

11625 FAIRES RD

10522226

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

3905B

FEE: 10.00 cash JC
DATE: 7-7-97 JC

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

PD 10.00 cash 7/11/97 JC
( ) CRT

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 3905B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 105-222-19 P8

STREET ADDRESS: ~~0 NE~~ Faires Rd. 11625

SUBDIVISION OR MOBILE HOME PARK NAME: 0

LOT NUMBER: 0

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

HEATED SQUARE FOOTAGE: 2730

NUMBER OF BEDROOMS: 4 | NUMBER OF OCCUPANTS: 4

CLOSING DATE_____

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
✓ ON SLAB
__ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
__ MUNICIPAL (M)
✓ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES ✓ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER:

NAME: Edwards Wayne + Gina Banner
(LAST) (FIRST) (MI)

ADDRESS: 3045 Rocky River Rd

CITY: Charlotte STATE: NC ZIP: 28215

DAYTIME PHONE: 704 333-0355

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) –

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Gina B Edwards DATE: 7-7-97

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3905B DATE: 12/15/97

TC: 105 222 19 P0 L

SERIAL Nº 17532

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 8/1/97. All work shall be completed on or before 1/15/98, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly. ☒ Well Installed

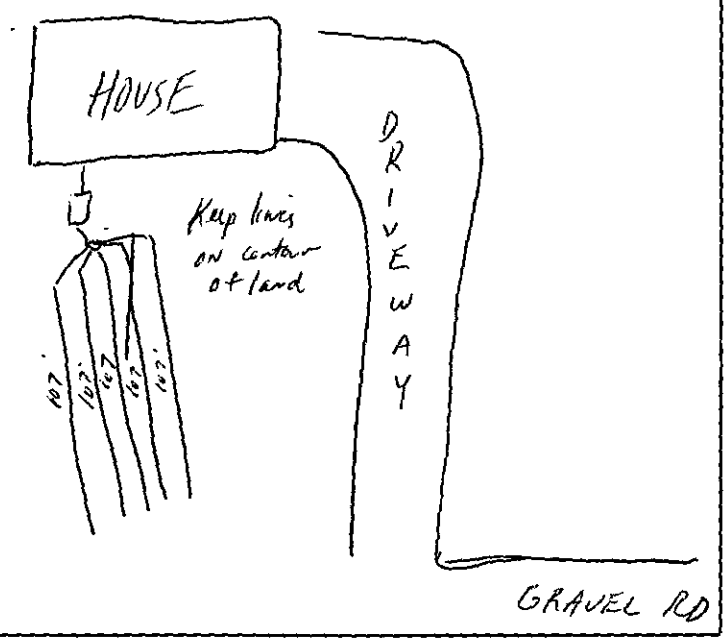

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction PCC

Trench Depth 24"

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Trench Walls Scored and Porous Yes

Total Line Length 535' feet

Number of Lines 5 (107')

Depth of Stone 12" inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well > 100' feet
50' min

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Wayne & Gina Edwards

LOCATION OF PROPERTY 11625 ~~Rocky River Rd~~ Faires Rd

Comments: 1500 ST, 5 lines x 107' long x 3' wd x 12" stone
Keep septic system > 100' from installed new well, Keep lines on contour of land

Philo S. Walker R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3905B DATE: 2/19/98

TC: 105 222 1990 ☒ L ☐ CRT

SERIAL Nº 17443

Name of Owner Wayne & Gina Edwards Juris.:

Address of Property 11625 Faires Rd

Inspection Data:

Tank Material PCC

Total Length of Drainfield 535'

Number of Lines 5 @ 107'

Cover Depth 18" - 24"

Water Supply Source well

Distance to Water Source >100'

Excavation Inspected 2/19/98

Tank(s) Inspected 2/19/98

Wash Line Inspected plumb to tank

High Water Alarm Inspected NA

PLOT

Design 1998, 1500ST, CON, 1610 SFT, 12"stone Cecil CTR# B. McCarver

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Septic system designed for 4 bedroom residence Type II

Phila S. Walker R.S.
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Permit Number: 3905B

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 105222 19 PO

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

.3 Long-term acceptance rate	480 Max gallons/day wastewater flow	1610 Absorption Area (sq ft)	9' Trench spacing (min. on centers)
YES Serviced by private well	1500 Gallon septic tank	535' Total trench length (ft)	24" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
4 Bedrooms in residence	NA Gallon pump tank	12" Depth of stone	

Any surface waters present: ~~No~~ Yes Type: Minimum separation distance: >50

Site modifications required:

Additional Conditions:

Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

1610 Absorption Area (Sq ft) 535' Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	12" Maximum Trench Depth

For existing system, enter the year originally installed:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department
- This Improvement permit is transferable.

Phila A. Walker R.S. 8-1-97
DEHNR Authorized Agent Date

× Lina B Edwards
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Paid 10/ CRT 8/4/00

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 8/1/97 **PERMIT NO:** 3905B
PARCEL NO: 105 222 19P0

JOB LOCATION ADDRESS: 11625 Farris Rd
PROPERTY OWNER: Wayne & Gina Edwards
BUILDING CONTRACTOR: —
SUBDIVISION NAME: —
AUTHORIZATION ISSUED BY: Phillip J. Walker R.S. **DATE:** 8/1/97
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 3905B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED **PRIOR** TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: _____

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

x Gina B Edwards 8-1-97
SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3905B

TC: 105-222-19 & 18

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

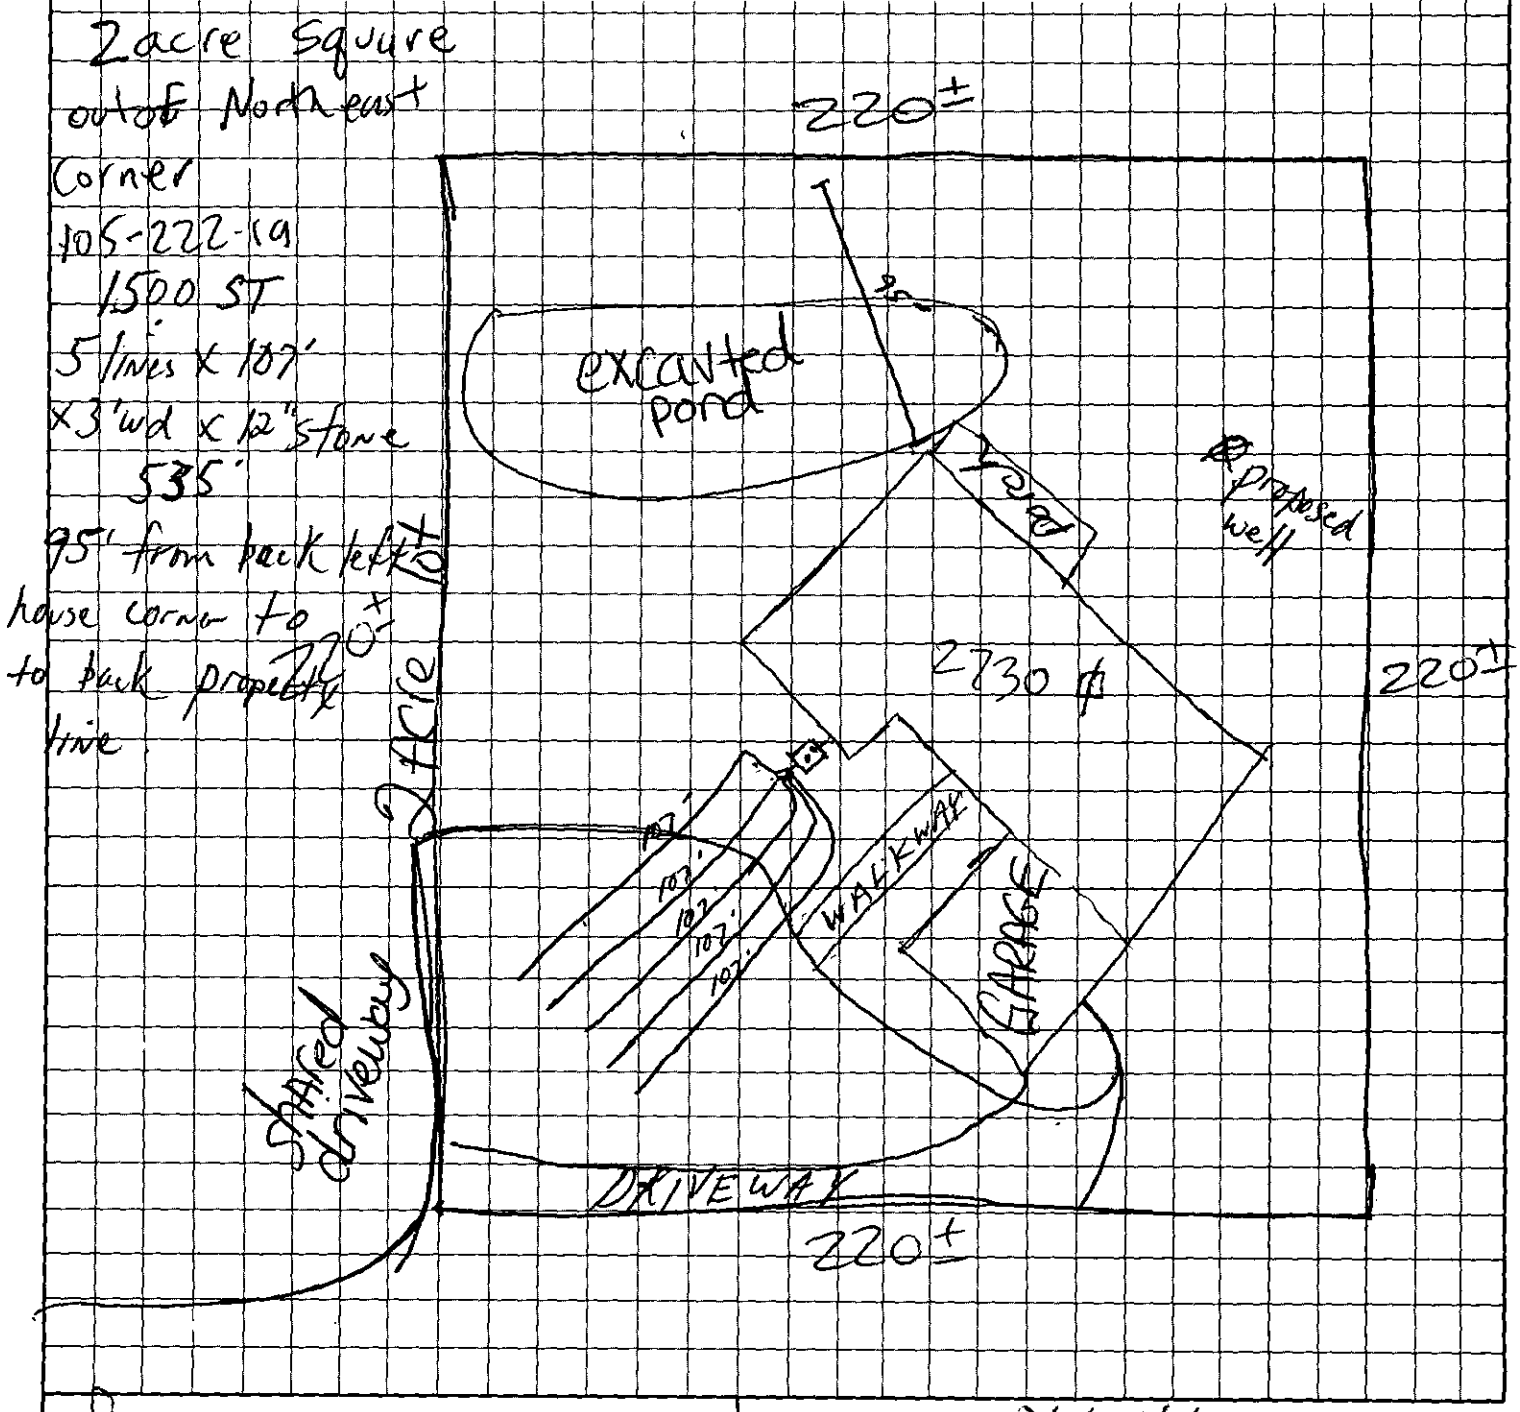

Lina B Edwards
OWNER/AGENT SIGNATURE

DATE 8-1-97

APPROVAL DATE JW 8/1/97

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy



DATE July 7, 1997

TO: CHARLOTTE-MECKLENBURG BUILDING STANDARDS
PERMIT ISSUING SECTION

FROM: MECKLENBURG COUNTY ENGINEERING

JURISDICTION Meck

105-222-19 po
PARCEL NUMBER

11625 Faires Rd
ASSIGNED STREET ADDRESS (ADDRESS OF RECORD)

EXISTING STREET ADDRESS (IF DIFFERENT FROM ASSIGNED)

N/A
PROJECT NAME (IF APPLICABLE)

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

1. SUBDIVISION REGULATIONS	**____APPROVED**	**____NOT APPROVED**
2. FLOODWAY REGULATIONS	**____APPROVED**	**____NOT APPROVED**
3. WATERSHED PROTECTION	**____APPROVED**	**____NOT APPROVED**
4. COMMERCIAL DRAINAGE PLAN	**____APPROVED**	**____NOT APPROVED**
5. PUBLIC UTILITY EASEMENT	**____PRESENT**	**____NOT PRESENT**
6. PROPERTY FRONTS ON THOROUGHFARE	**____YES**	**____NO**
7. DRIVEWAY PERMIT REQUIRED	**____YES**	**____NO**
8. DOES PROJECT CONFLICT WITH ROAD PROJECT?	**____YES**	**____NO**

REMARKS: Single Family

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIERS OFFICE WHEN PAYING PERMIT FEE. CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAY(S).

ALL OTHER FORMS OBSOLETE

☐ NEW ADDRESS -

SIGNED: Daryl A. Hess

REVISED 1/91

DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

COUNTY: Lee

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

#1 3905B
PO105-232-19

OWNER: Wayne & Steve Edwards APPLICANT: _____
ADDRESS: 3045 Rocky River Rd Sanford APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949): 360gpd PROPERTY SIZE: 1.0
LOCATION OF SITE: Farrier Rd PROPERTY RECORDED: _____
WATER SUPPLY: ☑ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	Slopes 5-10% .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-8"	gr/scl	Fr/SEXP/SS/SP	7-46" TO 50:1 wetness	46"	N/A	None	PS .39 | F2 LV
		8-48"	SBK/SC	Fi/SEXP/SP					
2	LS	0-6"	gr/scl	Fr/SEXP/SS/SP	7-48" TO soil wetness	46"	N/A	None	PS .39 | F2 LV
		6-48"	SBK/SC	Fi/SEXP/SP					
3	LS	0-7"	gr/scl	Fr/SEXP/SS/SP	7-46" TO 50:1 wetness	46"	N/A	None	PS .39 | F2 LV
		7-48"	SBK/SC	Fi/SEXP/SP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): provisionally Suitable
EVALUATED BY: W.R. Mauldin 7-30-97
OTHER(S) PRESENT: LSS

COMMENTS: 100% Repair, any need permit

LEGEND

use the following standard abbreviations

ANDSCAPE POSITION	GROUT	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)			MOIST	WET
(Ridge)		SCL (Sandy Clay Loam)				
(Shoulder Slope)		SUC (Silt Loam Clay)			VFR (Very Friable)	NS (Non-sticky)
(Terrace)					FR (Friable)	SS (Slightly Sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FI (Firm)	S (Sticky)
		SIC (Silty Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
					EFI (Extremely Firm)	NP (Non-plastic)
		O (Organic)	None			SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

OTES


ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
ESTRICTIVE HORIZON	Thickness and depth from land surface
PROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)


valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²


Show profile locations and other site features (dimensions, reference or benchmark, and North).

3905B

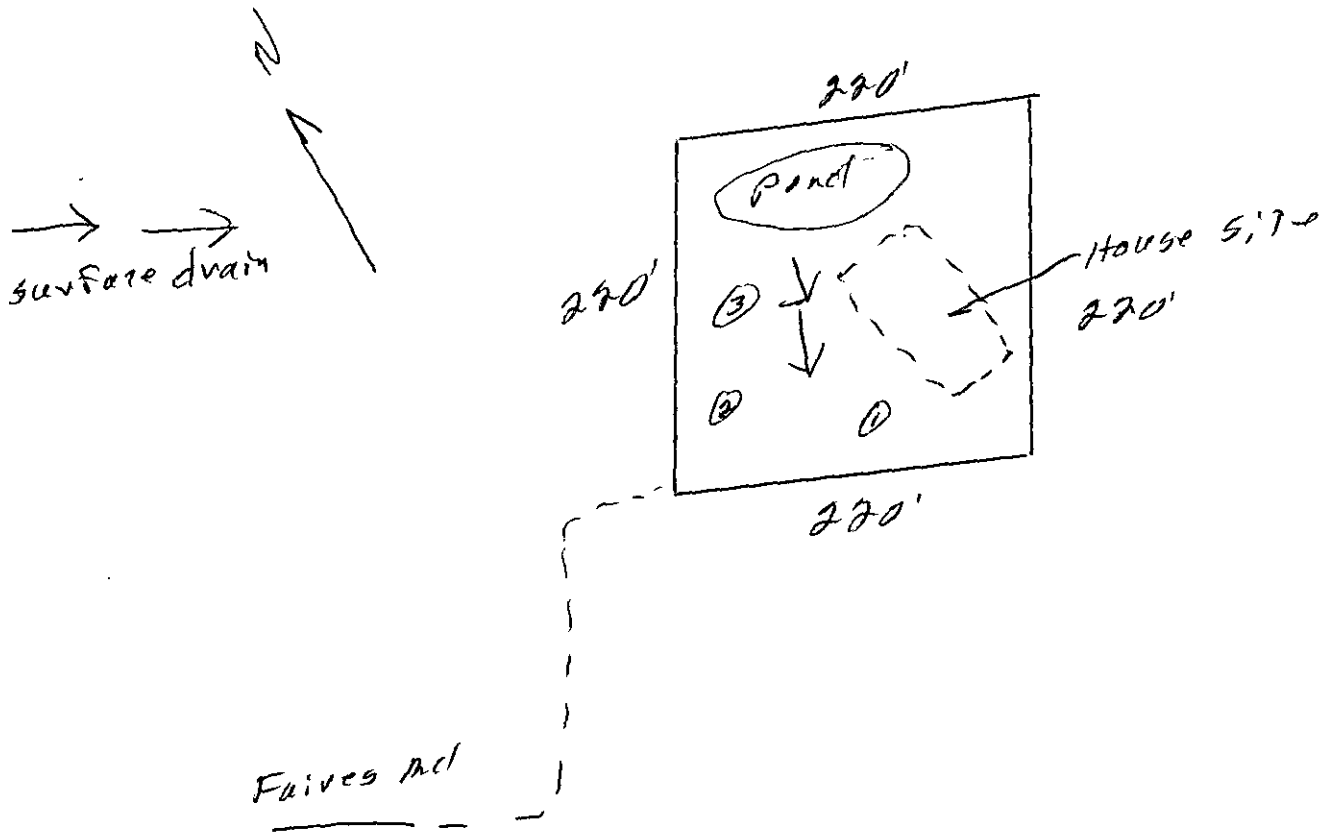

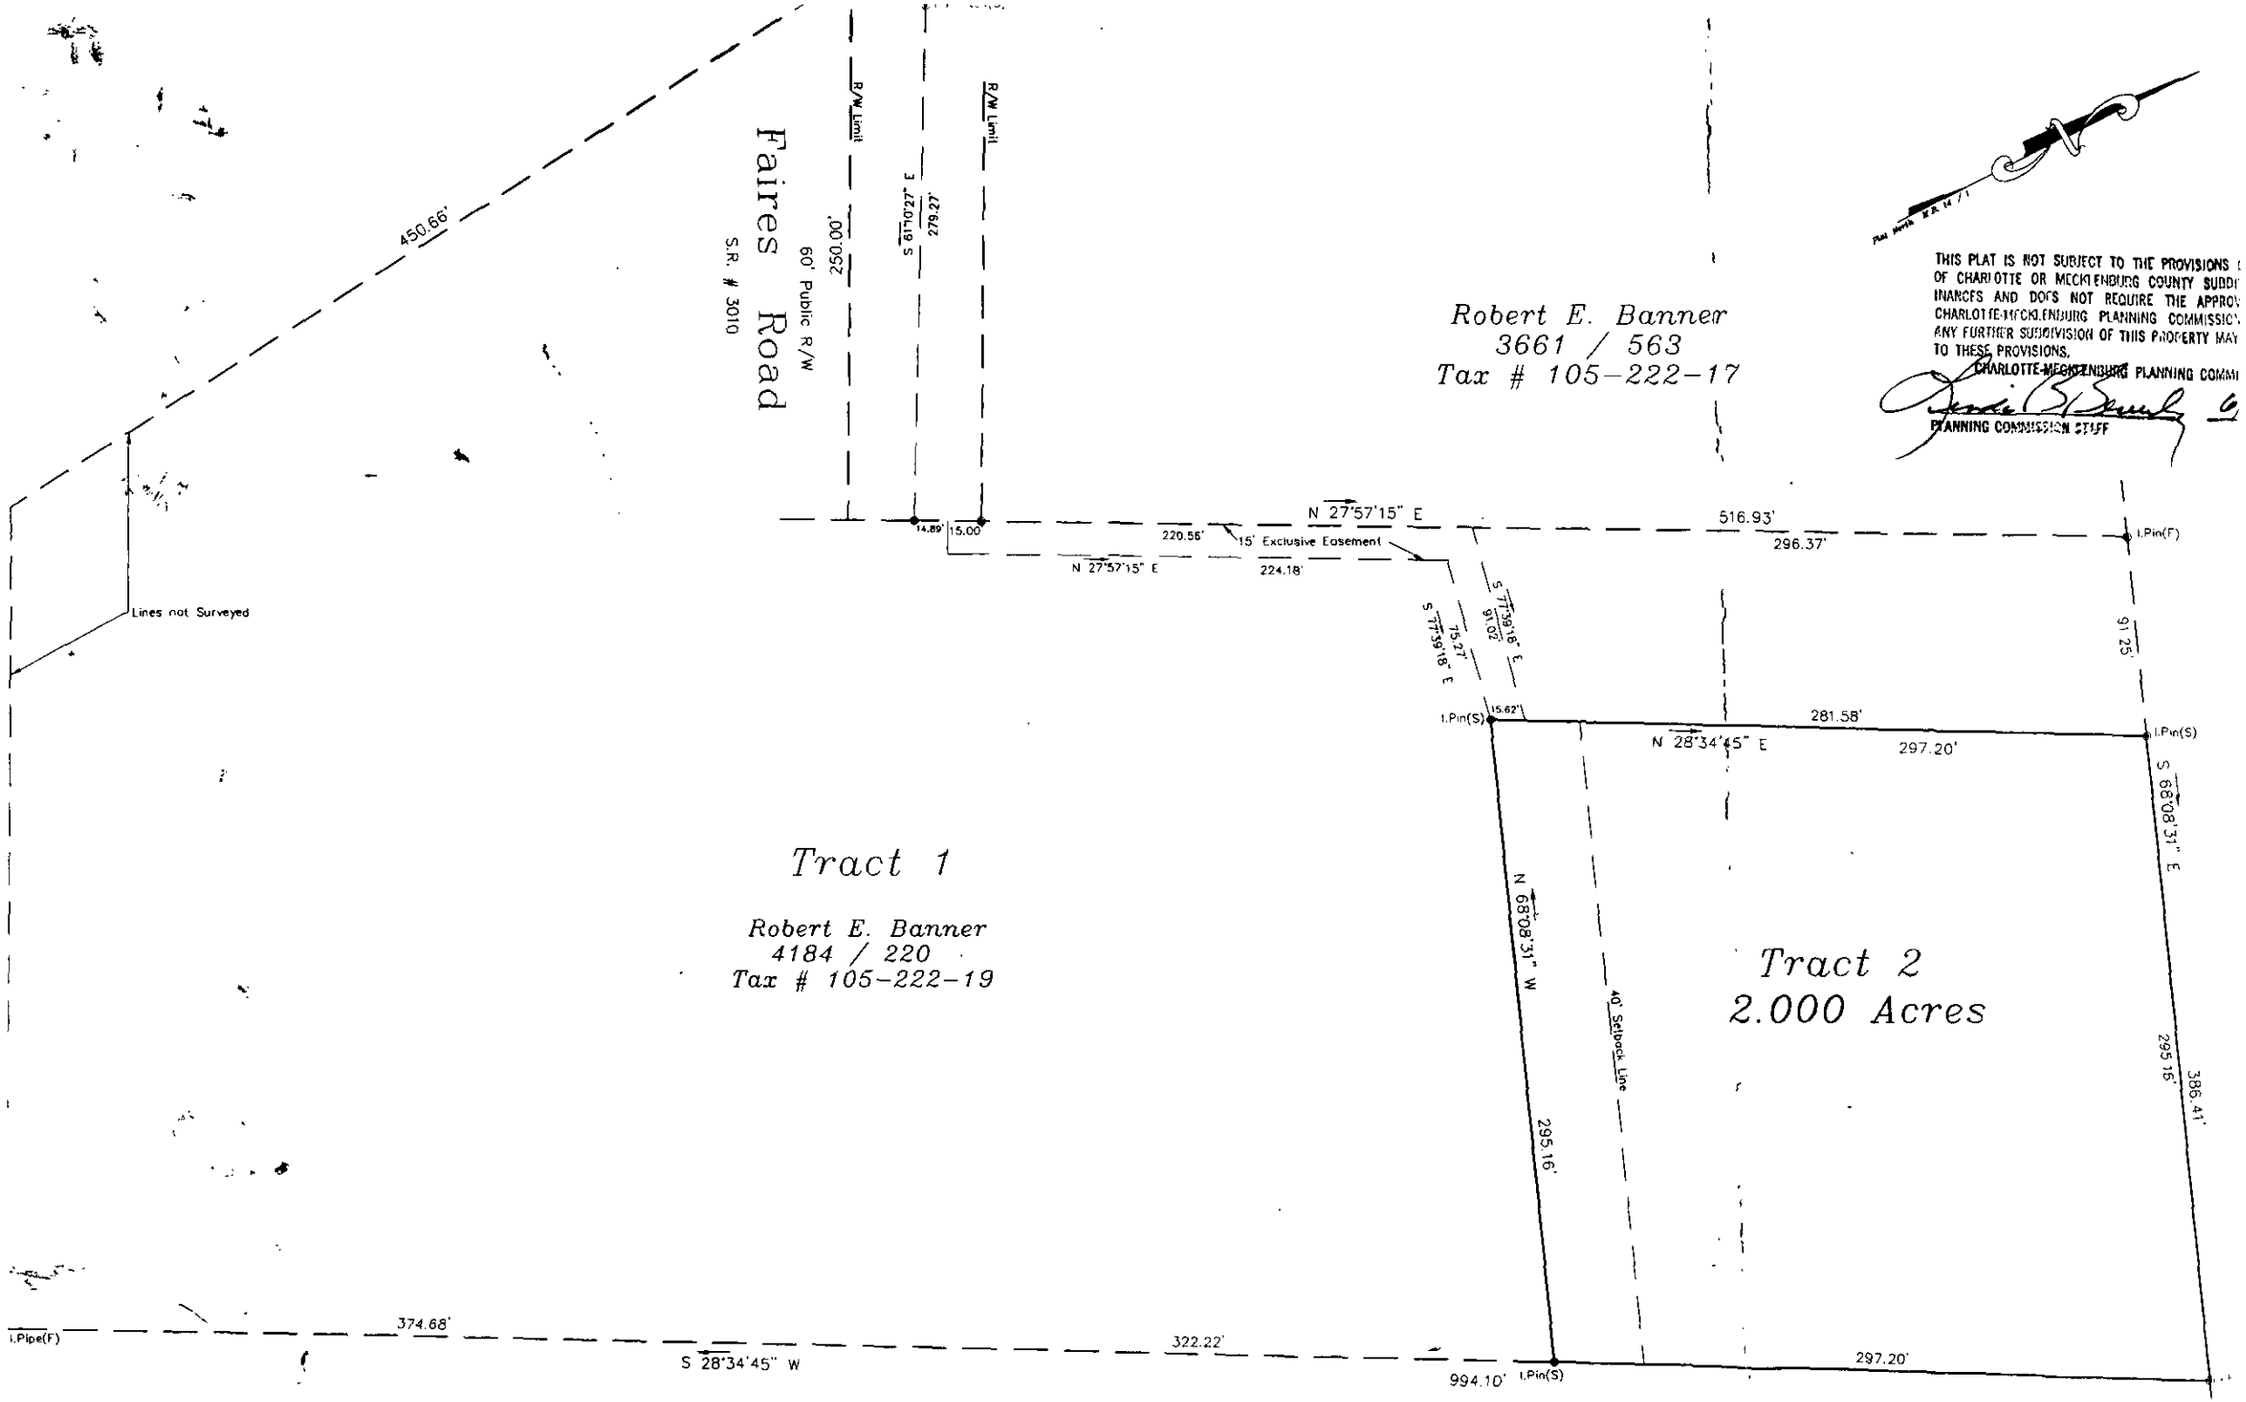


THIS PLAT IS NOT SUBJECT TO THE PROVISIONS
OF CHARLOTTE OR MECKLENBURG COUNTY SUBDI
INANCES AND DOES NOT REQUIRE THE APPRO
CHARLOTTE-MECKLENBURG PLANNING COMMISSIO
ANY FURTHER SUBDIVISION OF THIS PROPERTY MA
TO THESE PROVISIONS.
CHARLOTTE-MECKLENBURG PLANNING COMMI
PLANNING COMMISSION STAFF

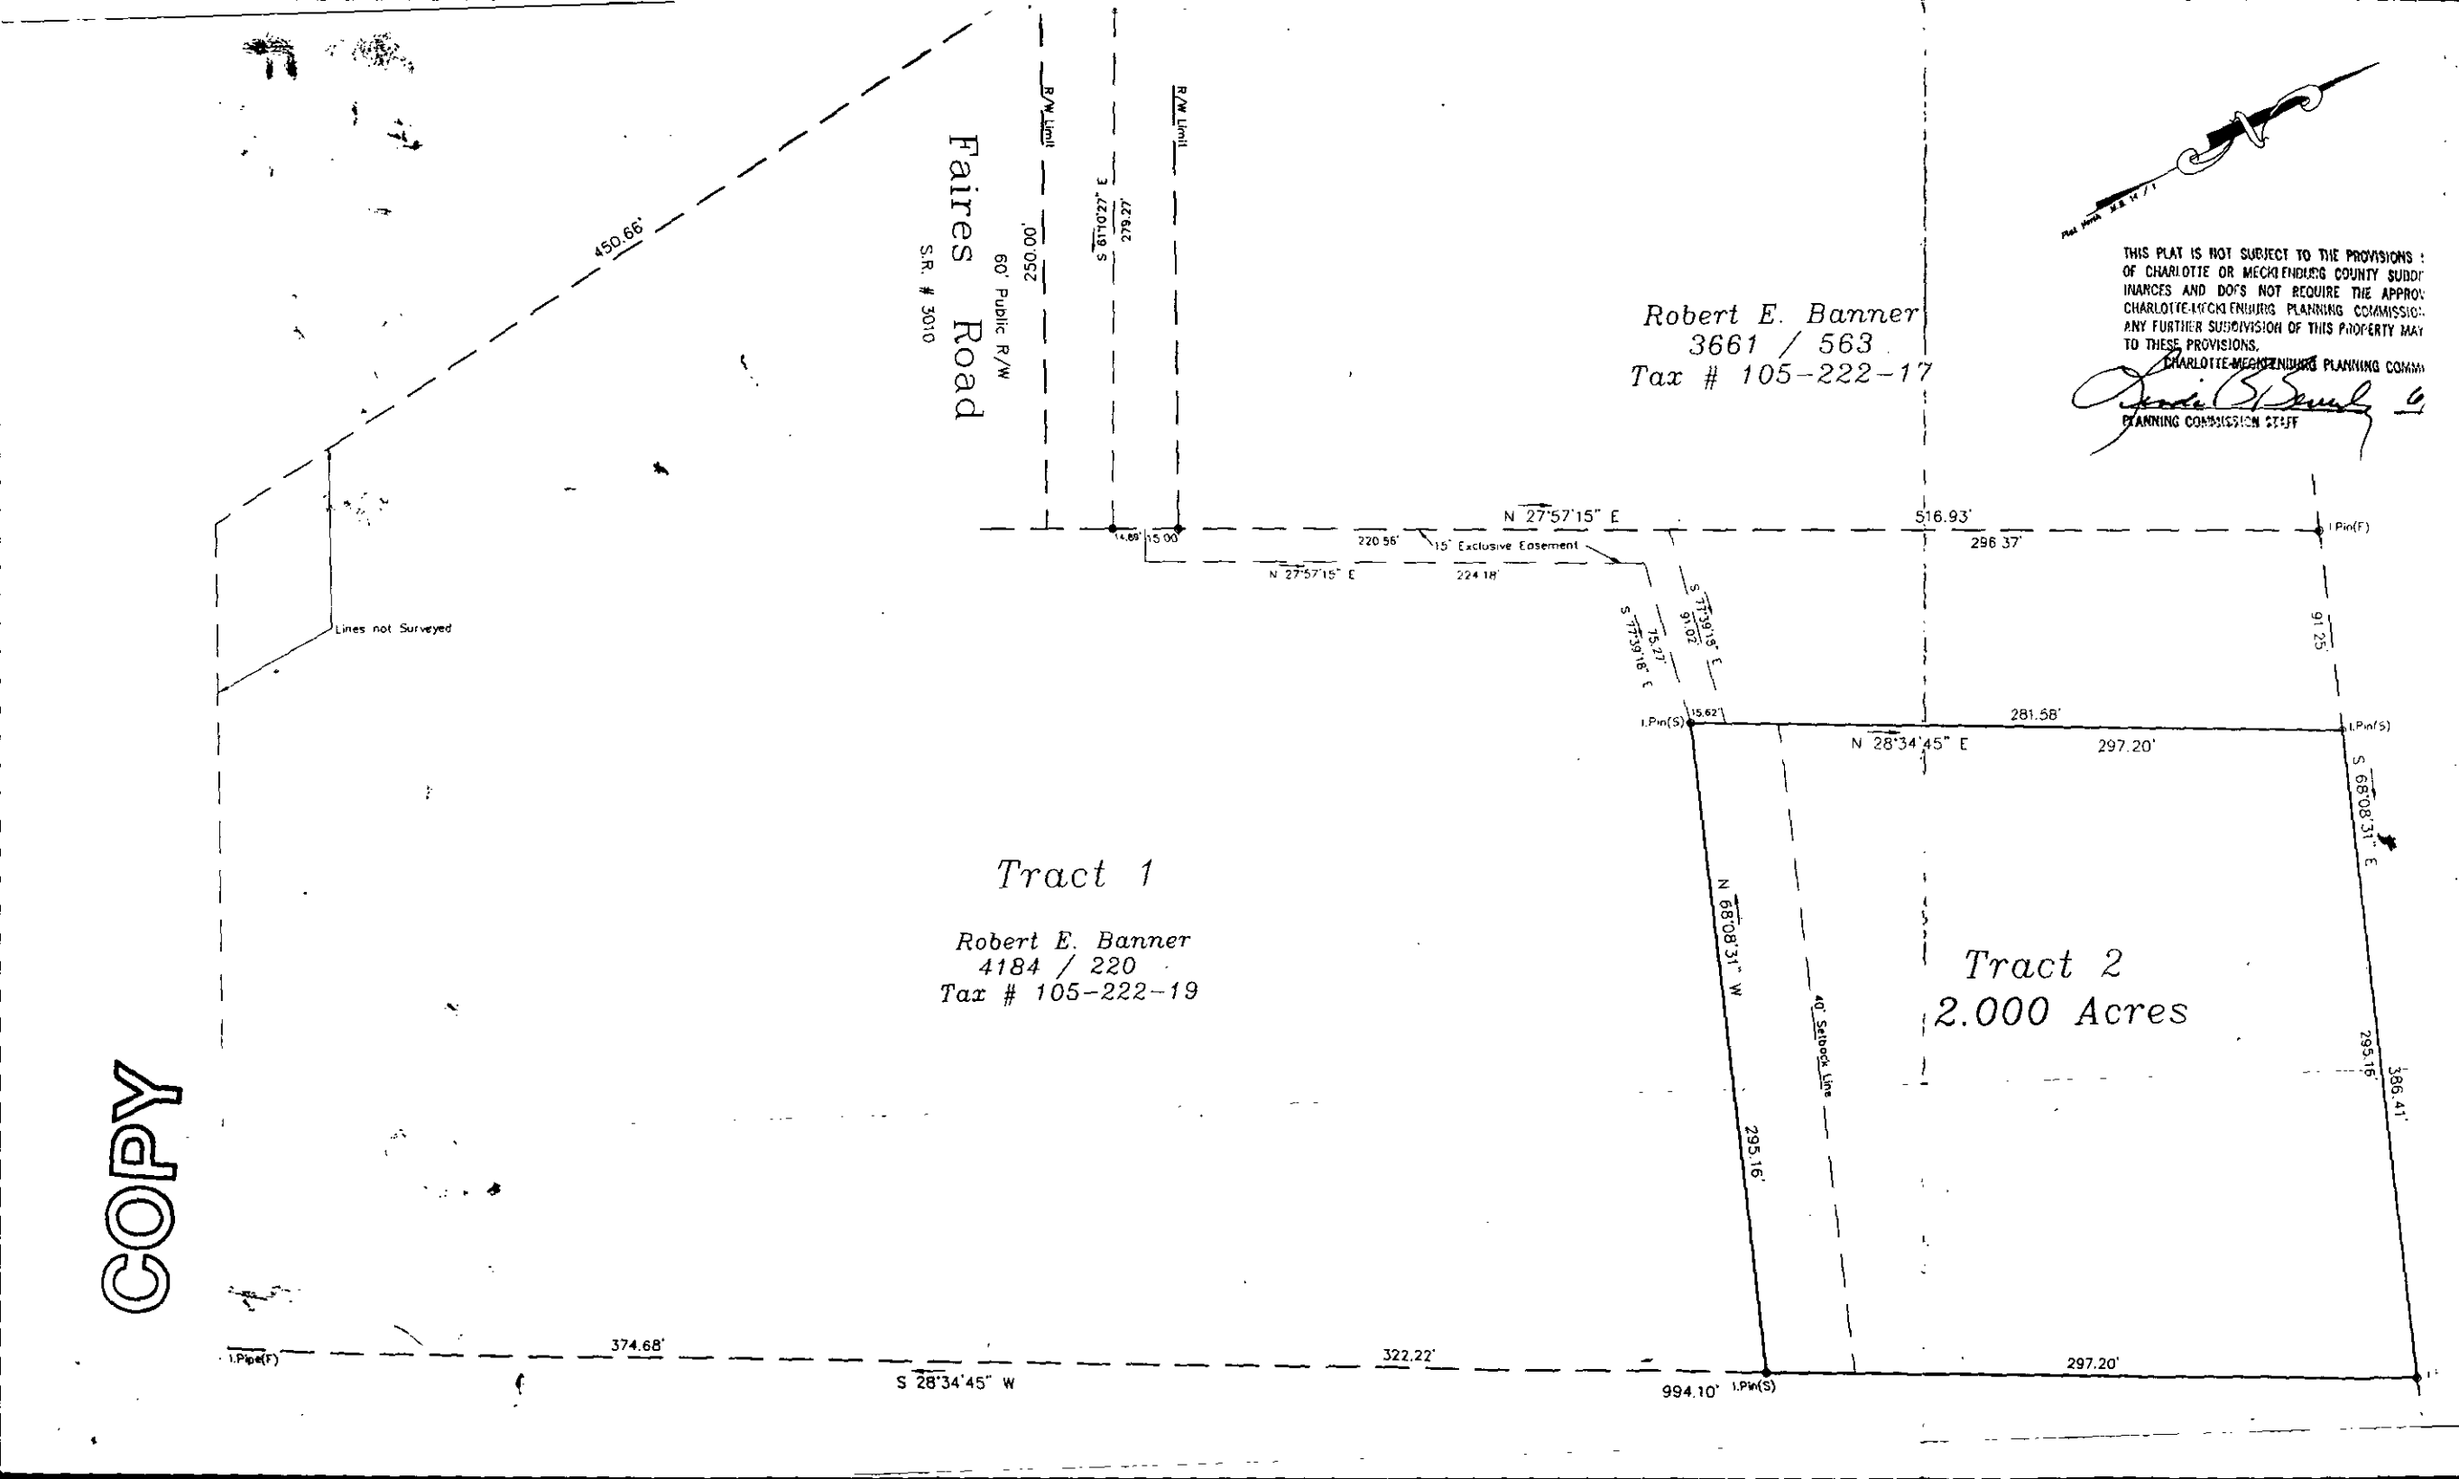
Faires Road
S.R. # 3010
60' Public R/W
R/W Limit
R/W Limit
.00
252.00'
S 61°10'22" E
279.27'
450.66'
Lines not Surveyed
Robert E. Banner
3661 / 563
Tax # 105-222-17
THIS PLAT IS NOT SUBJECT TO THE PROVISIONS
OF CHARLOTTE OR MECKLENBURG COUNTY SUBDI
INANCES AND DOES NOT REQUIRE THE APPRO
CHARLOTTE-MECKLENBURG PLANNING COMMISSIO
ANY FURTHER SUBDIVISION OF THIS PROPERTY MA
TO THESE PROVISIONS.
CHARLOTTE-MECKLENBURG PLANNING COMM
PLANNING COMMISSION STAFF
N 27°57'15" E
516.93'
296.37'
I.Pin(F)
14.88'
15.00'
220.56'
15' Exclusive Easement
N 27°57'15" E
224.18'
S 77°39'15" E
91.02'
S 77°39'16" E
75.27'
91.25'
I.Pin(S)
15.62'
281.58'
I.Pin(S)
N 28°34'45" E
297.20'
S 68°08'31" E
N 68°08'31" W
295.16'
40' Setback Line
Tract 1
Robert E. Banner
4184 / 220
Tax # 105-222-19
Tract 2
2.000 Acres
295.16'
386.41'
297.20'
374.68'
I.Pipe(F)
S 28°34'45" W
322.22'
994.10'
I.Pin(S)

COPY

PG. 14

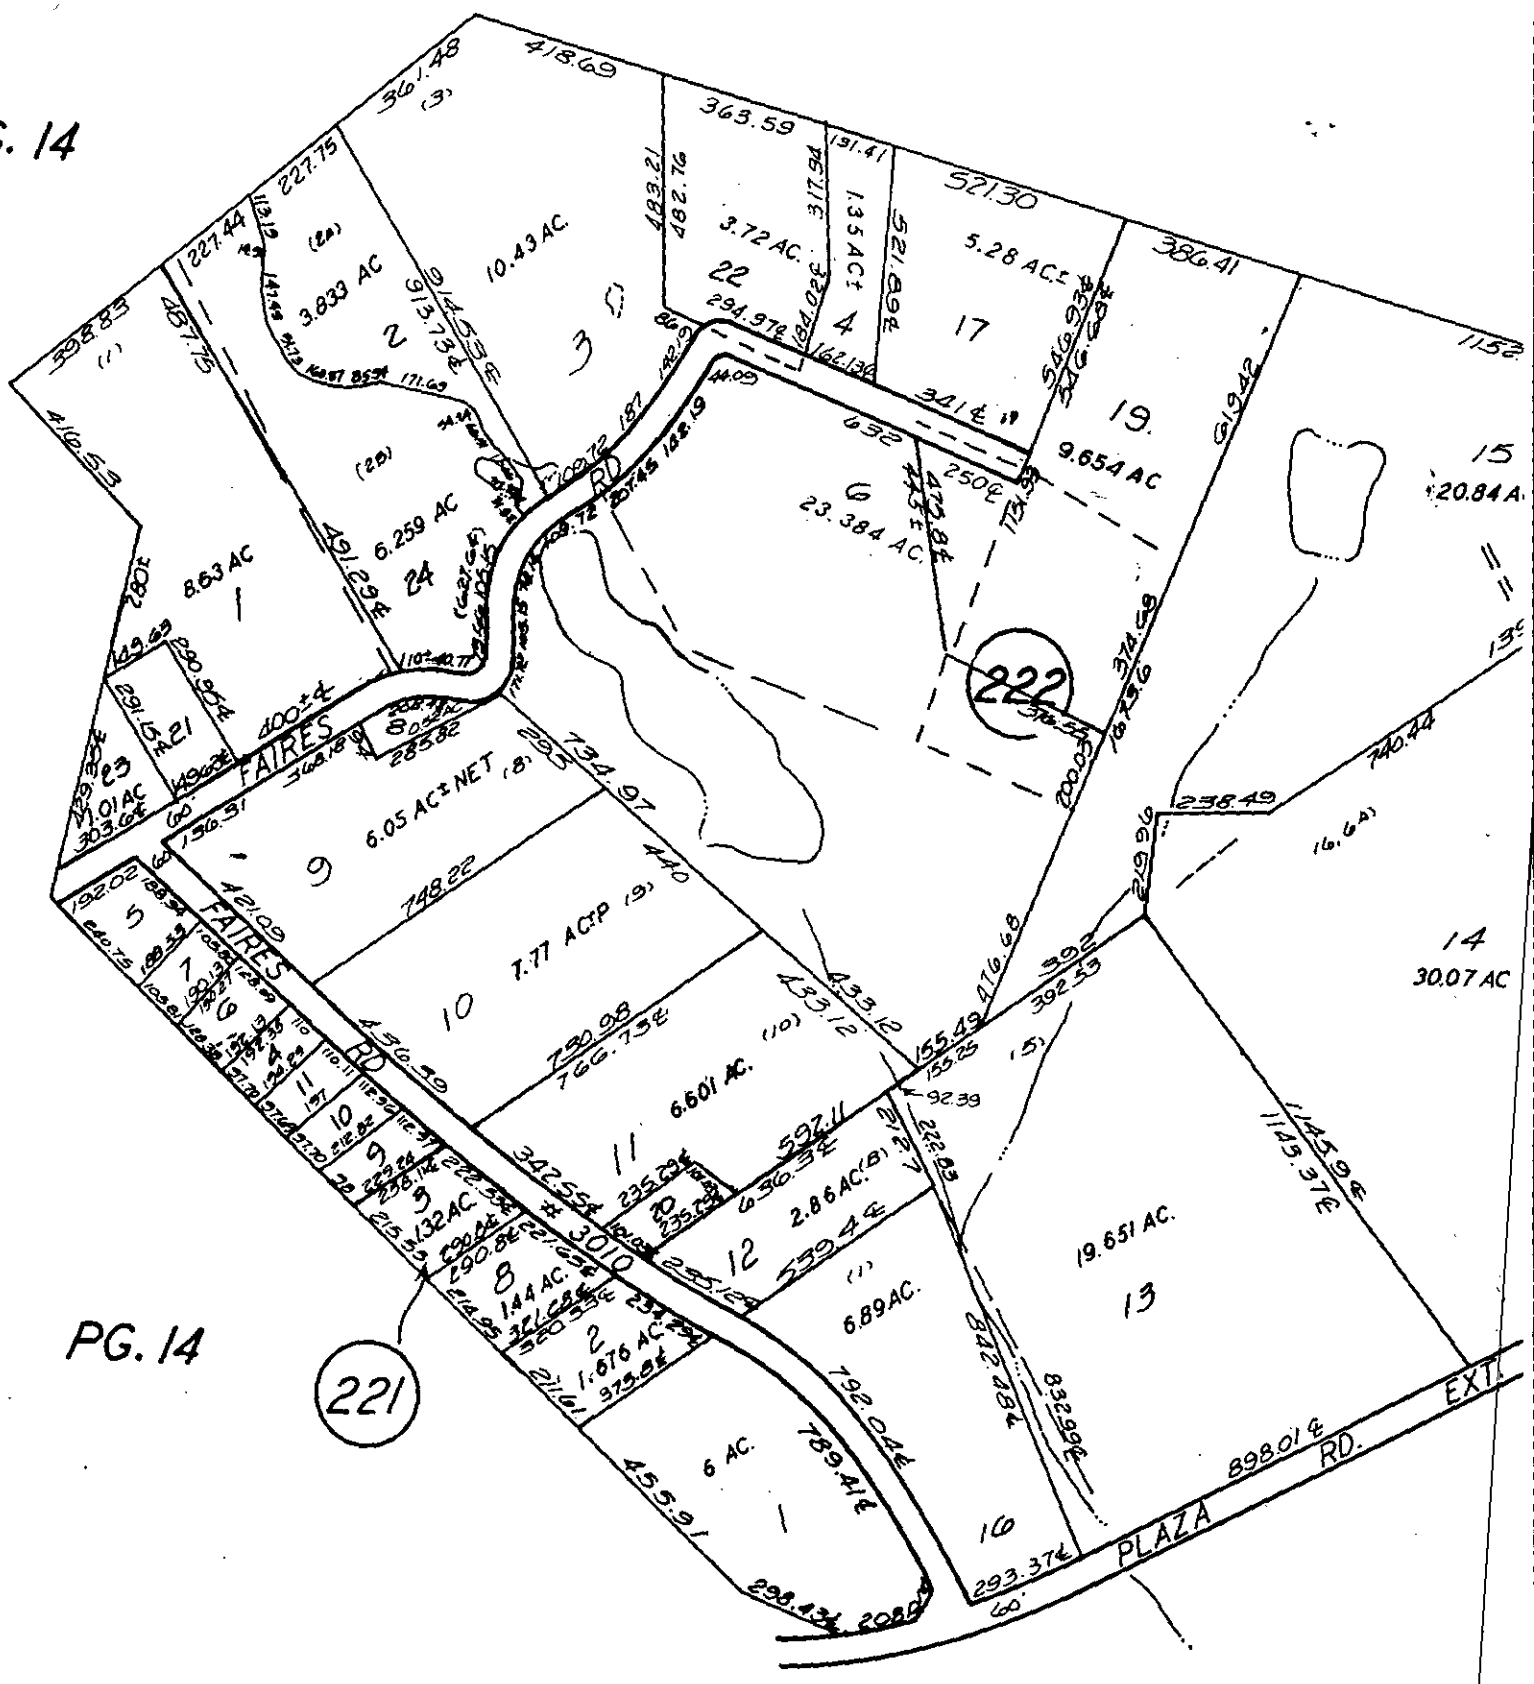
FAIRES RD
PLAZA RD. EXT.
221
222
3010
10.43 AC.
3.839 AC
6.259 AC
8.63 AC
6.05 AC± NET
7.77 AC±
6.601 AC.
2.86 AC±
1.144 AC.
1.676 AC±
6 AC.
3.72 AC.
5.28 AC±
9.654 AC
23.384 AC.
19.651 AC.
6.89 AC.
30.07 AC
20.84 A
11.01 AC

PG. 14