MECK. COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH
Date Received RECEIVED 2/3/78 Apt. No. (S) _____

Application No. (W) 5755
T. C. No. 139-271-25
Map Date _____

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR WELL WATER SUPPLY PERMIT

NAME OF OWNER _____ (LAST / FIRST / MIDDLE)

ADDRESS OF OWNER _____ ZIP _____

PHONE NO. Home _____ Office _____

LOCATION OF PROPERTY _____ (STREET OR COUNTY ROAD)


SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO. _____ FHA LOAN

DEED REFERENCE: DEED BOOK _____ PAGE NO. _____ VA LOAN

WELL CONTRACTOR _____ LICENSE NO. _____

Application is hereby made to the Mecklenburg County Health Department for a permit to drill a water well on the hereinabove described lot to be used as a source of _____ individual, _____ semi public, or _____ public water supply:

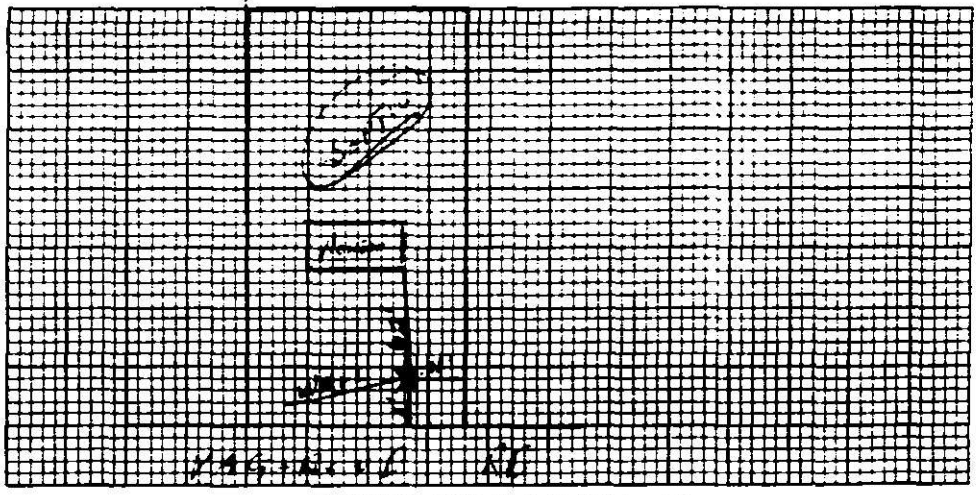

ACCURATELY DIAGRAM & DIMENSION LOT

2/3/78
DATE OF APPLICATION

OWNER

Application approved and permit hereby granted

Permit No: 5755

ENVIRONMENTALIST

FORM NO. E-28-5-1-73

HEALTH DEPARTMENT'S COPY

MAR 0 1978

Date Received 3-16-23

APT No [redacted]

T C No

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR PERCOLATION TEST

1) NAME OF OWNER Helms (LAST) Hurley (FIRST) Smith (MIDDLE)

2) ADDRESS OF OWNER 6015 Woodbridge Rd Charlotte NC ZIP 28212

3) PHONE NO Home 537-0218 Office 333 3151


4) LOCATION OF PROPERTY Butterfield Park off Briar Road (STREET OR COUNTY ROAD) Vagabond Rd. Mck.

5) SUBDIVISION Butterfield Park. LOT NO [redacted]-44 BLOCK NO 45-46

MAP BOOK NO 12 PAGE NO 541

6) DEED REFERENCE DEED BOOK 2739 PAGE NO 224

Application is hereby made to the Mecklenburg County Health Department for the conduct of a percolation test and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge

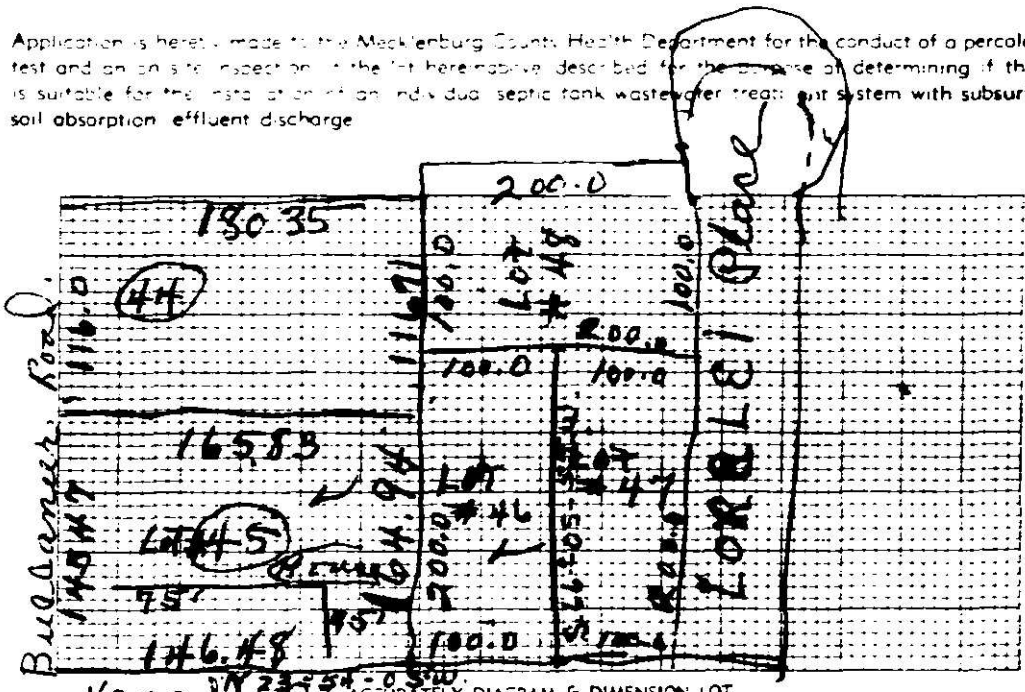

1) ACCURATELY DIAGRAM & DIMENSION LOT

Harley S Helms.
OWNER

FORM NO E-1-9-1-72

HEALTH DEPARTMENT'S COPY

MECKLENBURG COUNTY
Department of Public Health
1200 Blythe Boulevard
Charlotte, North Carolina 28203

Telephone 374-2113

Date Issued
1. April 19, 1973
2. _____
3. _____

SITE DISAPPROVAL REPORT
INDIVIDUAL SEPTIC TANK SYSTEM WITH SUBSURFACE,
SOIL ABSORPTION, EFFLUENT DISCHARGE

SDR No. 5755 25
T.C. No. 139-271-26

NAME OF OWNER Helms, Hurley Smith

ADDRESS OF OWNER 6015 Woodbridge Road ZIP 28212

LOCATION OF LOT Vagabond [illegible] Lots [illegible] 6 46

The lot described above has been disapproved for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge due to the following:

FAILURE TO PASS PERCOLATION TEST (60 minutes per inch or less)

	Test No.	Date of Test	Percolation Rate
X	1.	[illegible]	135 min/in
____	2.	____	____ min/in
____	3.	____	____ min/in

____ ON SITE INSPECTION REVEALED LOT TO BE UNSUITABLE FOR THE FOLLOWING REASON(S) _____

R. M. Reynolds
Environmentalist

(Stencil No.)
MED 396
1/70

FORM NO. [illegible]-70

Serial No. 0

PTR No. 5755

T C No 139-271-26

Map Date _____

Date Issued May 2, 1973

Do Not Issue A Building Permit Based On This Form

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


PERCOLATION TEST REPORT

NAME OF OWNER Helms (LAST) Hurley (FIRST) Smith (MIDDLE)

ADDRESS OF OWNER 6015 Woodbridge Road ZIP 28212

LOCATION OF PROPERTY Vagabond Road (STREET OR R.F.D. NO. ROAD)

SUBDIVISION Butterfield Park LOT NO 4 & 5 4E BLOCK NO

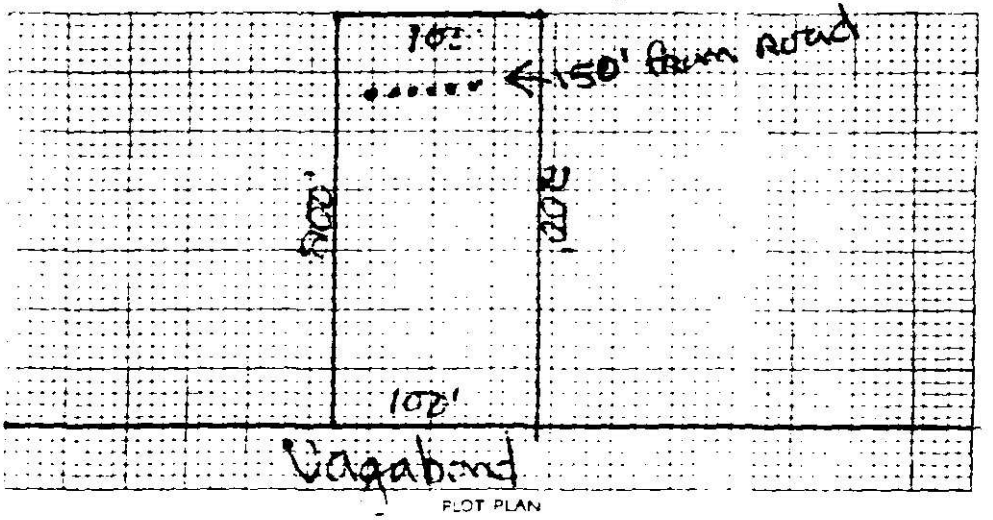

PLOT PLAN

This is to certify that a percolation test has been run and an on site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 58 min/in. The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run.
4. This approval is void if any grading, filling, or construction (including the placing of fill) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

John R. Atkinson

Director, Environmental Health Division or Authorized Section Head

FORM NO. E-2-4-1-71

HEALTH DEPARTMENT'S COPY

SEE INSTRUCTIONS ON BACK

Date Received 5-25-73

ICAR'S Application No 5755

T C No 124-371-2736

Map Date


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

Application for an
Installation, Construction, Alteration, and/or Repair Permit
Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1 X Install or Construct 2 Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption, effluent discharge

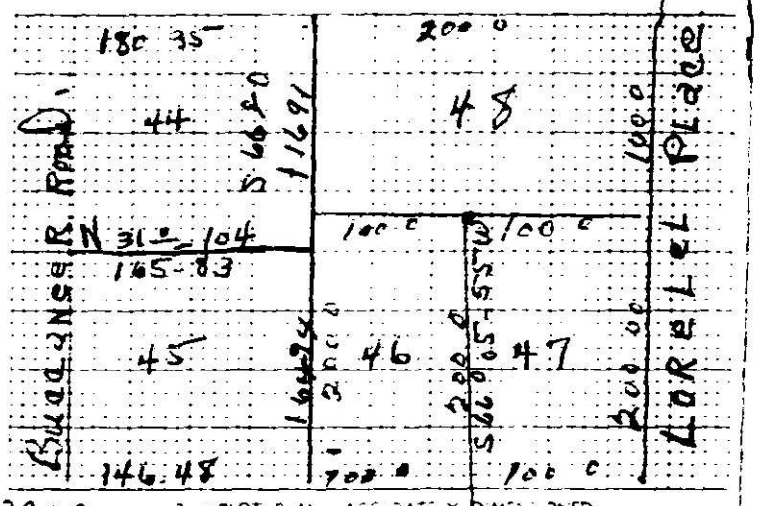

VAGABOND Road. PLOT PLAN ACCURATELY DIMENSIONED

3

13) NAME OF OWNER Helms Hurley (LAST) (FIRST) Smith. (MIDDLE)

14) ADDRESS OF OWNER 6015 Woodbridge Road.

15) PHONE NO Home 537-0218 Office 333-3151

16) LOCATION OF SYSTEM VAGABOND Road, THECK. (STREET OR COUNTY ROAD)

17) SUBDIVISION Batterfield Lot No 46 Block No 3

Map Book No 2739 Page No 224

18) DEED REFERENCE — DEED BOOK 2739 AT PAGE 224

19) HAS A PERCOLATION TEST BEEN RUN? ✓ YES ___ NO DATE RUN 5-17-73

20) PTR NUMBER See Instructions

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true

DATE OF APPLICATION

Hurley S Helms
OWNER

FORM NO E-4-9-1-72

HEALTH DEPARTMENT'S COPY

Date Issued May 25, 1973

Serial No. 2982

LA No 5755

T C No 139-271-26

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Helms (LAST) Hurley (FIRST) Smith (MIDDLE)

ADDRESS OF OWNER 6015 Woodbridge Road ZIP

LOCATION OF LOT Vagabond Road (STREET OR COUNTY ROAD)

SUBDIVISION Butterfield LOT NO 46 BLOCK NO 3

MAP BOOK NO PAGE NO

The above specified lot is approved by the Mecklenburg County Health Department for the installation of an individual septic tank system with subsurface, soil absorption effluent discharge based on the percolation test results which yielded a percolation rate of 58 min/in on an on site inspection of the said lot, and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" number 5755. This approval is subject to the following terms and conditions

1. That the nitrification field be installed constructed, altered, and, or repaired in the same area where the percolation test was run
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration and/or Repair Permit.

R. M Reynolds
Environmentalist

John R Adkerson
Director, Environmental Health Division or Authorized Section Head

FORM NO E-3-4-1-71

HEALTH DEPARTMENT'S COPY

Date Received 4-21-77

APT No. 16206

T. C. No. 139-271-25

Map Date 1-15-75

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Helms (LAST) Tyler (FIRST) (MIDDLE)

2) ADDRESS OF OWNER Manor Joint Co. . . Box 25311 Charlotte . . ZIP 2821[illegible]

3) PHONE NO Home _____ Office 536-2100

4) LOCATION OF PROPERTY Vagabond Rd. off Briar Rd. (STREET OR COUNTY ROAD)


5) SUBDIVISION [illegible] Park LOT NO 14 BLOCK NO _____

Tax Lot 139-271-25

MAP BOOK NO _____ PAGE NO _____

6) DEED REFERENCE DEED BOOK _____ PAGE NO _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge

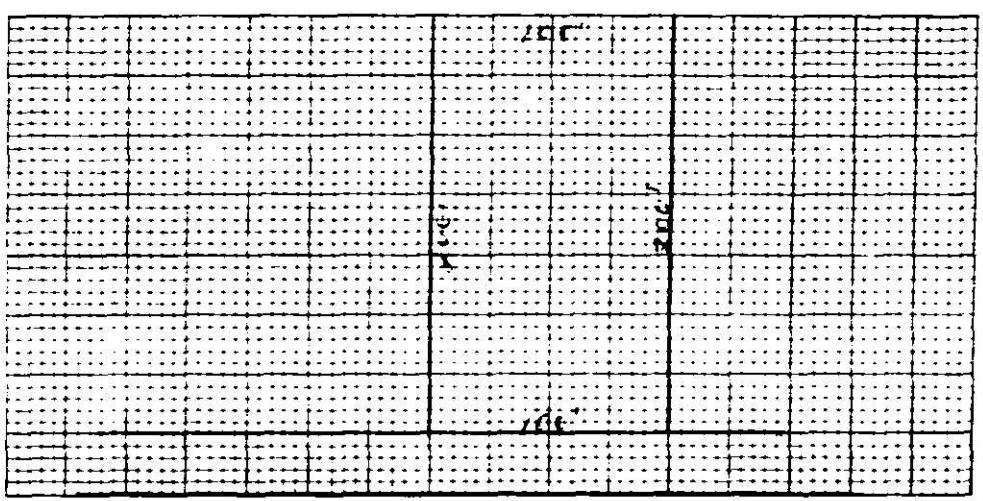

7) ACCURATELY DIAGRAM & DIMENSION LOT

Timothy S Helms

OWNER

EHD-5-76

Environmental Health Department's Copy

Date Received 12-2-77

ICAR(S) Application No 5155

T C No [illegible]


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1 [illegible] Construct 2 Alter or Repair an individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge

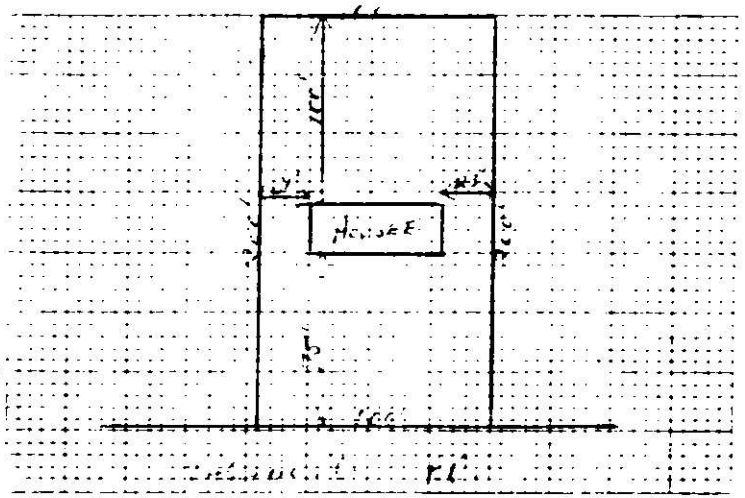

3 PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home Yes No

4 No of Bedrooms 3

5 House Use Max No Employees

6 Washing Machine Yes No

7 Garbage Disposal Yes No

8 Dishwasher Yes No

9 Water Supply
A Individual Well
B Governmental System
C Community System
Well source
2 Governmental source

10 Sewage System
House located within 200 feet of public sewer Yes No
House located within 200 feet of community sewer Yes No

11 FHA Case No

12 VA Case No

13) NAME OF OWNER [illegible] Elwin (LAST) (FIRST) K. (MIDDLE)

14) ADDRESS OF OWNER [illegible] Idlewood Rd. Charlotte [illegible]

15) PHONE NO Home [illegible] Office [illegible]

16) LOCATION OF SYSTEM [illegible] Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION Ballantyne Park Lot No. 46 Block No.

Map Book No Page No.

18) DEED REFERENCE — DEED BOOK AT PAGE

19) HAS A SOIL INVESTIGATION BEEN RUN? YES NO DATE RUN

20) PTR NUMBER (See Instructions)

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

DATE OF APPLICATION

Edwin K. Galloway Jr.
OWNER

EHD-5-76

Environmental Health Department's Copy

Serial No. 1401

LA No. 5755

Date Issued December 12, 1977

T C. No. 139-271-25

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Galloway (LAST) Edwin (FIRST) K. (MIDDLE)

ADDRESS OF OWNER 6528 Idlewild Road, Charlotte, NC ZIP

LOCATION OF LOT Vagabond Drive (STREET OR COUNTY ROAD)

SUBDIVISION Butterfield Park LOT NO 46 BLOCK NO.

MAP BOOK NO. PAGE NO

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot, and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 5755. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation Construction Alteration, and/or Repair Permit

Environmentalist

John R. Atkisson

Environmental Health Director, or Authorized Section Head

EHD-5-76

Environmental Health Department's Copy


Date Issued May 5, 1978 Serial No. 1540 ICARUS Permit No 5755

T C No 139-271-25

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge as applied for herein at the described location. This permit is granted based upon the information supplied in application # 5755 dated and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before after which date this permit shall be null and void.

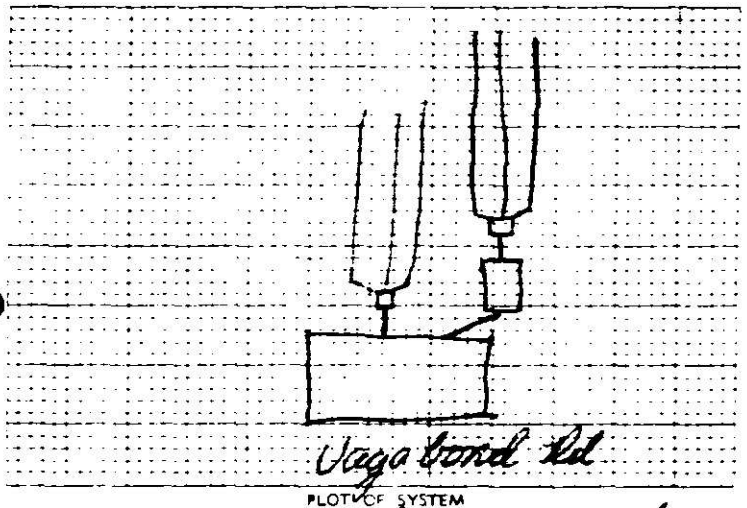

PLOT OF SYSTEM

Permeability Rate 60/min.

Liquid Capacity of Tank 1000/gal.

Type Construction RC.

Absorption Area Determined by

Total Line Length 330'; 125'

Number of Lines 5 & 4

Distance from House 10'+

Distance from Property Line 10'+

Distance from Well 100'+

NAME OF OWNER Ewurni K. Galloway

LOCATION OF PROPERTY Vagabond Rd.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. **The issuance of this permit does not in any guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments (15'x66')
(12'x32')

Division or Section Head

Environmentalist Eddie Reynolds

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-S-76

Environmental Health Department's Copy

C of A (s) No. 5755

Date Issued May 10, 1978 Serial No. 1490

T C No 139-271-25

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF COMPLETION
CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Galloway (LAST) Erwin (FIRST) K (MIDDLE)

Location of Property Vagabond Rd.

Application Number 5755 Permit Number 5755

Inspection Data:

Liquid Capacity of Tank 1000/gal Tank Material PC

Total Length of Drain Tile 330 & 125 Number of Lines 5 & 4

Depth of Filter Material 17" Cover Depth 18"

Water Supply Source Well Distance from Water Source 100'

Excavation Inspected 5-10-78 (DATE) Tank Inspected 5-10-78 (DATE)

Nitrification Field Inspected 5-10-78 (DATE)

Washing Machine Line Inspected, If Applicable 5-10-78 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit and in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Eddie Reynolds
Environmentalist

EHD-5-76

Environmental Health Department's Copy

WELL RECORD Well Permit No. 75-c

MAIL COMPLETED FORM TO: WELL WATER SUPPLIES

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION, 1200 BLYTHE BOULEVARD, CHARLOTTE, N. C. 28203

Drilling Contractor Carolina Asgill Drilling 240

1. Location of property Mint Hill N.C. 7815 Jefferson Colony RD
2. Name of owner Ralph Sanders Co
   Address P.O. Box 25122 CHARLOTTE N.C.
3. Does this well replace an existing well? No
4. Topography (circle one): draw, slope, hilltop, valley, flat
5. Use of well Dom Date completed 7-11-75
6. Rig type or method AIR Total depth 105
7. Casing:

Depth From	to	ft.	Inside Diam.	in.	Wall thick. or Wt./ft.	Type
0	78	ft.	6 5/8	in.	.125	THC

8. Grout:

Depth From	to	ft.	Material	Method
0	20	ft.	CMT	POUR

9. Liner, if used: Depth _____ Diameter _____
   No. holes drilled and abandoned _____
10. Water zones (depth and gpm) _____
    90
    _____
11. Static water level: 21 ft above / below top of casing
    which is _____ ft. above land surface. Elev. _____
    Date 7-15-75
12. Yield (gpm) 2 Method of testing AIR
13. Pumping water level: _____ ft. after _____ hrs.
    at _____ gpm.
14. Water quality _____ Temperature (°F) _____
15. Well sterilization method HTH
16. Permanent pump: Y Type S.B Make F+W
    Installed – Date 7-15-75 By CMD
    Capacity 5 gpm. Hp 1/2 TDH _____
    Intake depth 90 Airline depth 21
17. Remarks: _____

I do hereby certify that this well record is true and exact.

Jan D. Rhodes
SIGNATURE OF CONTRACTOR OR AGENT

DRILLING LOG

Depth From	To	Formation
0	78	YELLOW SOFT ROCK
78	105	BLACK CRAFT

FORM NO. E-22-5-1-73