MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ☐ N/A ☑ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☑ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 139-161-08
STREET ADDRESS:
CITY: Mint Hill
STATE: NC ZIP:
SUBDIVISION NAME: Old Camden
LOT #: 17 LOT SIZE (acres): 31,418 Sq. ft.
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☑ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☑ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 2,400 +
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 4
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☑ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☐ PRIVATE WELL ☑ PUBLIC WELL ☐ SHARED WELL ☐ OTHER _____

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☑ POTABLE (DRINKING WATER) ☐ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☑ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☑ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☐ YES	☑ NO	JURISDICTIONAL WETLANDS	☐ YES	☑ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES	☑ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☑ NO
CHEMICAL/PETROLEUM STORAGE TANKS	☐ YES	☑ NO	KNOWN UNDERGROUND CONTAMINATION	☐ YES	☑ NO
WASTE STORAGE	☐ YES	☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	☐ YES	☑ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☑ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? ASAP ☑ N/A

12. PROPERTY OWNER:
NAME: Gold Medallion Homes
ADDRESS: 5923-A Stockbridge Dr.
CITY: Monroe
STATE: NC ZIP: 28110
HOME PHONE:
WORK PHONE:
MOBILE PHONE: 704 201-0050
FAX:

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Tim Whitaker
ADDRESS: 1112 Queensgate St.
CITY: Gastonia
STATE: NC ZIP: 28054
HOME PHONE:
WORK PHONE:
MOBILE PHONE: 704 830-4344
FAX: 704 866-9540

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

TW (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below.

T. Whittaker
Property Owner's or Owner's Legal Representative Signature

9/26/08
Date

OFFICE USE ONLY

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: 7405B

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-8894

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: PO 139-161-08
Lot #: ~~19~~ 17
File #: 7405B
AppID: 2865

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Gold Medallion Homes, LLC
Applicant: Joseph L. Collins
Address: 5923-A Stockbridge Drive, Monroe, N. C. 28110
Date Evaluated: 2/11/08
Proposed Facility: Residence
Design Flow (.1949) 600gpd
Property Size: .72a
Location of Site: Off Old Camden Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 6	0-4	GR/CL	FR/SEXP/SS/SP	>33" TO SOIL WETNESS	40	N/A	NONE	PS, IV
		4-33	SBK/C	FI/SEXP/S/P					.275GPD/FT
		33-40	SBK/CL	FR/SEXP/SS/SP					
		40-42	M/CL	"					
2	"	0-3	GR/CL	"	>44" TO SOIL WETNESS	44+	"	"	"
		3-44	SBK/C	FI/SEXP/S/P					
		BORING	TERMINATED	AT 44"-FLOATER ROCK					
					SITE LTAR .275GPD/FT^2				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)		
Site LTAR		


Other Factors (.1946):
Soil Evaluation By: W. R. Marlin, LSS, 2/13/2008, W. R. Marlin
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:

COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

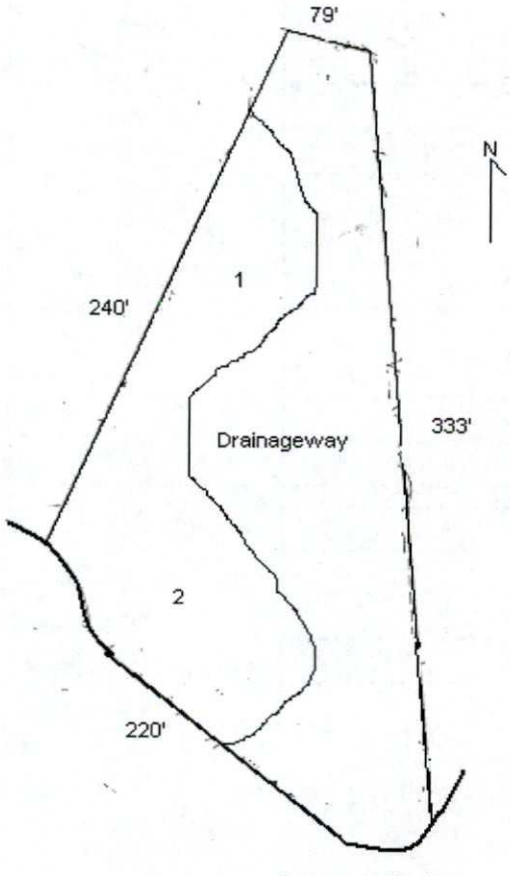

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: PO 139-161-08
Lot #: 17
File #: 7405B
AppID: 2865


SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Gold Medallion Homes, LLC
Applicant: Joseph L. Collins
Address: 5923-A Stockbridge Drive, Monroe, N. C. 28110
Date Evaluated: 2/11/2008
Proposed Facility: Residence
Design Flow (.1949) 360gpd
Property Size: .72a
Location of Site: Off Old Camden Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 6	0-4	GR/CL	FR/SEXP/SS/SP	>33" TO SOIL WETNESS	40	N/A	NONE	PS, IV
		4-33	SBK/C	FI/SEXP/S/P					.275GPD/FT
		33-40	SBK/CL	FR/SEXP/SS/SP					
		40-42	M/CL	"					
2	"	0-3	GR/CL	"	>44" TO SOIL WETNESS	44+	"	"	"
		3-44	SBK/C	FI/SEXP/S/P					
		BORING	TERMINATED	AT 44"-FLOATER ROCK					
					SITE LTAR .275GPD/FT^2				

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IV	IV
Site LTAR	0.275	0.275

Other Factors (.1946):
Soil Evaluation By: W. R. Marlin, LSS, 2/13/2008,
Others Present:
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: David Cornelius, RS
Others Present:

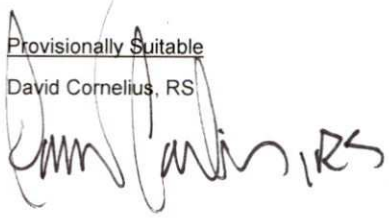


COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

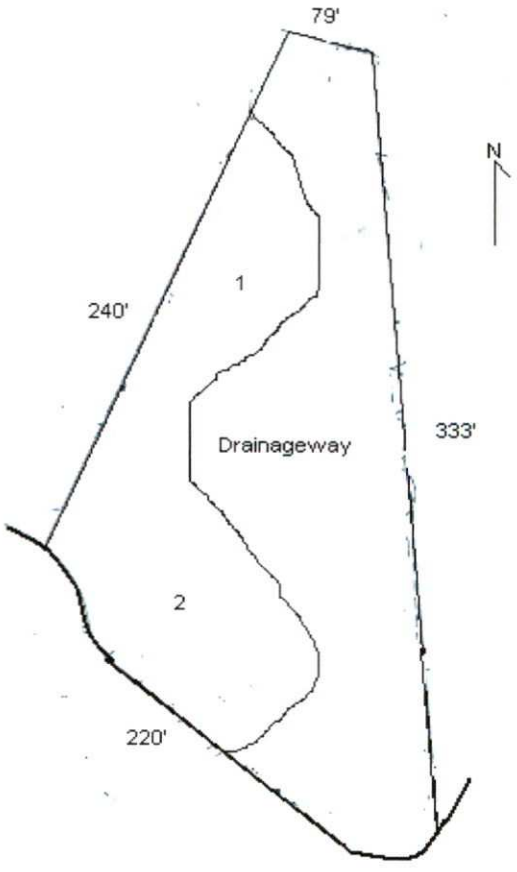

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002865** GWS File #: **7405B** Tax Parcel #: **139-161-08**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 2/3/2014

Type of Installation: Residential - New System Lot Number: 17

Structure Type: HOUSE Size (ft^2): 3000 # Bedrooms: 3 # Occupants: 4

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: PPBPS (pressurized) **System Classification:** IVa

Initial System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	654	Total Trench Length (ft):	218
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Pressure Manifold		

III. Repair System Type: PPBPS (pressurized) **System Classification:** IVa

Repair System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	654	Total Trench Length (ft):	218
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius Owner/Legal Agent: _____

Print Name

Signature: _____ Signature: _____

Date Issued: 2/3/2009

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002865** GWS File #: **7405B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 3 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- This type of septic system requires a Certified Operator to maintain the system. A system maintenance contract with a Certified Operator must be on file prior to issuance of an Operation Permit.
- The septic system shall be installed in accordance with the plans submitted by the wastewater system design consultant.
- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- An effluent filter is required on the pump discharge pipe exiting the pump tank.
- The septic system shall be located at least 10 feet from any foundation drain.
- Install according to plans on file submitted by Tim Whittaker, 11/17/08. A full set of house plans must be on file before construction authorization will be issued. DC

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius

Signature: _____


Date Issued: 2/3/2009

Owner/Legal Agent: _____
Print Name

Signature: _____

M.C.G.W.S
File: 17405-B
Lot 17 Old Camden Estates

(3) Bedrm. pumped PANEL Block
Septic Sys. Type IV PPBPS. LTAR .275

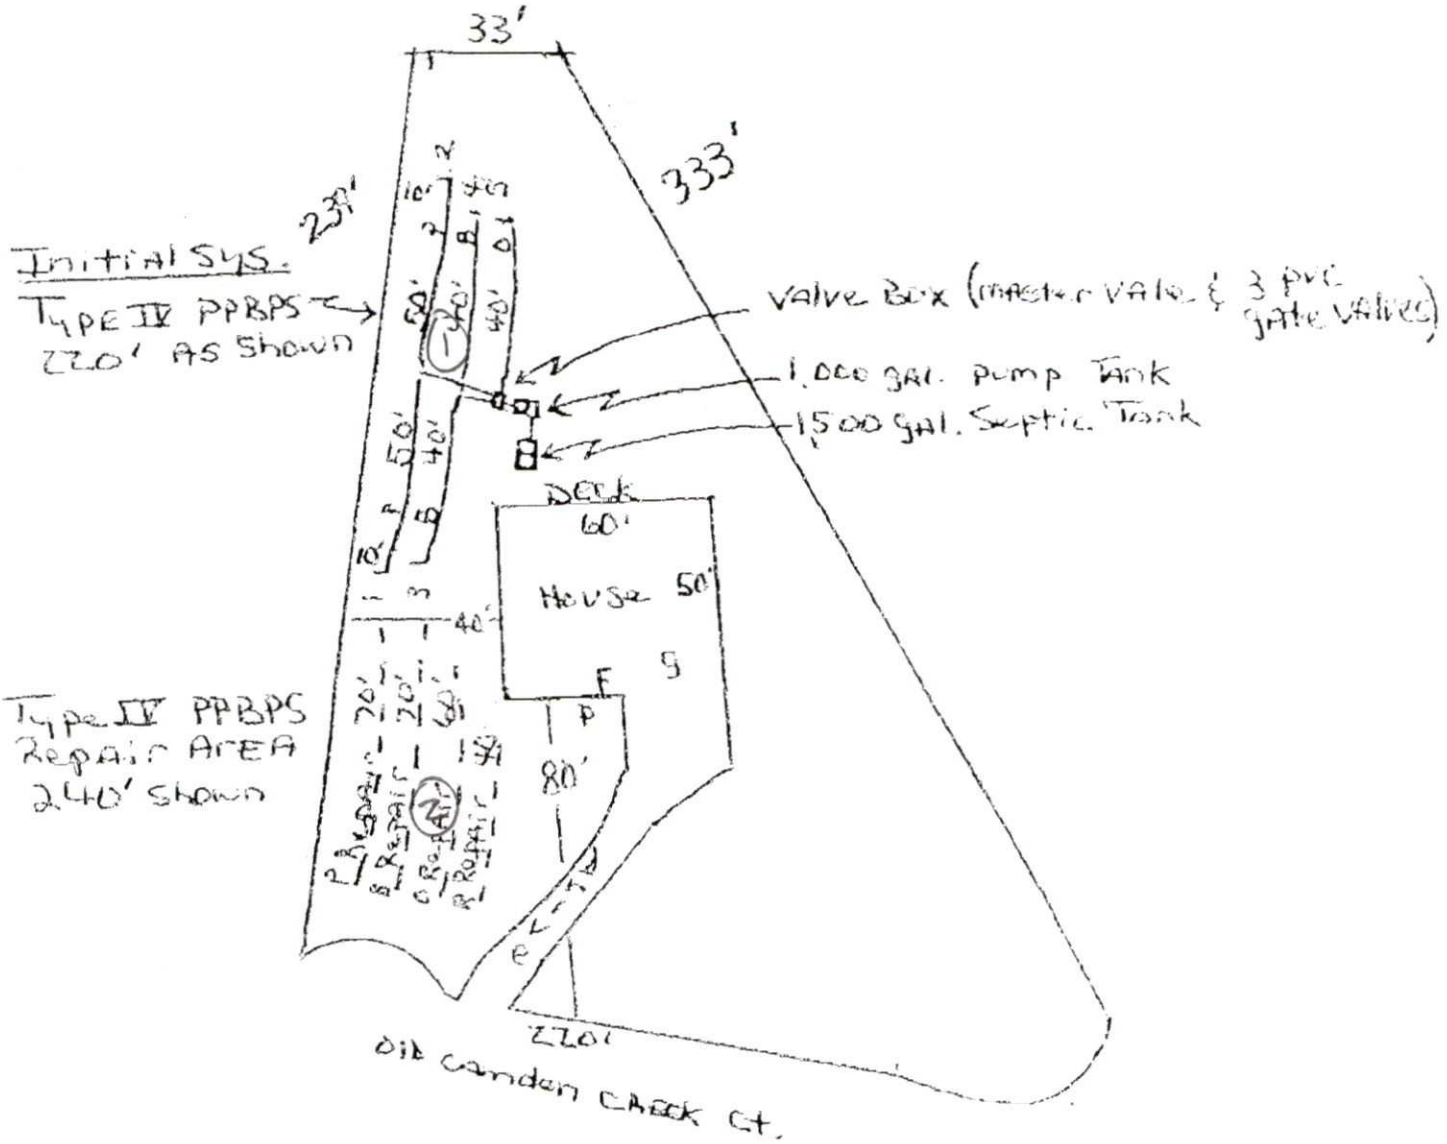

*(See SPEC. Sheet)
* Install per manufactures SPECS

11/17/08
Tim Whittaker
704-966-1504
5150

M.C.G.W.S. 11/17/08

TO: Jason Jackson, R.S.

From: Tim Whittaker

RE: Old Camden Est.
Designs for Lots ~~9, 10, 15~~ 17

Jason; for review, will call for setting Appts.

Thanks,
Tim Whittaker
704 830-4344

cover pg. plus 2 ~~#~~ pgs.

(3) Bedrm. Pumped Panel Block (TYPE IV) Lot 17

PPBPS Design Worksheet

File #: 77405-B
Tax #: 139-161-08
Address: 018 Camden Creek Ct.

Consultant: Tim Whittaker
Phone: 704 830-4344

Reviewed By:
Date:

System Requirements

Design Flow	360	gpd
LTAR	.275	gpd/ft.^2
Linear footage	436	ft. (conventional)
Linear footage	218	ft. (50% Reduction)

Design Layout

Laterals	Length (ft)	# Panels	Calculated
Line # 1	50'	11	
Line # 2	50'	11	
Line # 3	40'	9	
Line # 4	40'	9	
Line # 5	40'	9	
Line # 6			
Line # 7			
Line # 8			
Totals	220'	49	panels

T & J Panels

Linear Feet	# Panels
30	7
40	9
50	11
60	14
70	16

Absorption Area

Length (ft) 100' Width (ft) 22 Area (ft^2) 2,200

System Pressure Head	3	ft.	Value selected by system designer (must be between 2-5 ft.)
Orifice Diameter	5/32	in.	Size selected by system designer (1/8 in. minimum)
Flow Rate per Orifice	.50	gpm	Determined from orifice flow design table (value dependent on pressure head & orifice diameter)
Total System Flow Rate	24.5	gpm	Total number of panels required multiplied by the orifice flow rate
System Dose Volume	176.4	gal.	Total number of panels required multiplied by 3.6 gal./panel
Pump Run Time	7.2	min.	System dose volume divided by the total system flow rate
Pump Tank Drawdown	8	in	1,000 gal. Pump tank volume is approximately 21 gallons per inch
			1,500 gal. Pump tank volume is approximately 29 gallons per inch

approx. 168 gals dosed

Comments:


1. Install system as per 3 ft. wide trenches. Yes
2. Install drainage at 3 ft. centers, level and uniform. Yes
3. System design requires effluent pump for distribution. Yes
4. 100% replacement PPBPS required for property. Yes

T Whittaker 11/17/08

1/4 h.p. pump

(Sys. will require management Entity Contract)

11/17/2008 10:23 17048659540 TIM WHITTAKER PAGE 02/02

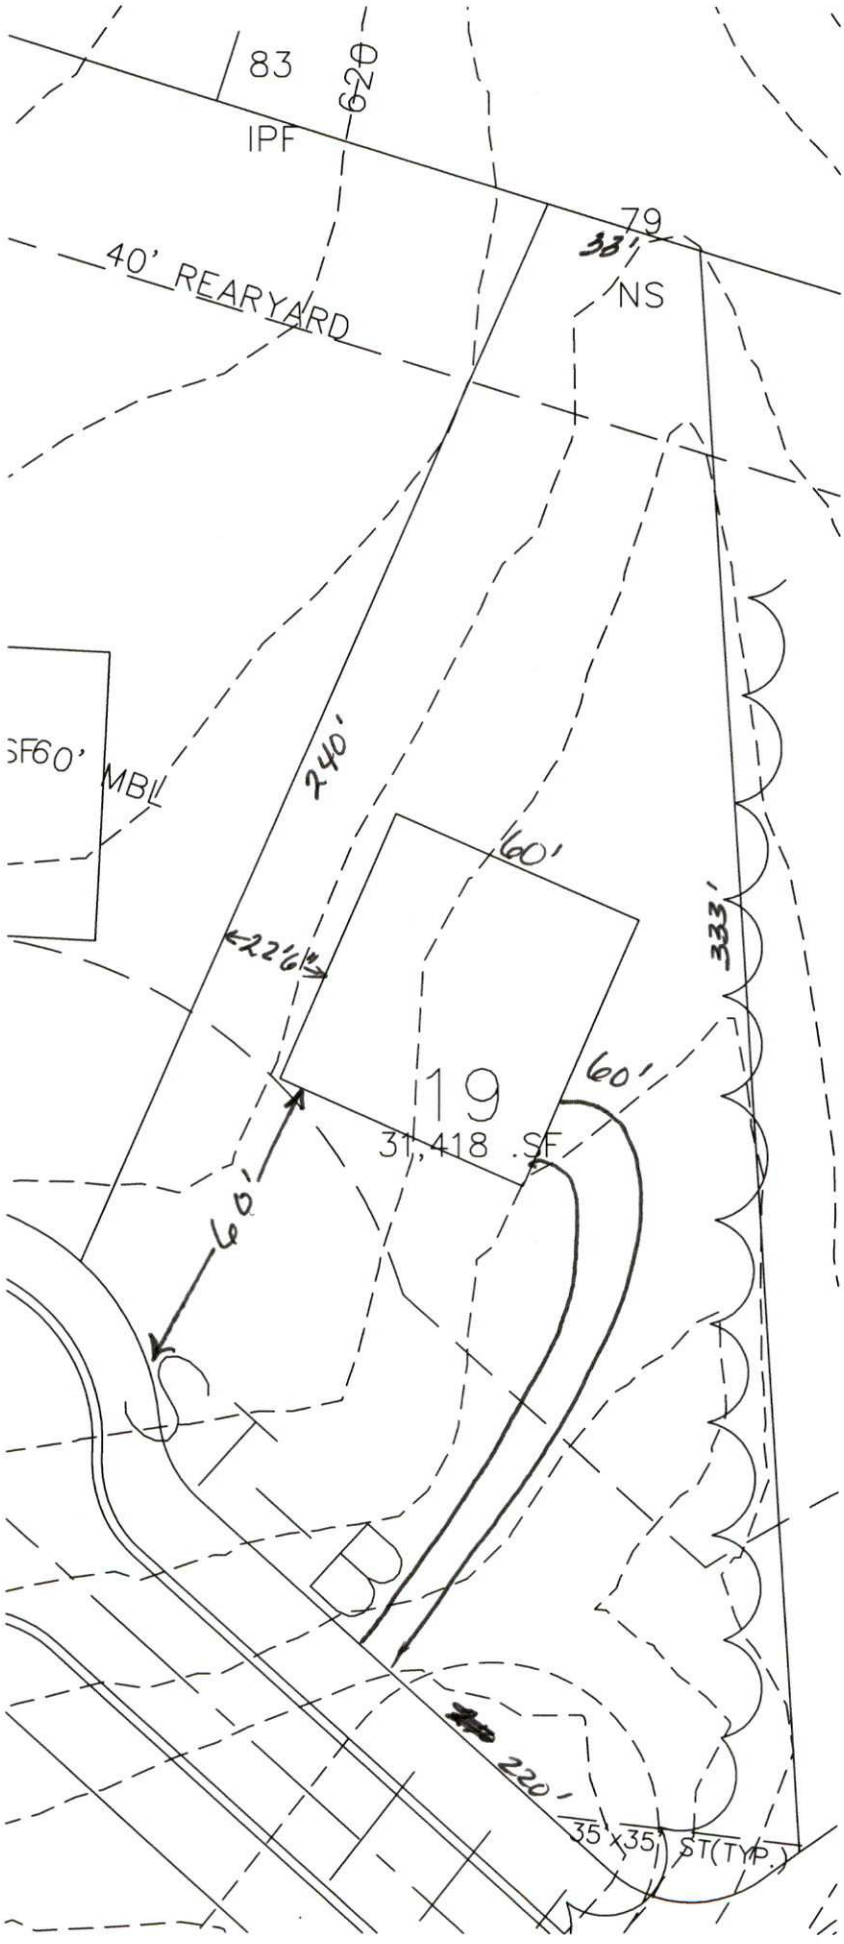
83
620
IPF
79
38'
NS
40' REARYARD
SF60'
MBL
240'
60'
22'6"
333'
60'
19
31,418 SF
60'
220'
35' X 35' ST(TYP.)

FILE NUMBER: 7405B ck 6284 Revised On: August 31, 2007 APPLICATION NUMBER: 2865

SEPTIC FEE: 200 DATE: 10/17/07

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____ DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☒ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 139-161-08
STREET ADDRESS: Old Camden Rd
CITY: Midland
STATE: NC ZIP: 28107
SUBDIVISION NAME:
LOT #: 19 LOT SIZE (acres): .715
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☒ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☒ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 3000
NUMBER OF BEDROOMS: 5 4
NUMBER OF OCCUPANTS: mc 2.18.08
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☒ PUBLIC WELL ☐ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

	☒ ANY TYPE	☐ CONVENTIONAL	☐ ACCEPTED	☐ INNOVATIVE	☐ ALTERNATIVE	☐ OTHER
8A. RANK:	4	1	____	2	3	____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☐ YES ☒ NO	JURISDICTIONAL WETLANDS	☐ YES ☒ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES ☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☒ NO

10. PROPERTY OWNER:
NAME: Gold Medallion Homes, LLC
ADDRESS: 5923-A Stockbridge Drive
CITY: Monroe
STATE: NC ZIP: 28110
HOME PHONE: WORK PHONE: (704)821-7606
MOBILE PHONE: FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Joseph L. Collins
ADDRESS: 1101 Lester Mullis Road
CITY: Indian Trail
STATE: NC ZIP: 28079
HOME PHONE: WORK PHONE:
MOBILE PHONE: (704)641-5898 FAX: (704)753-5898

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 9/7/2007
13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? already closed on 9/7/2007

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Joseph L Collins 10/16/07
Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____
Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☒ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED