

8326 ROLLING FIELDS RD

19722101

1/11/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Pond

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 7151B WASPS App #: 2334

Primary ES assigned to project: YJ

Secondary ES assigned to project:

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 4 Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR - 285	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☑
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

IA issued date: 1-14-08

OP issued date: 1-23-08

Review performed by: VR Date performed: 8-15-07

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7151B Permit #: 30002334 Tax Parcel #: 197-221-66

Property Owner: THE Home Group

Job Location Address: 8326 Rolling Fields Rd. Lot 56

City: Mint Hill State: NC Zip Code: 28227

Operation Permit Issuance Date: _____ Contractor Name: Stanley Septic

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Effluent Pump Model: Goulds 0.5

Drainfield Installation ☐ N/A INNOVATIVE 25% REDUCTION CHAMBERS

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.) 4X88'

Total line length: 424 feet 1X72'

# of Lines: 5 @ VAR feet

Depth of Media: N/A inches (Type) IIIdg

Depth of Cover: 12 inches

Distribution Device: Drop Box

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: >5 feet

Distance from Property Line: >10 feet

Distance from Water Supply Source: >100 feet


Inspection Dates

Tank(s) Inspected: 1/17/08

Excavation Inspected: 1/17/08

Pump & Controls Inspected: 1/17/08

SKETCH OF SYSTEM INSTALLATION (As-Built Drawing)

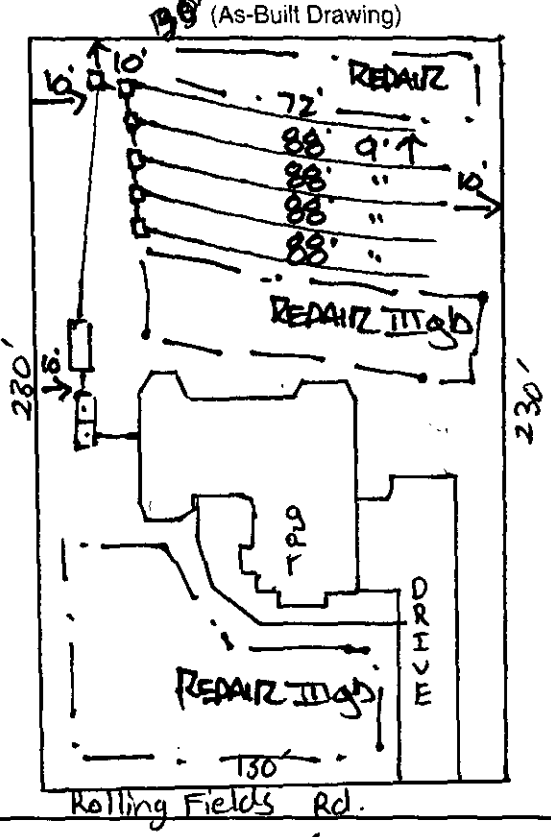

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIgb, INNOVATIVE, 25% REDUCTION. INSTALLED ACCORDING TO PLANS ON FILE SUBMITTED BY TIM WHITTAKER 8/11/07

DENR Authorized Agent: DAVID CORNELIUS Signature: _____, RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7151 B Permit #: 30002334 Tax Parcel #: 197-221-66

Property Owner: THE HOME GROUP

Job Location Address: 8326 Rolling Fields Rd. Lot 56

City: Mint Hill State: NC Zip Code: 28227

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIbg

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: DAVID CORNELIUS, RS Date: 1/23/08

Signature: DAVID CORNELIUS, RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7151 B Permit #: _____ Tax Parcel #: 197-221-66

Property Owner: 8326 THE HOME GROUP

Job Location Address: ~~8333~~ Rolling Fields Rd. Lot 56

City: Mint Hill State: NC Zip Code: _____

Installation Approval Issuance Date: 1-14-08

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 2-14-08, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: .285 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 424 feet

# of Lines: 5 @ various feet

Depth of Media: 12 inches (Type) 25% Reduction

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

Install to consultants design.

Comments: System Classification & Type: III bg

DENR Authorized Agent: Jeremy Michael Signature: Jeremy Michael

FEE: 300.00

DATE: 8/28/2007

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY

GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 7151B

PERMIT NUMBER: 30002334

PARCEL NUMBER: 19722166

JOB LOCATION INFORMATION

ADDRESS: 8326 ROLLING FIELDS RD

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: The Home Group

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 8/28/2007

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30002334, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 8/15/2012

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002334** GWS File #: **7151B** Tax Parcel #: **197-221-66**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 8/15/2012

Type of Installation: Residential - New System Lot Number: 56

Structure Type: HOUSE Size (ft^2): 0 # Bedrooms: 4 # Occupants: 4

Building Foundation: Crawl Space Water Supply: Municipal

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.285	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1263	Total Trench Length (ft):	421
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1309	Total Trench Length (ft):	436
Maximum Trench Depth (in):	18	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michael

Signature: Jeremy Michael

Date Issued: 8/15/2007

Owner/Legal Agent: Tim Whittaker
Print Name

Signature: Tim Whittaker

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002334** GWS File #: **7151B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- The septic system shall be installed in accordance with the plans submitted by the wastewater system design consultant.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michael

Signature: Jeremy Michael

Date Issued: 8/15/2007

Owner/Legal Agent: Tim Whitaker

Print Name

Signature: Tim Whitaker

G.W.S.
File: 7151-B
Lot 56
Plantation Falls Estates

(4) Bedrm. Pumped Quick Four Chamber, 25% Reduction Septic System. LTAR .285

SPECS: 1,500 gal. Septic Tank
Primary Sys. 1,000 gal. Pump Tank, Riser, Nema 4 Box, 1/4 HP pump
75 gal. Washer Box, (2" PVC Service Line, 70' ±)

(5) Drop Boxes

L' (1) 72' Chamber Line = 72'
L2-5 (4) 88' Chamber Lines = 352'
Total — 424'

L' 72' = 18 chambers
L2-5 88' = 88 chambers
Total — 106 Chambers

Repair Sys. Shallow Placed Quick Four Chamber
Front Yard 305', Back Yard 150' = 455' shown

* Flexible tank placements, Bldr. Responsible to Establish gravity feed to Tanks.

* Install Septic Sys. per plan, grade, contour per manufactured specs.

8/11/07
T— Watterson
704 830-4344


E HOME GROUP

THE HOME GROUP, INC
Homes Uniquely Designed For Your Lifestyle

PLANTATION FALLS ESTATES
LOT 56

ROLLING FIELDS ROAD - 60' R/W

0.69 ACRE
8326 ROLLING FIELDS RD
MINT HILL, NC 28227

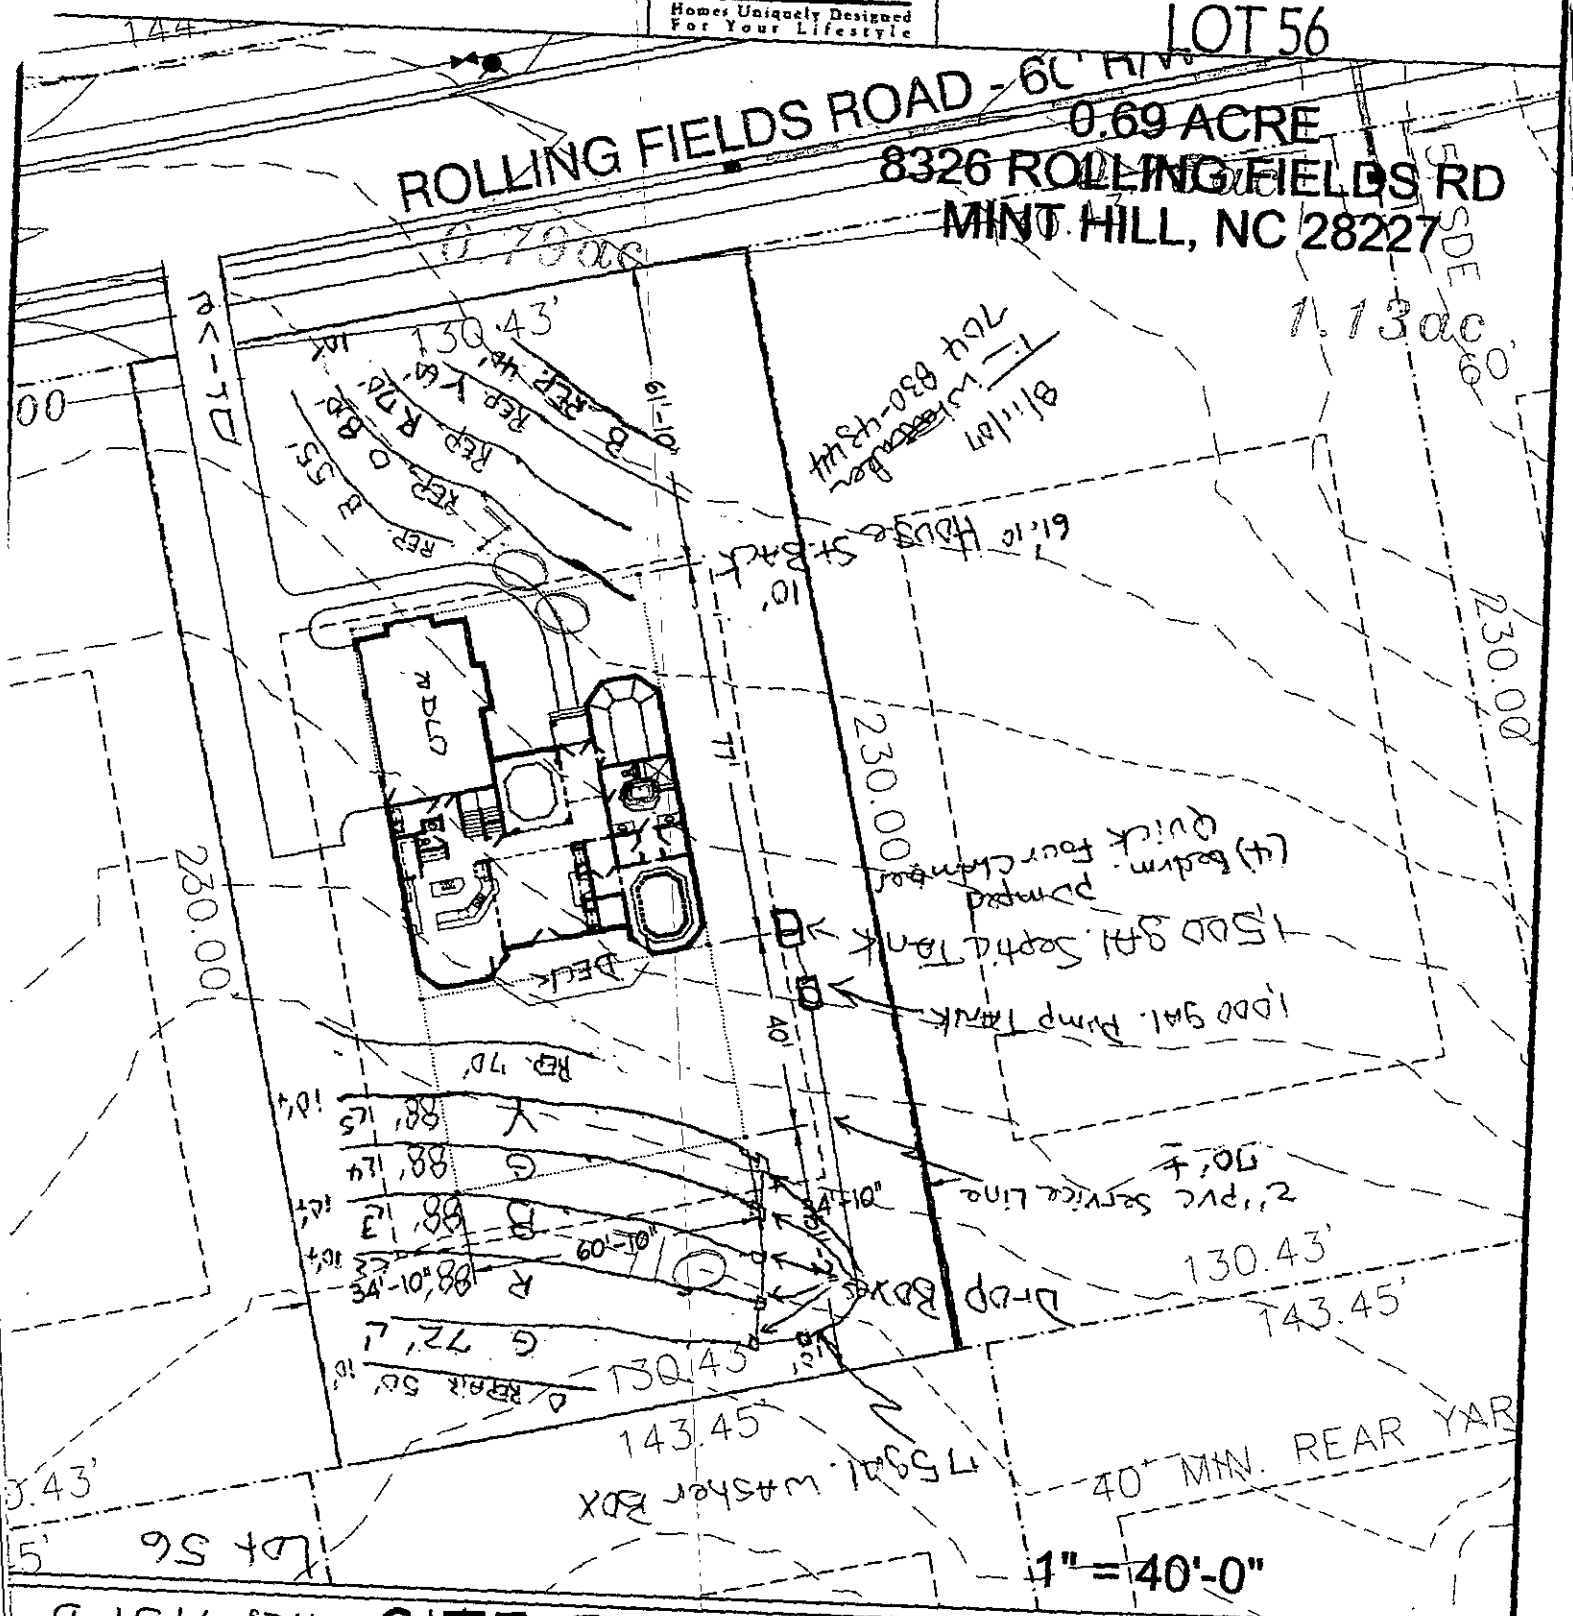

SITE PLAN - LOT 56

PLAN DESIGN • BUILDING • REAL-ESTATE

3070 SENNA DRIVE, MATTHEWS, NC 28105 P-704.841.2074 F-704.841.2084

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 197-221-66
Lot #: 56
File #: 7151B
AppID: 2334

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: The Home Group, Inc. Applicant:
Address: 3070-A Senna Drive, Matthews, N. C. 28105 Date Evaluated: 6/14/2007
Proposed Facility: Residence Design Flow (.1949): 480gpd Property Size: .71a
Location of Site: 8326 Rolling Fields Road Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		PROFILE FACTORS b				
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS, 10	0-4	GR/CL	FR/SEXP/SS/SP	>49" TO SOIL WETNESS	49	N/A	NONE	PS, IV .3GPD/FT^2
		4-24	SBK/C/CL	FR-FI/SEXP/SS/SP					
		24-49	SBK/ABK/C	FI/SEXP/S/P					
2	LS, 8	0-4	GR/L	VFR/SEXP/NS/NP	>48" TO SOIL WETNESS	48	"	"	"
		4-48	SBK/ABK/C	FI/SEXP/S/P					
3	"	0-6	GR/L	VFR/SEXP/NS/NP	>41" TO SOIL WETNESS	41	"	"	PS, IV .275GPD/FT^2
		6-41	SBK/ABK/C	FI/SEXP/S/P					
4	2-3	0-6	GR/SL	FR/SEXP/NS/NP	SITE LTAR .285GPD/FT^2				
		6-30	SBK/C	FI/SEXP/S/P	:30	30	"	"	.275
		few	manganese	pockets					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIIb	IIIbg
Site LTAR	.285	.275

Other Factors (.1946):
Soil Evaluation By: W. R. Marlin, LSS, 6/15/2007,
Others Present:
Site Classification (.1948):
Site Evaluation By: Jeremy Mustard
Others Present:


COMMENTS:
100% repair

FILE #: 7151B

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

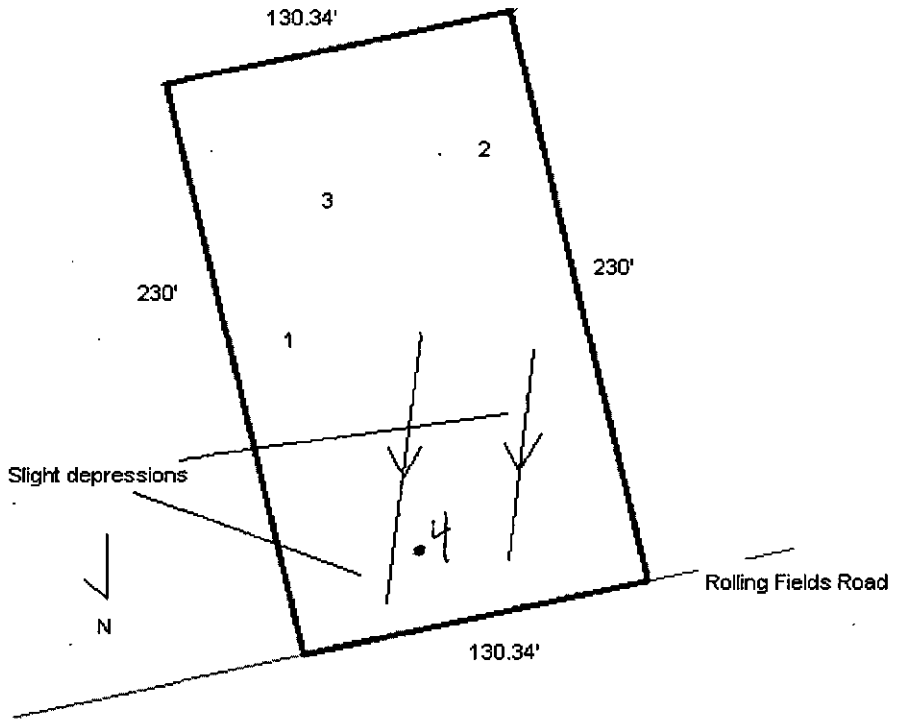

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 197-221-66
Lot #: 56
File #: 7151B
AppID: 2334

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: The Home Group, Inc. Applicant:
Address: 3070-A Senna Drive, Matthews, N. C. 28105 Date Evaluated: 6/14/07
Proposed Facility: Residence Design Flow (.1949): 480gpd Property Size: .71a
Location of Site: 8326 Rolling Fields Road Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 10	0-4	GR/CL	FR/SEXP/SS/SP	>49" TO SOIL WETNESS	49	N/A	NONE	PS, IV
		4-24	SBK/C/CL	FR-FI/SEXP/SS/SP					.3GPD/FT^2
		24-49	SBK/ABK/C	FI/SEXP/S/P					
2	LS, 8	0-4	GR/L	VFR/SEXP/NS/NP	>48" TO SOIL WETNESS	48	"	"	"
		4-48	SBK/ABK/C	FI/SEXP/S/P					
3	"	0-6	GR/L	VFR/SEXP/NS/NP	>41" TO SOIL WETNESS	41	"	"	PS, IV
		6-41	SBK/ABK/C	FI/SEXP/S/P					.275GPD/FT^2
					SITE LTAR .285GPD/FT^2				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)		
Site LTAR		


Other Factors (.1946):
Soil Evaluation By: W. R. Marlin, LSS, 6/15/2007, W. R. Marlin
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:

COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

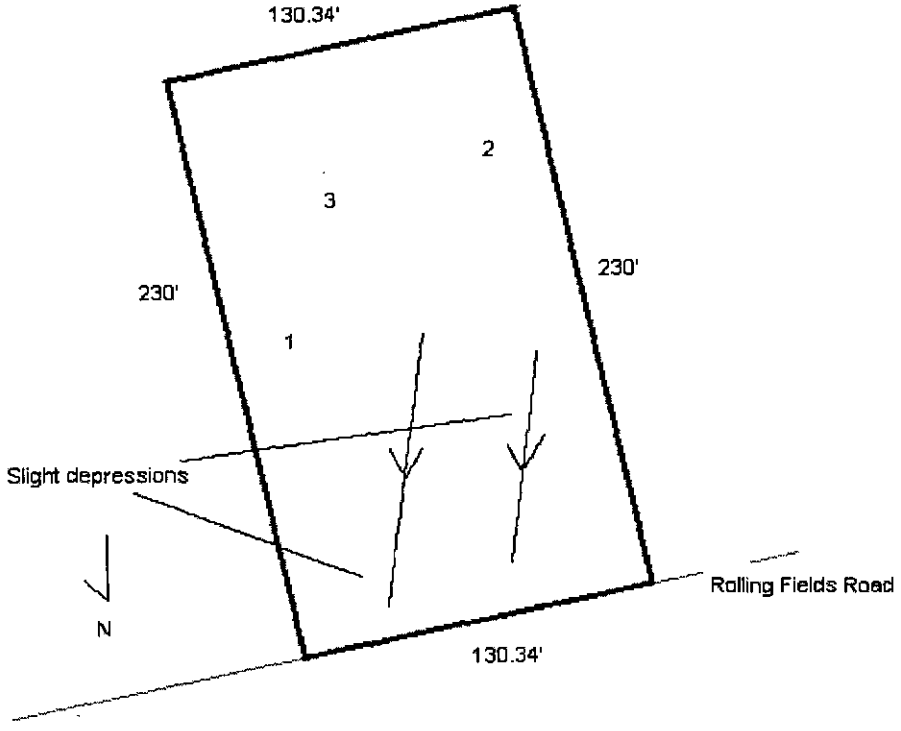

FILE NUMBER: 7151B X31095 or 2004

Revised On: January 3, 2007

APPLICATION NUMBER: 2334

SEPTIC FEE: 200
DATE: 5/24/07

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☒ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 197-221-66 01 10
STREET ADDRESS: 8326 Rolling Fields Rd
CITY: Mint Hill
STATE: NC ZIP: 28227
SUBDIVISION NAME: Plantation Falls Estates
LOT #: 56 LOT SIZE (acres): 0.69
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☒ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☒ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE:
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 4
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☒ MUNICIPAL ☐ PUBLIC WELL ☐ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☒ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

	☐ ANY TYPE	☒ CONVENTIONAL	☒ ACCEPTED	☐ INNOVATIVE	☐ ALTERNATIVE	☐ OTHER _____
8A. RANK:		1	2			

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☒ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☒ NO	JURISDICTIONAL WETLANDS	☐ YES	☒ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES	☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☒ NO

10. PROPERTY OWNER:
NAME: THE HOME GROUP INC
ADDRESS: 3070-A SENNA DR
CITY: MATTHEWS
STATE: NC ZIP: 28105
HOME PHONE: WORK PHONE: 704 841 2074
MOBILE PHONE: FAX: 704 841 2084

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____
13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months; complete plat = non-expiring.

Edna Nolan 5/24/07
Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____
Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☒ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED


E HOME GROUP

THE HOME GROUP, INC
Homes Uniquely Designed For Your Lifestyle

PLANTATION FALLS ESTATES
LOT 56

ROLLING FIELDS ROAD - 60' R/W

0.69 ACRE
8326 ROLLING FIELDS RD
MINT HILL, NC 28227

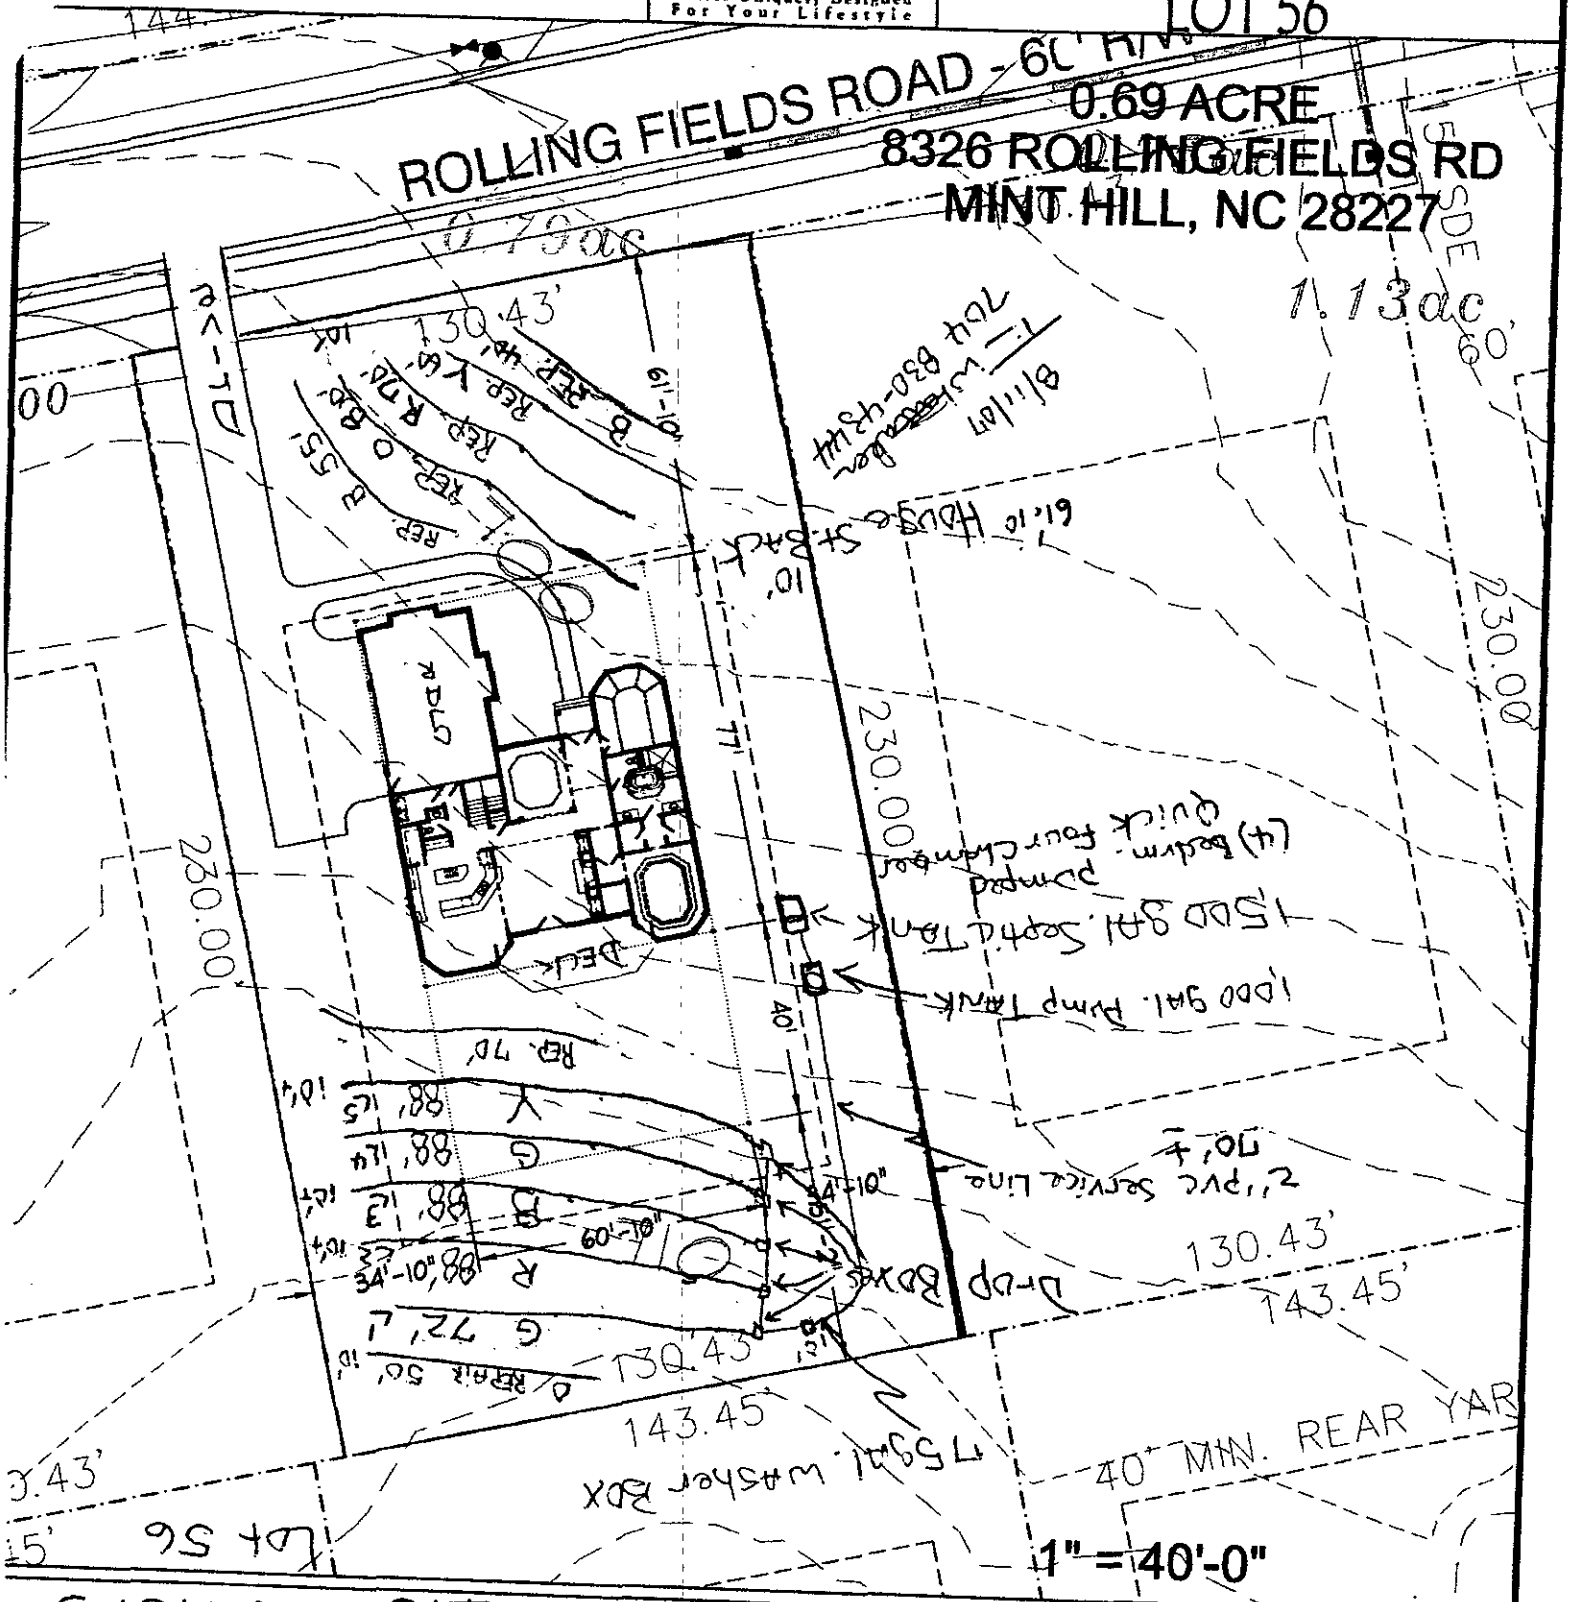

SITE PLAN - LOT 56

PLAN DESIGN • BUILDING • REAL-ESTATE

3070 SENNA DRIVE, MATTHEWS, NC 28105 P-704.841.2074 F-704.841.2084

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 08/28/07
Receipt #: 52396
Check / Auth #: CHARGE
Received By: CRAIGGY

Amount: 150.00
Tendered: 0.00
Returned: 0.00

Account Information

Account #: X31095
Contractor: HOME GROUP IN THE
Attn:
Address: 3070 SENNA DR
Address: STE A
City/State/Zip: MATTHEWS, NC 28105

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 8326 Rolling Fields/file 7151B		1	150.00	150.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
2,973.85	763.75				

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 08/28/07
Receipt #: 52397
Check / Auth #: CHARGE
Received By: CRAIGGY

Amount: 150.00
Tendered: 0.00
Returned: 0.00

Account Information

Account #: X31095
Contractor: HOME GROUP IN THE
Attn:
Address: 3070 SENNA DR
Address: STE A
City/State/Zip: MATTHEWS, NC 28105

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 8326 Rolling Fields/file 7151B		1	150.00	150.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
3,123.85	763.75				

G.W.S.
File: 7151-B
Lot 56
Plantation Falls Estates

(4) Bedrm. Pumped Quick Four Chamber, 25% Reduction Septic System. LTAR .285

SPECS: 1,500 gal. Septic Tank
Primary Sys. 1,000 gal. Pump Tank, Riser, Nema 4 Box, 1/4 HP pump
75 gal. Washer Box, (2" PVC Service Line, 70' ±)

(5) Drop Boxes

L' (1) 72' chamber L' Line = 72'
L2-5 (4) 88' chamber Lines = 352'
Total — 424'

L' 72' = 18 chambers
L2-5 88' = 88 chambers
Total — 106 Chambers

Repair Sys. Shallow Placed Quick Four Chamber
Front Yard 305', Back Yard 150' = 455' shown

* Flexible tank placements, Bldr. Responsible to Establish gravity feed to Tanks.


* Install Septic Sys. per plan, grade, contour per manufactured specs.

8/11/07
T. Wheeler
704 830-4344

THE HOME GROUP

THE HOME GROUP, INC
Homes Uniquely Designed For Your Lifestyle

PLANTATION FALLS ESTATES LOT 56

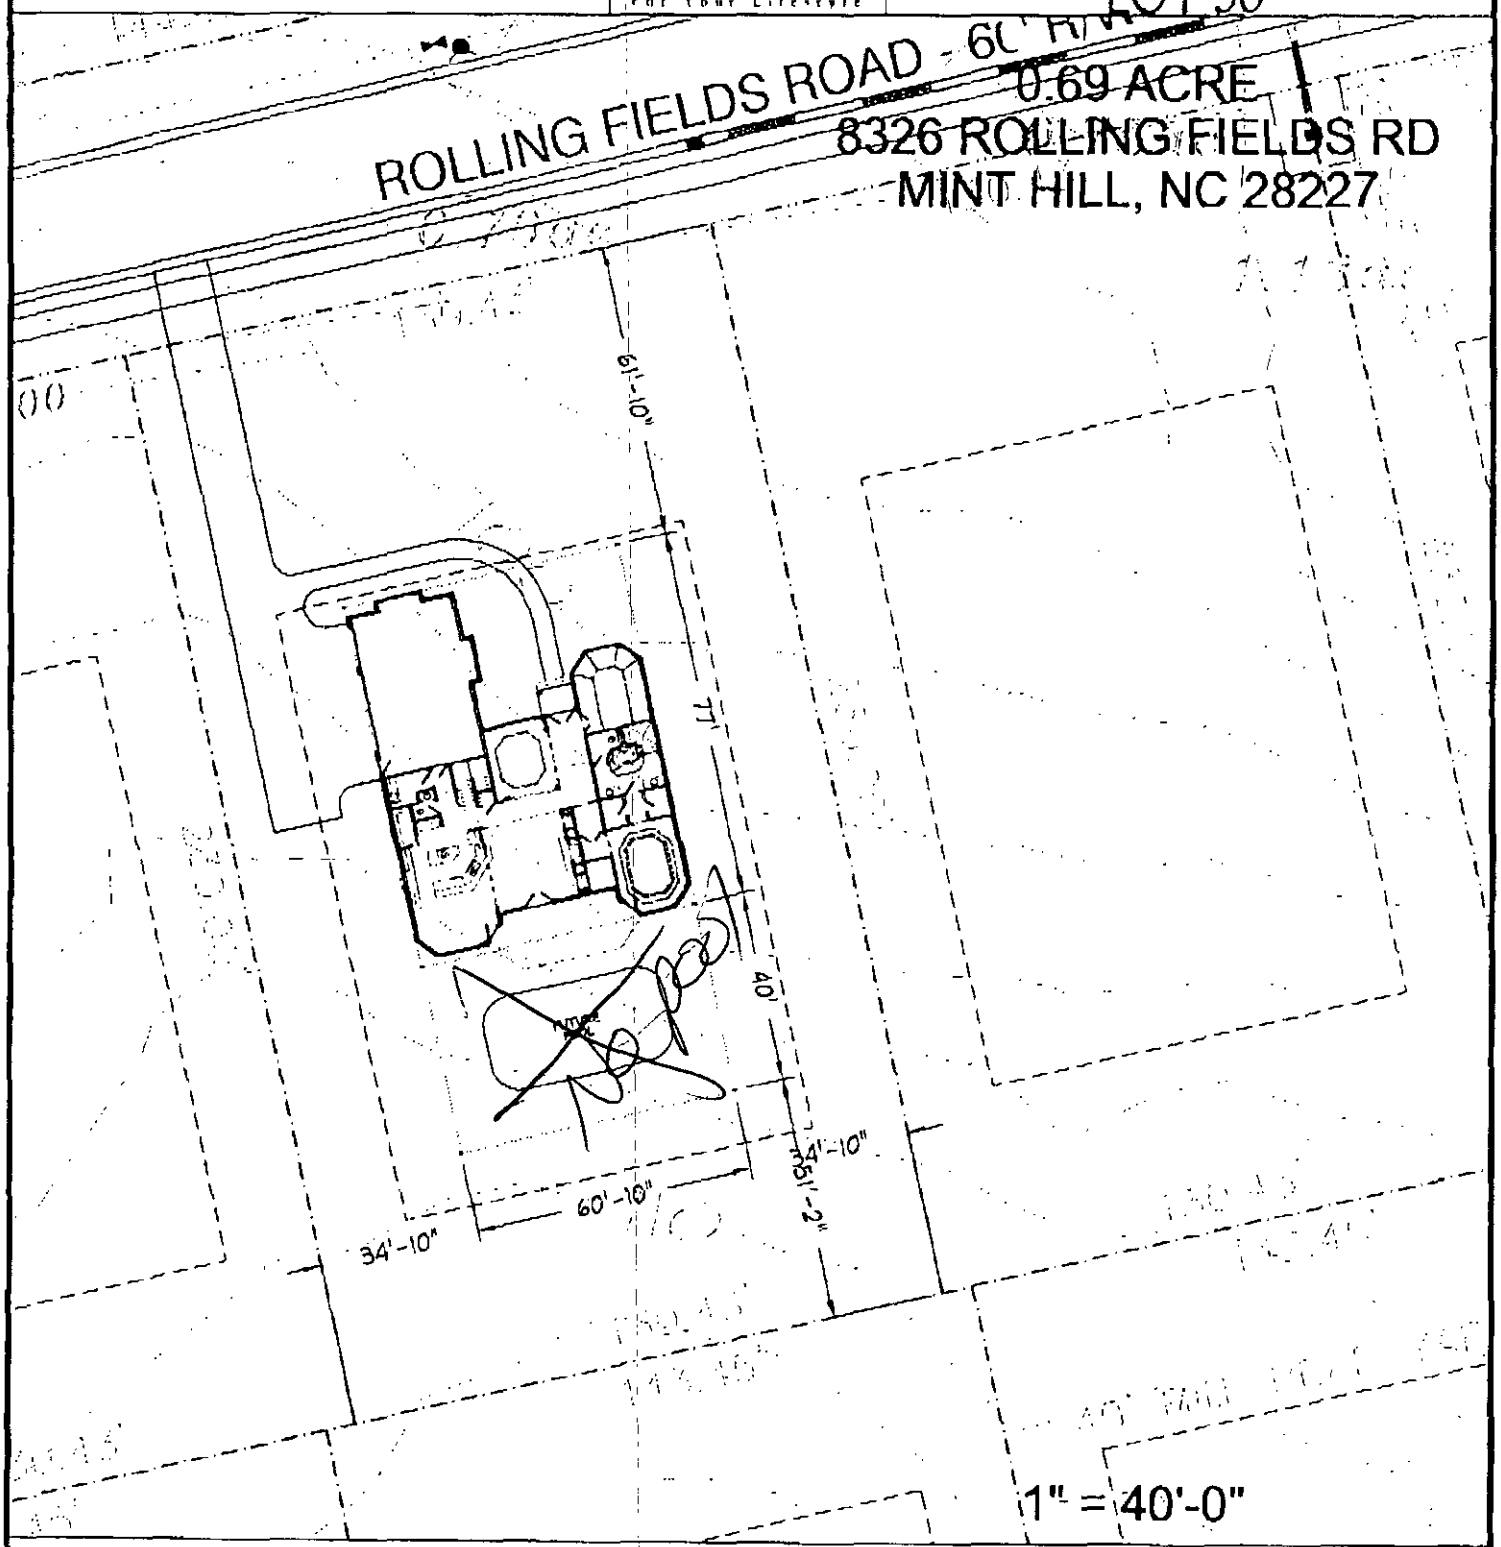

SITE PLAN - LOT 56

PLAN DESIGN • BUILDING • REAL-ESTATE
3070 SENNA DRIVE, MATTHEWS, NC 28105 P-704.841.2074 F-704.841.2084