

12336 OLD STATESVILLE RD

01911104

1/4/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4261B DATE: 11/22/02

TC: 019-111-04 ☐ L ☐ CRT

SERIAL Nº 18635

Name of Owner Arnold Wilson Johnston Juris.: _____

Address of Property 12336 Old Statesville Road

Inspection Data:

Tank Material PCC

Total Length of Drainfield 400'

Number of Lines 5 @ 80'

Cover Depth 9"

Water Supply Source well


Distance to Water Source not drilled

Excavation Inspected 11/22/02

Tank(s) Inspected 11/22/02

Wash Line Inspected NA

High Water Alarm Inspected NA

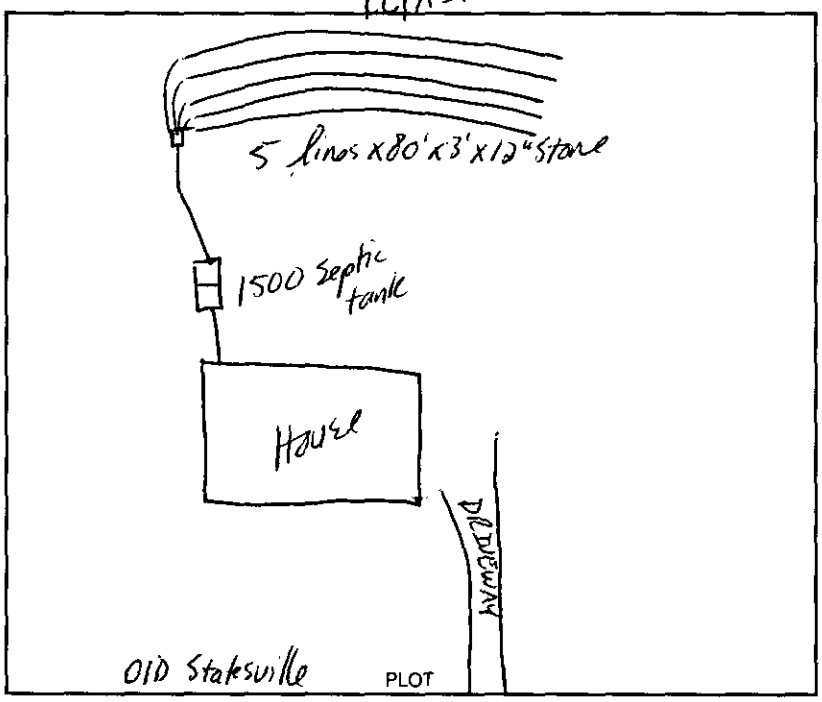

Design 1500ST, 1200SFT, CON, 12" Stone CTR# _____

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Three Bedroom House
5 lines x 80' x 3' x 12" Stone
Type II Conventional System

Terry Middlin R.S.
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Hold for:

1) Fees $300

Auth $150

Inst. co $150

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4261B DATE: 11/20/02

TC: 019-111-04 ☐ L

SERIAL 19174

Permission is hereby given to ___ Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated ~~12336 Old~~ 3/14/00. All work shall be completed on or before 12/20/02, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

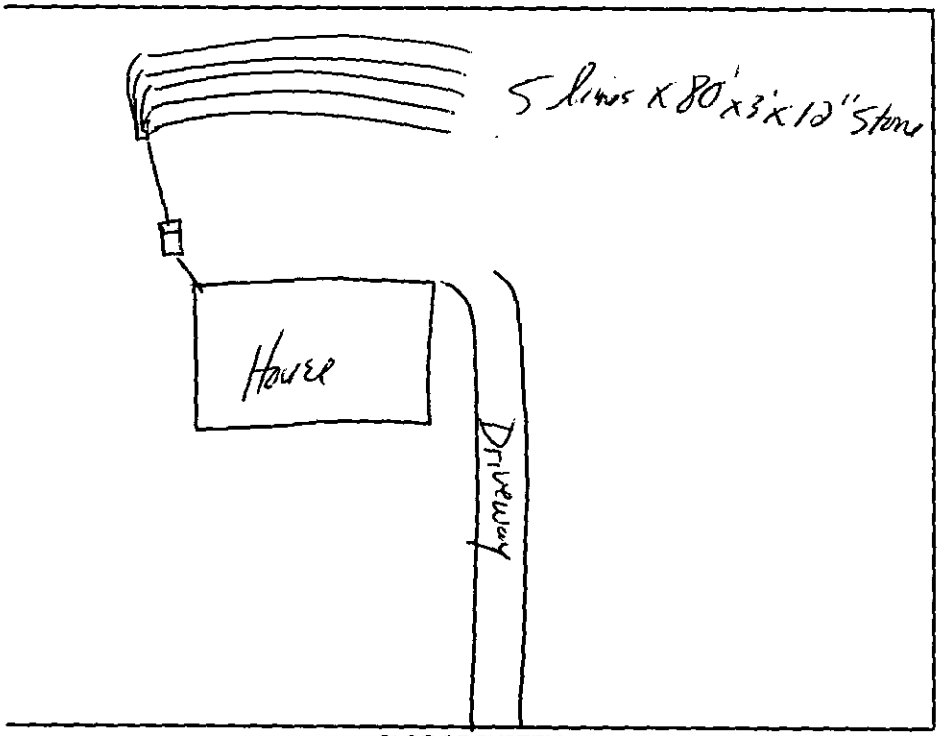

PLOT OF SYSTEM

Old Statesville Road

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction PCC

Trench Depth 30"

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Trench Walls Scored and Porous yes

Total Line Length 400' feet

Number of Lines 5 x 80'

Depth of Stone 12" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well >100' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Arnold Wilson Johnston

LOCATION OF PROPERTY 12336 Old Statesville Road

Comments: Three Bedroom Residence
Install 1500 gallon septic tank
Install 5 lines x 80' x 3' x 12" Stone

Tony Mobley R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

ACS

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 4/11/2000 PERMIT NO: 4261B
PARCEL NO: 019 111 04

JOB LOCATION ADDRESS: 12336 Old Statesville Rd
PROPERTY OWNER: Arnold W. Johnson
BUILDING CONTRACTOR: —
SUBDIVISION NAME: —
AUTHORIZATION ISSUED BY: Thilo J Walker RS DATE: 4/11/2000
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 4261B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: _____

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

x Gloria E. Johnston 4-11-2000
SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

CONDITIONS OF IMPROVEMENT PERMIT

Permit Number 4261B

Tax Number 019 111 04

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

3 Long-term acceptance rate	360 Max gallons/day wastewater flow	1200 Absorption Area (sq ft)	9' Trench spacing (min. on centers)
YES Serviced by private well	1500 Gallon septic tank	400' Total trench length (ft)	24" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
3 Bedrooms in residence	NA Gallon pump tank	12" Depth of stone	

Any surface waters present: NO Type: Minimum separation distance:

Site modifications required:

Additional Conditions: Keep the septic system > 100' (50' min) from any well(s)

Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

1200' Absorption Area (Sq ft) 400' Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	24 Maximum Trench Depth

For existing system, enter the year originally installed:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in e at the time of issuance of the permit and is subject to the following provisions:

- ... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Departm
- ... This Improvement permit is transferable.

Philo S. Walker RS. 4/11/2000
DEHNR Authorized Agent Date

Gloria C. Johnston 4-11-2000
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4261B

TC: 019-111-04

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

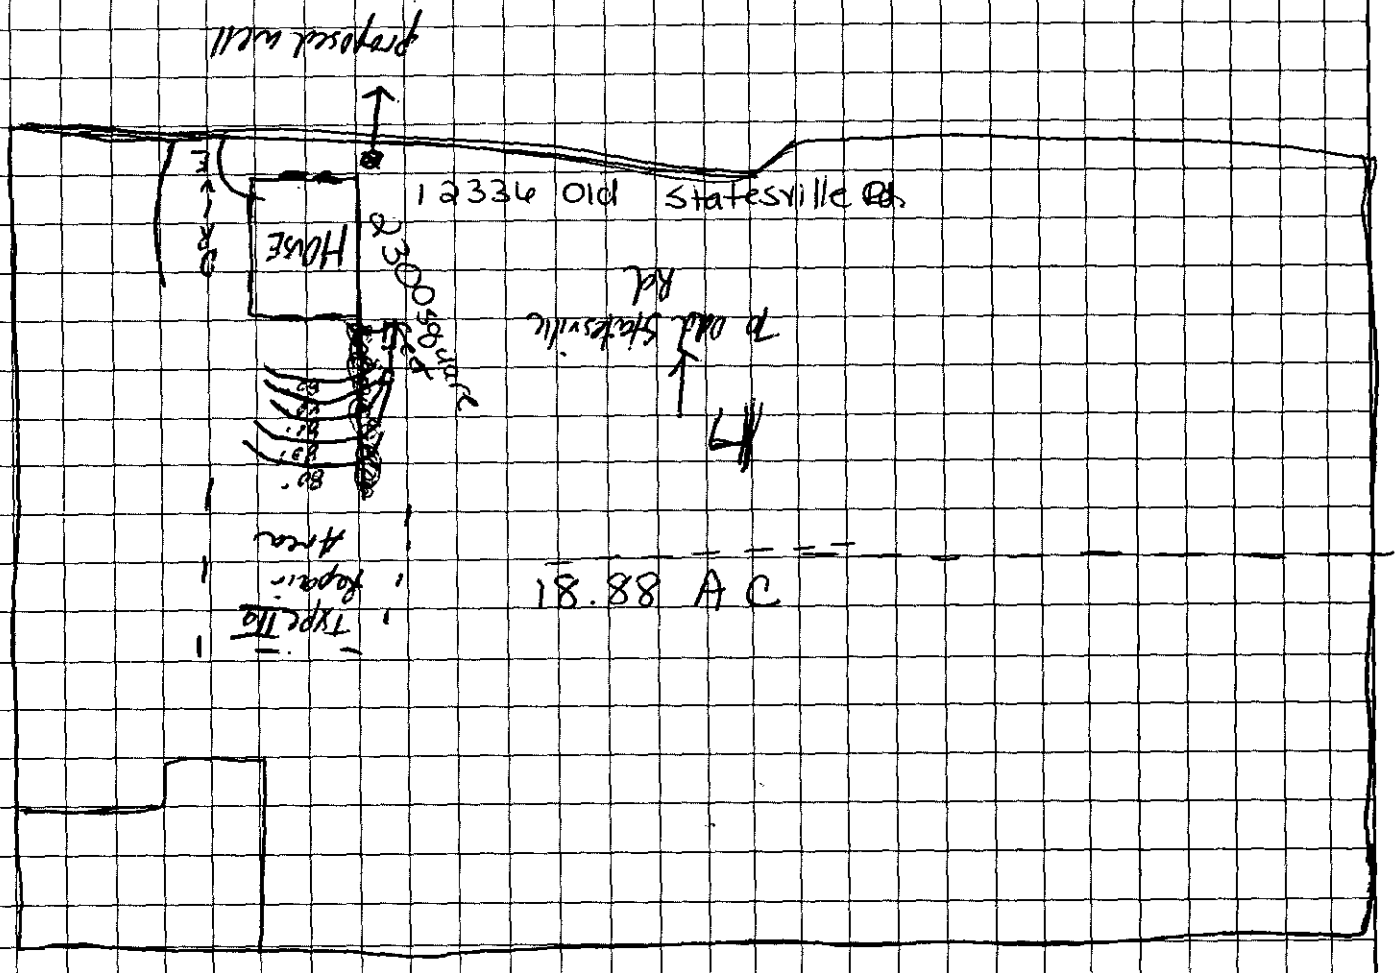

COMMENTS 3 Bedroom Residences, 1580ST, Conv. Slabs x 80' long x 3' wide x 12" stone, Type IIa Approx. Area, Keep the septic system 4100 ft ± > 100' (Setback) from any wells

Home already built

+ 5 days ECS

Gloria Houston
OWNER/AGENT SIGNATURE

DATE 3-15-2000

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet: _____

Property ID: PO 019-111-01

Lot #: _____

File #: 4261B

AS #2

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Arnold W. Johnston APPLICANT: _____

ADDRESS: 12300 Old Statesville Road, Huntersville DATE EVALUATED: 3-28-06

PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949) _____ PROPERTY SIZE: .25 ac

LOCATION OF SITE: 12336 Old Statesville Road PROPERTY RECORDED: _____

WATER SUPPLY: ☑Private ☐Public ☐Well ☐Spring ☐Other _____

EVALUATION METHOD: ☐Augur Boring ☐Pit ☐Cut

TYPE OF WASTEWATER: ☐Sewage ☐Industrial Process ☐Mixed

PROFILE #	Slopes 6-12% .1940 Landscape Position/ Slope %	Horizon Depth (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS &LTAR
1	LS	0-9"	Mixed Fill		7.5YR 5/8 mottles	48"	N/A	None	PS .39 Fa IV
		9-36"	SBK/C	Fr/SEXP/SS/SP					
		36-48"	SBK/C	Fr/SEXP/SS/SP					
2	LS	0-3"	gr/sc	Fr/SEXP/SS/SP	7.5YR 5/8 mottles	48"	N/A	None	PS .39 Fa IV
		3-40"	SBK/Sc	Fr/SEXP/SP					
		40-48"	SBK/SCl	Fr/SEXP/SS/SP					
3	LS	0-2"	gr/sc	Fr/SEXP/SS/SP	7.5YR 5/8 mottles	48"	~~N/A~~	None	PS .39 Fa IV
		2-40"	SBK/Sc	Fr/SEXP/SP					
		40-48"	SBK/SCl	Fr/SEXP/SS/SP					
4	LS	0-3"	gr/sc	Fr/SEXP/SS/SP	7.5YR 5/8 mottles	46"	N/A	None	PS .39 Fa IV
		3-40"	SBK/Sc	Fr/SEXP/SP					
		40-46"	SBK/SCl	Fr/SEXP/SS/SP					
5	LS	0-13"	Mixed Fill		7.5YR 5/8 mottles	46"	N/A	None	PS .49 Fa III
		13-38"	SBK/SCl	Fr/SEXP/SS/SP					
		38-46"	SBK/Cl	Fr/SEXP/SS/SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	US
System Type(s)		
Site LTAR	.39 Fa	.39 Fa

OTHER FACTORS (.1946): _____

SITE CLASSIFICATION (.1948): Unsuitable

EVALUATED BY: M. A. McNeill LSS 3-28-06

OTHER(S) PRESENT: _____

FILE # 4261B

COMMENTS 100% Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC


STRUCTURE

SG-SINGLE GRAIN
M-MASSIVE
CR-CRUMB
GR-GRANULAR
SBK-SUBANGULAR BLOCKY
ABK-ANGULAR BLOCKY
PL-PLATY
PR-PRISMATIC

MINERALOGY

SLIGHTLY EXPANSIVE

EXPANSIVE

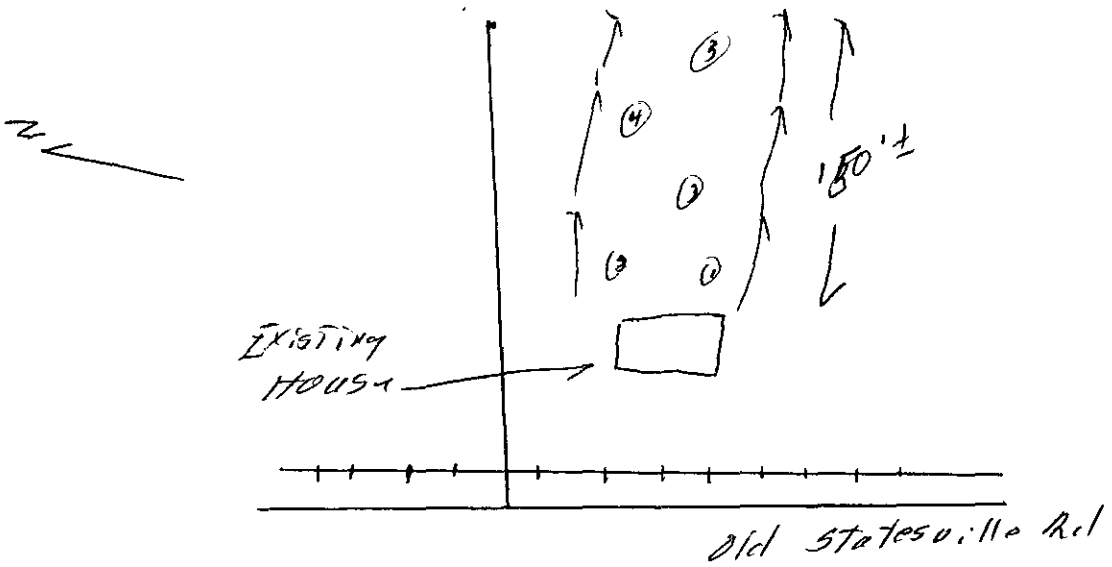

DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#2

Property ID: 90 019-111-01

Lot #:

File #: 4261B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Arnold W. Johnson APPLICANT:

ADDRESS: 12300 Old Statesville Road, Huntersville DATE EVALUATED: 3-26-6

PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE: .25 ac

LOCATION OF SITE: 12336 Old Statesville Road PROPERTY RECORDED:

WATER SUPPLY: ~~Private~~ Public Well Spring Other

EVALUATION METHOD: ~~Augur Boring~~ Pit Cut

TYPE OF WASTEWATER: ~~Sewage~~ Industrial Process Mixed

PROFILE #	Slopes 6-12% .1940 Landscape Position/ Slope %	Horizon Depth (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS &LTAR
1	LS	0-9"	Mixed Fill		7.5YR TO Soil wetness	48"	N/A	None	PS .391 Fa IV
		9-36"	SBM/C	Fr/SEXP/SS/SP					
		36-48"	SBM/CL	Fr/SEXP/SS/SP					
2	LS	0-3"	gr/scl	Fr/SEXP/SS/SP	7.5YR TO Soil wetness	48"	N/A	None	PS .391 Fa IV
		3-40"	SBM/SC	Fr/SEXP/SS/P					
		40-46"	SBM/SCL	Fr/SEXP/SS/SP					
3	LS	0-2"	gr/scl	Fr/SEXP/SS/SP	7.5YR TO Soil wetness	48"	~~N/A~~	None	PS .391 Fa IV
		2-40"	SBM/SC	Fr/SEXP/SS/P					
		40-48"	SBM/SCL	Fr/SEXP/SS/SP					
4	LS	0-3"	gr/scl	Fr/SEXP/SS/SP	7.5YR TO Soil wetness	46"	N/A	None	PS .391 Fa IV
		3-40"	SBM/SC	Fr/SEXP/SS/P					
		40-46"	SBM/SCL	Fr/SEX.P/SS/SP					
5	LS	0-13"	Mixed Fill		7.5YR TO Soil wetness	46"	N/A	None	PS .491 Fa III
		13-38"	SBM/SCL	Fr/SEX.P/SS/SP					
		38-46"	SBM/CL	Fr/SEX.P/SS/SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	US
System Type(s)		
Site LTAR	.391 Fa	.391 Fa

OTHER FACTORS (.1946):

SITE CLASSIFICATION (.1948): Unsuitable

EVALUATED BY: M. McNeal LSS 3-28-06

OTHER(S) PRESENT:


FILE # 42618

COMMENTS WW Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC

STRUCTURE	MINERALOGY
SG-SINGLE GRAIN	SLIGHTLY EXPANSIVE
M-MASSIVE	
CR-CRUMB	EXPANSIVE
GR-GRANULAR	
SBK-SUBANGULAR BLOCKY	
ABK-ANGULAR BLOCKY	
PL-PLATY	
PR-PRISMATIC	

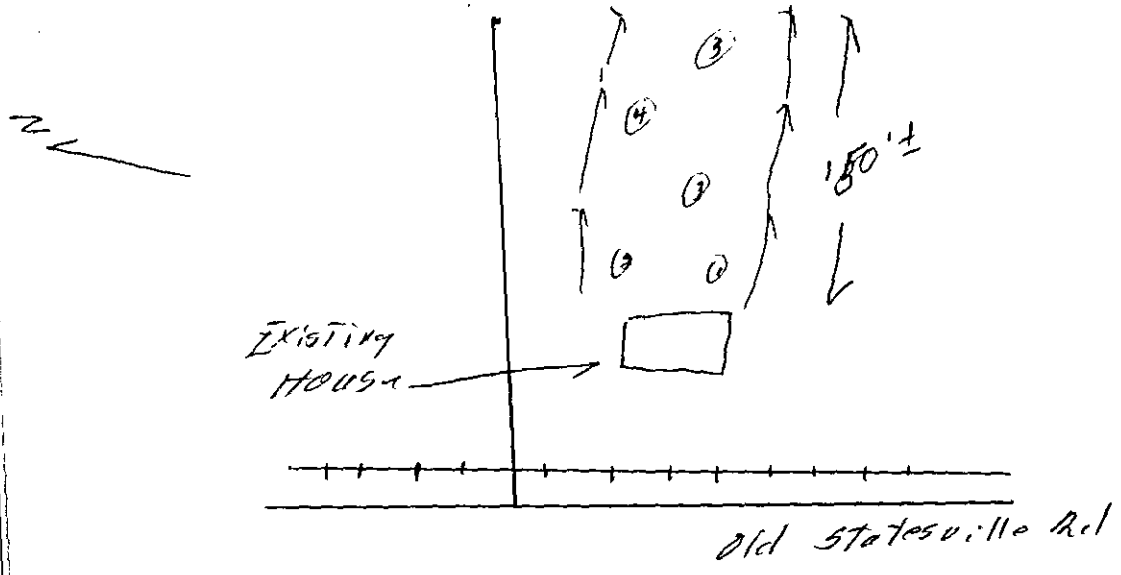

DATE: 3-15-00

TO: CHARLOTTE-MECKLENBURG BUILDING STANDARDS
PERMIT ISSUING SECTION

FROM: MECKLENBURG COUNTY ENGINEERING

JURISDICTION Hunt

019-111-04
PARCEL NUMBER

12336 Old Statesville RD
ASSIGNED STREET ADDRESS (ADDRESS OF RECORD)

EXISTING STREET ADDRESS (IF DIFFERENT FROM ASSIGNED)

PROJECT NAME (IF APPLICABLE)

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

1. SUBDIVISION REGULATIONS	_____ APPROVED	_____ NOT APPROVED
2. FLOODWAY REGULATIONS	_____ APPROVED	_____ NOT APPROVED
3. WATERSHED PROTECTION	_____ APPROVED	_____ NOT APPROVED
4. COMERCIAL DRAINAGE PLAN	_____ APPROVED	_____ NOT APPROVED
5. PUBLIC UTILITY EASEMENT	_____ PRESENT	_____ NOT PRESENT
6. PROPERTY FRONTS ON THOROUGHFARE	_____ YES	_____ NO
7. DRIVEWAY PERMIT REQUIRED	_____ YES	_____ NO
8. DOES PROJECT CONFLICT WITH ROAD PROJECT?	_____ YES	_____ NO

REMARKS: Address Verification

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIERS OFFICE WHEN PAYING PERMIT FEE. CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAY(S).

ALL OTHER FORMS OBSOLETE

☐ NEW ADDRESS
REVISED 1/91

SIGNED: [signature]

FEE: 200.00 #104

DATE: 3/14/00 EHO

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: X NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 4261B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION: 12336 Old Statesville Rd.

TAX/PARCEL NUMBER: 019-111-04

STREET ADDRESS: 12336 Old Statesville Rd

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

- ✓ 0 MECKLENBURG
- __ 1 CHARLOTTE
- __ 2 DAVIDSON
- __ 3 CORNELIUS
- __ 4 PINEVILLE
- __ 5 MATTHEWS
- __ 6 HUNTERSVILLE
- __ 7 MINT HILL

CLOSING DATE_____

TYPE OF BUILDING (CHECK ONE):

- __ SINGLE MOBILE HOME(S)
- __ DOUBLE WIDE (D)
- ✓ HOUSE (H)
- __ MODULAR HOME (M)
- __ MULTIPLE FAMILY (U)
- __ OTHER (O)

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 4

FOUNDATION FOR RESIDENCE:

- __ WITHOUT BASEMENT
- __ ON SLAB
- __ CRAWL SPACE
- __ WITH BASEMENT /PLUMBING
- __ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

- __ COMMUNITY (C)
- __ MUNICIPAL (M)
- ✓ PRIVATE WELL (P)
- __ SHARED WELL (S)
- __ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	__ YES ✓ NO	WELL, SPRINGS OR WATERLINES	__ YES ✓ NO
EXISTING WASTEWATER SYSTEMS	__ YES ✓ NO	DESIGNATED WETLANDS	__ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS	__ YES ✓ NO		

PROPERTY OWNER:

NAME: Johnston Arnold Wilson
(LAST) (FIRST) (MI)

ADDRESS: 12300 old Statesville Rd.

CITY: Huntersville STATE: N.C. ZIP: 28078

DAYTIME PHONE: 704 875-8515

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) -

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Arnold W. Johnston DATE: 3-14-2000

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

PG. 09

4261D

PG. 10

See new Page

PG. 17

PG. 12

PG. 13

TAX LINE MAP	BOOK 19 PAGE 11
MECKLENBURG COUNTY, NORTH CAROLINA	
REVISED	SCALE 1" = 400'

FOR TAX PURPOSES ONLY