C of A(s) No. 17495

Date Issued 3-31-82 Serial 5029 T.C. No. 25-031-06

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF COMPLETION
CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner: Gardner (LAST) Ernest (FIRST) A (MIDDLE)

Location of Property: 318 Westdale Road

Application Number: 17495 Permit Number: 17495

Inspection Data:

Liquid Capacity of Tank: Existing Tank Material: Existing

Total Length of Drain Tile: 100' Repair Number of Lines: one

Depth of Filter Material: 10" Cover Depth: 15"+

Water Supply Source: City water Distance from Water Source: 20'+

Excavation Inspected: 3-31-82 (DATE) Tank Inspected: N/A (DATE)

Nitrification Field Inspected: 3-31-82 (DATE)

Washing Machine Line Inspected, If Applicable: 3-31-82 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been repaired installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments:

Bob Wilson
Environmentalist

EHD-S-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

SEE INSTRUCTIONS ON BACK

Date Received 12/8/80

ICAR(S) Application No. 17495

T. C. No. 215-031-06


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) _____ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

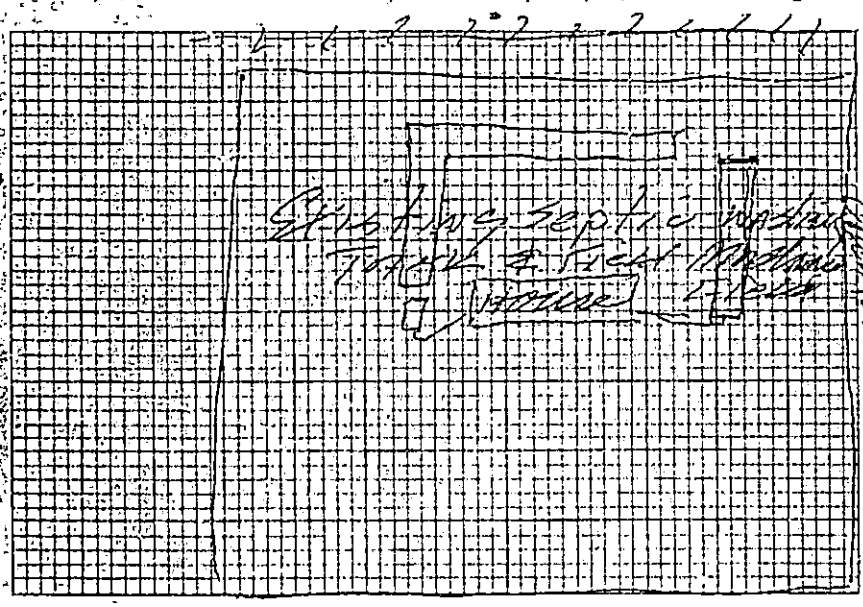

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ____Yes ____No
Residence ____Yes ____No
4) No. of Bedrooms 2
5) Business Use — Max No. Employees ____
6) Washing Machine ____Yes ____No
7) Garbage Disposal ____Yes ____No
8) Dishwasher ____Yes ____No
9) Water Supply:
A) Individual Well ____
B) Governmental System ✓
C) Community System:
1. Well source ____
2. Governmental source ____
10) Sewage System:
House located within 200 feet of public sewer ____Yes ✓No
House located within 200 feet of community sewer ____Yes ____No
11) FHA Case No. ____
12) VA Case No. ____

13) NAME OF OWNER Gardner (LAST) Earnest (FIRST) H. (MIDDLE)

14) ADDRESS OF OWNER P. O. Box 246 Matthews, N.C. 28105

15) PHONE NO. Home 847-9985 Office ____

16) LOCATION OF SYSTEM Crestdale Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION ____ Lot No. ____ Block No. ____

Map Book No. ____ Page No. ____

18) DEED REFERENCE — DEED BOOK ____ AT PAGE ____

19) HAS A SOIL INVESTIGATION BEEN RUN? ____ YES ____ NO DATE RUN ____

20) PTR NUMBER (See Instructions) ____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

DATE OF APPLICATION

OWNER E. H. Gardner

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Issued 1-15-81 Serial 4249

C of A (s) No. 17495

T. C. 15-031-06

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner GARDNER (LAST) Earnest (FIRST) A (MIDDLE)

Location of Property Crestdale Rd off Tank Town Rd

Application Number 17495 Permit Number 17495

Inspection Data:

Liquid Capacity of Tank Existing Tank Material N. A

Total Length of Drain Tile 100' Number of Lines 2

Depth of Filter Material 4' Cover Depth 24"

Water Supply Source City Distance from Water Source 101+

Excavation Inspected 1-15-80 (DATE) Tank Inspected N. A. (DATE)

Nitrification Field Inspected 1-15-80 (DATE)

Washing Machine Line Inspected, If Applicable 1-15-80 (DATE) REPAIR

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been _____ installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments: _____

Marshall Edwards
Environmentalist

EHD-5-76

Environmental Health Department's Copy

Serial No 4452

Date Issued 12-9-80

ICAR (S) Permit No. 17495


T. C. No. 15-031-26

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct; X Alter or Repair the individual septic tank-waste water treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 17495 dated 12-8-80 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before ___, after which date this permit shall be null and void. Repair washing machine line

TANK Town Rd

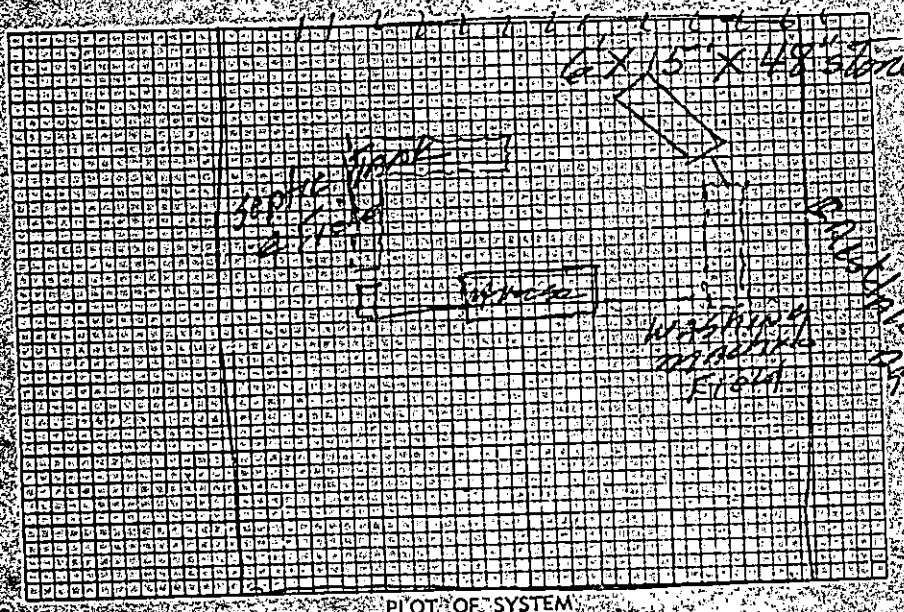

PLOT OF SYSTEM

Permeability Rate: Existing

Liquid Capacity of Tank: Existing

Tank Construction: Existing

Absorption and/or Nitrification Lines:

Total Line Length: 100'

Number of Lines: 2

Distance from House: 10'+

Distance from Property Line: 10'+

Distance from Well: Close

NAME OF OWNER: Earnest A. Gardner

LOCATION OF PROPERTY: Crestdale Rd off Charlotte on Tank Town Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Washing Machine Repair 6' X 15' X 48" Stone

Comments:

Division or Section Head

Environmentalist: Kathleen Edwards

If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy


Date Issued 3-18-82 Serial No. 5279 ICAR(S) Permit No. 17495

T. C. No. 215-031-06

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the Individual septic tank waste-water treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 17495 dated 3-15-82 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 4-2-82, after which date this permit shall be null and void.

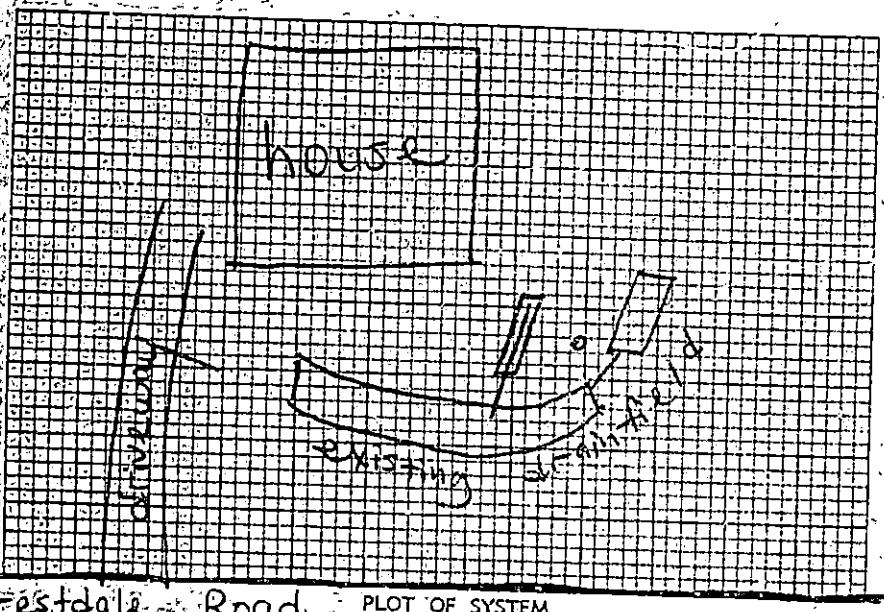

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank —

Tank Construction —

Absorption and/or Nitrification Lines:

Total Line Length 100'

Number of Lines one

Distance from House >10'

Distance from Property Line >10'

Distance from Well > city water

NAME OF OWNER Gardner, Ernest Alexander

LOCATION OF PROPERTY Crestdale Road

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

add a 3'wide x 15'long x 10' of stone

Comments: use excess soil to pack over the s.t. + washing machine drainfield

Division or Section Head

Mike Sexton
Environmentalist

If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY