

16407 TERRY LN

00102352

5/20/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

Approval


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2770 DATE: 10-12-94

TC: 001-023-52 ☐ L

SERIAL № 13913

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 10-12-94. All work shall be completed on or before 11-12-94, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

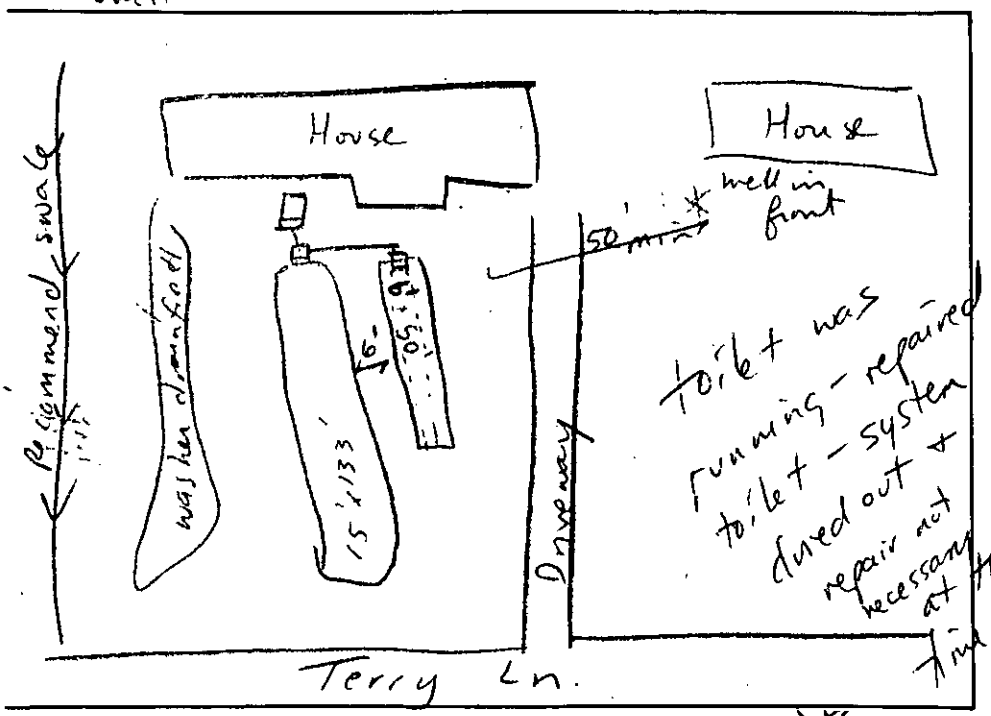

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Exist gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PVC

Absorption and/or Nitrification Lines:

Trench Width 6' feet

Total Line Length 180' feet

Number of Lines 2 at 50' each

Depth of Stone 12" inches

Distance from House 5' min feet

Distance from Property Line 10' min feet

Distance from Well 50' min feet

** Please have septic tank Contractor call before installing.

NAME OF OWNER Joe Bost

LOCATION OF PROPERTY 16407 Terry Ln

Comments: Recommend pumping tank out just before repair is started. Keep 6' Separation distance between fields. Repair any possible leaky plumbing. Recommend swale to divert surface water runoff away from drainfield area.

Division or Section Head

Susan Batten
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

Approval

LQ460


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2770 DATE: 10-12-94

TC: 001-023-52 ☐ L

SERIAL Nº 13913

Permission is hereby given to ____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 10-12-94. All work shall be completed on or before 11-12-94, after which date this permit shall be null and void. The system shall meet all of the construction requirements of ~~15~~ NCAC 18A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

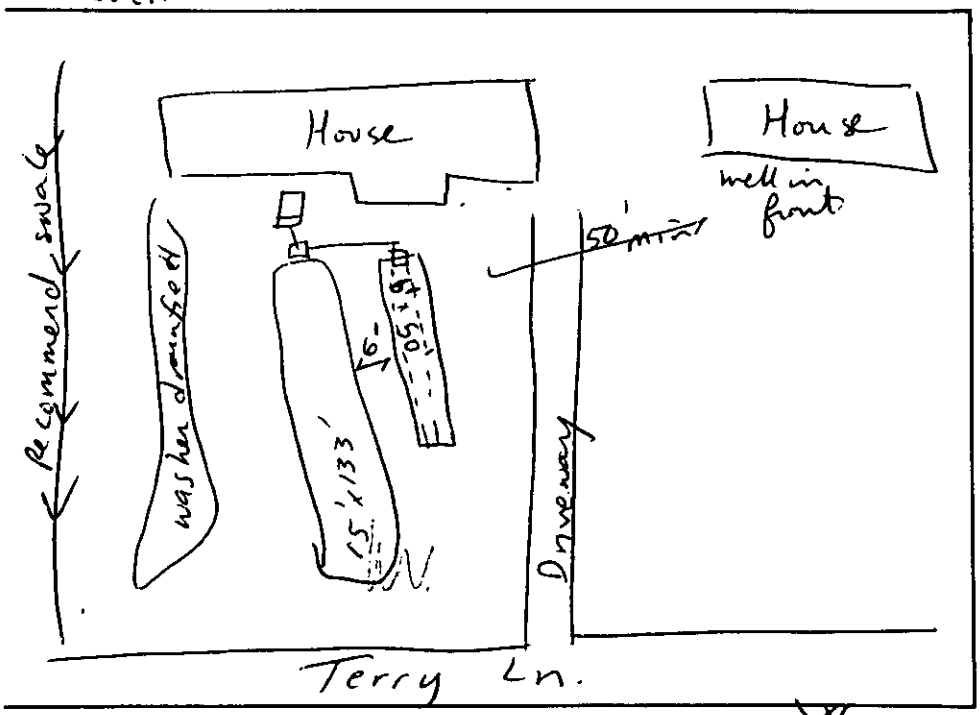

PLOT OF SYSTEM

Liquid Capacity of Septic Tank: Exist gallons

Liquid Capacity of Dosing Tank: — gallons

Tank Construction: PLC

Absorption and/or Nitrification Lines:

Trench Width: 6' feet

Total Line Length: 180' feet

Number of Lines: 2 at 50' each

Depth of Stone: 12" inches

Distance from House: 5' min feet

Distance from Property Line: 10' min feet

Distance from Well: 50' min feet

** Please have septic tank Contractor call before installing

NAME OF OWNER: Joe Bost

LOCATION OF PROPERTY: 16407 Terry Ln

Comments: Recommend pumping tank at 3 yrs. before repair is started. Keep 6' Separation distance between fields. Repair any possible leaky plumbing. Recommend swale to divert surface water runoff away from drainfield area

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

Rte 2770

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

D402

[ ] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:
NAME: Bost (last) JOE (first) K (mi)
ADDRESS: 16407 TERRY LN PHONE: 704) 875-2737; 892-7800 (work)
CITY: Huntersville STATE: NC ZIPCODE: 28078

Date: 10-12-94

PROPERTY OWNER:
NAME: SAME (last) (first) (mi)
ADDRESS: PHONE: ( )
CITY: STATE: ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 001-023-52
STREET ADDRESS: 16407 Terry ln
ZONING:

Township (check one):
[ ] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):
[ ] SOIL TEST - INDIVIDUAL LOT (D)
[ ] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[X] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[ ] SINGLE MOBILE HOME (S) [X] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: 4 NUMBER OCCUPANTS: 3

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [X] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Joe K Bost Date: 10-12-94

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... repair permit issued

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Susan Fortenberry 10-12-94
Environmentalist Date

Director or Authorized Section Head Date

WATER : 12279