SEE INSTRUCTIONS ON BACK

Date Received 6-1-83

ICAR(S) Application No. 19720

T. C. No 111-144-07


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) . . . Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

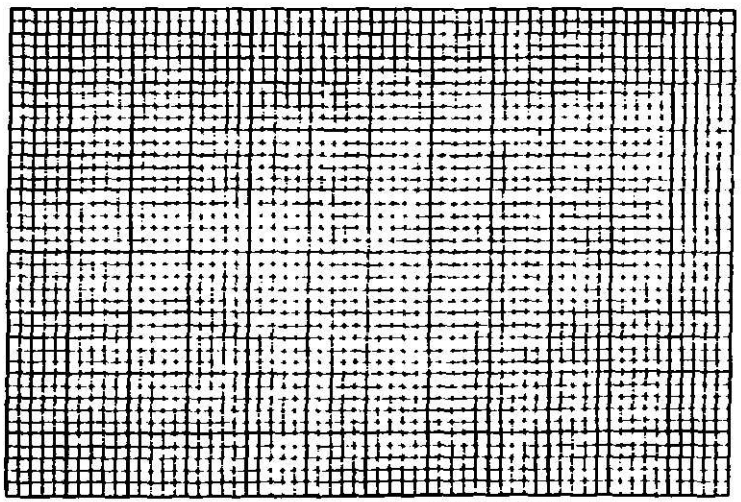

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) Mobile Home ___ Yes ✓ No
Residence ✓ Yes ___ No

4) No. of Bedrooms 3

5) Business Use — Max No Employees ___

6) Washing Machine ✓ Yes ___ No

7) Garbage Disposal ___ Yes ✓ No

8) Dishwasher ___ Yes ✓ No

9) Water Supply:
A) Individual Well ___
B) Governmental System ✓
C) Community System:
1 Well source ___
2 Governmental source ___

10) Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No

11) FHA Case No N/A

12) VA Case No. N/A

13) NAME OF OWNER Dunn (LAST) Ike (FIRST) ___ (MIDDLE)

14) ADDRESS OF OWNER 9604 Misenheimer Rd 28215

15) PHONE NO. Home 374-2831 (Preston Page) Office ___

16) LOCATION OF SYSTEM 9604 Misenheimer Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. ___ Block No. ___

Map Book No. ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

5/31/83
DATE OF APPLICATION

Dunn Dunn
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

/

Date Issued 13 Oct 83 **Serial No. 6688** ICAR(S) Permit No. 19720

T. C. No. 111-144-07


Map Date ________

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ____Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19720, dated 31 May 83 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 13 Nov 83, after which date this permit shall be null and void.

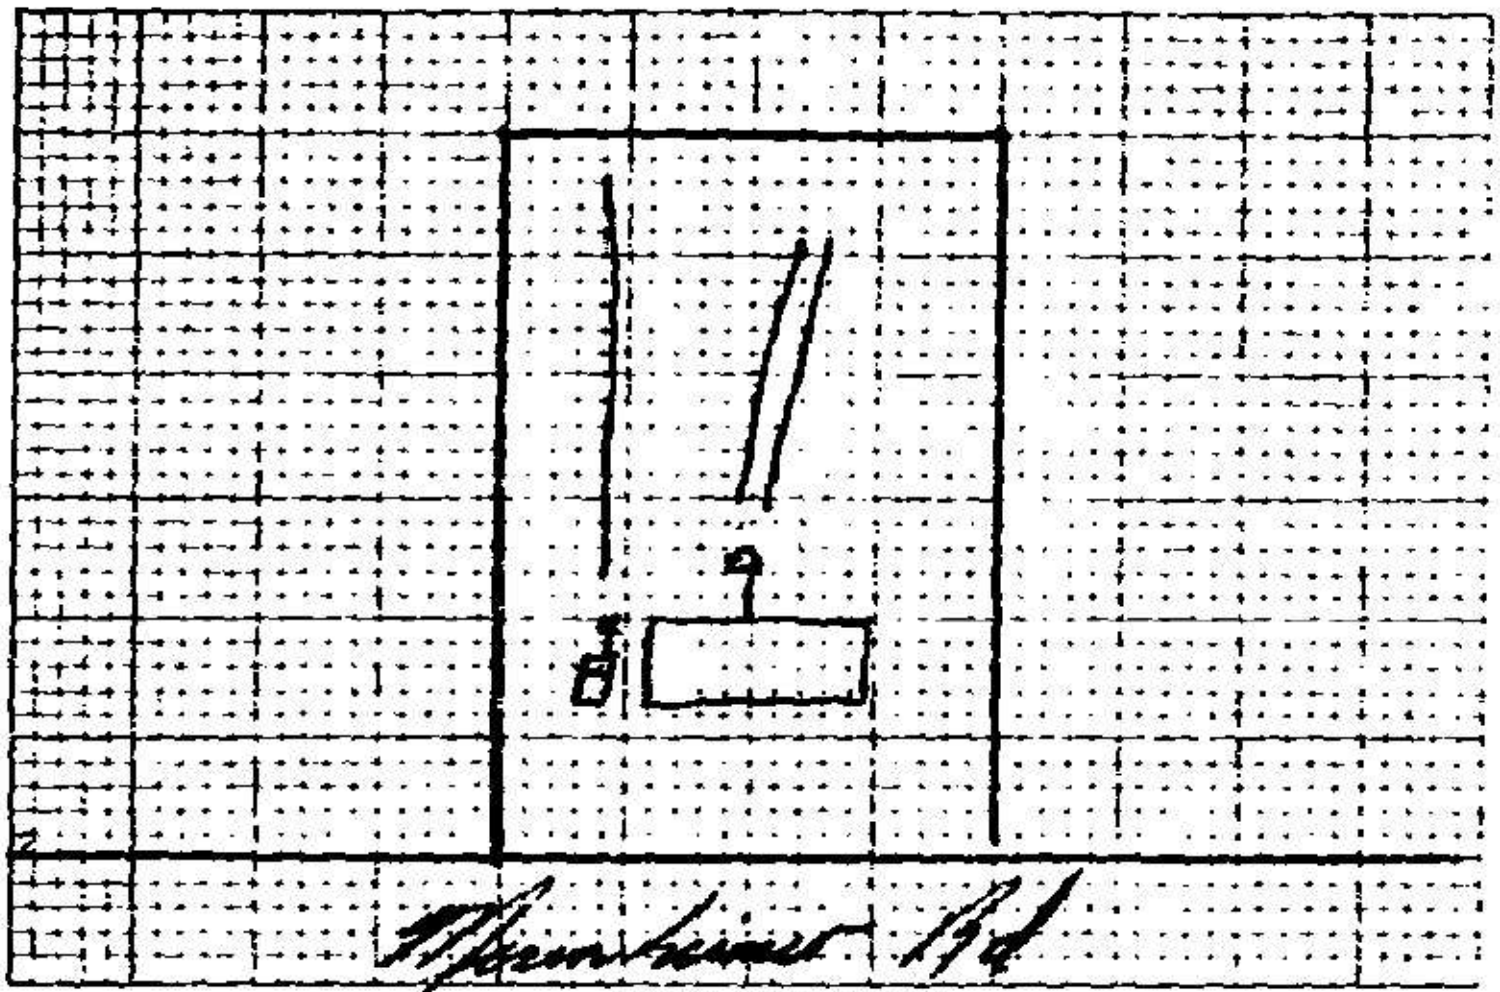

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank —

Tank Construction —

Absorption and/or Nitrification Lines:

Total Line Length 125' & 100'

Number of Lines 2 & 1

Distance from House 75'

Distance from Property Line >10'

Distance from Well City water

NAME OF OWNER Dunn, Dale

LOCATION OF PROPERTY 9604 Mimsheimer Road

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

WM Trench 3'X63'X12"

Comments: ST. Trench 3'X63'X12"

Division or Section Head ________ Environmentalist W. D. Kirby

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

C of A (s) No. 19720

Date Issued 14 Oct 83 Serial 6212 T. C. No. 111-144-07

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF COMPLETION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner [illegible] / [illegible] (LAST / FIRST / MIDDLE)

Location of Property 9604 Mimosa Rd

Application Number 19720 Permit Number 19720

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 125'WM + 100'ST Number of Lines 2 & 1

Depth of Filter Material 12" Cover Depth 15-18"

Water Supply Source City Distance from Water Source —

Excavation Inspected 13 Oct 83 (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 13 Oct 83 (DATE)

Washing Machine Line Inspected, If Applicable 13 Oct 83 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been — — installed or constructed, ✓ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments: WM - 2 Trenches 3'X63'X12"

ST - 1 Trench 3'X100'X12"

M. L. Kirby
Environmentalist

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY