

3433 MIRANDA RD

03315108

7/14/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007

Barcode Font = IDAutomationHC39M

$150.00

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102


FILE: 14538 DATE: 4-18-97

TC: 033-151-08 ✓

SERIAL Nº 17193

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 3-31-97. All work shall be completed on or before 5-18-97, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

- Disconnect washing machine and plumb into septic tank
- Add D-Box if one is not present
- May substitute (2) 3'w trenches in place of 6' bed.

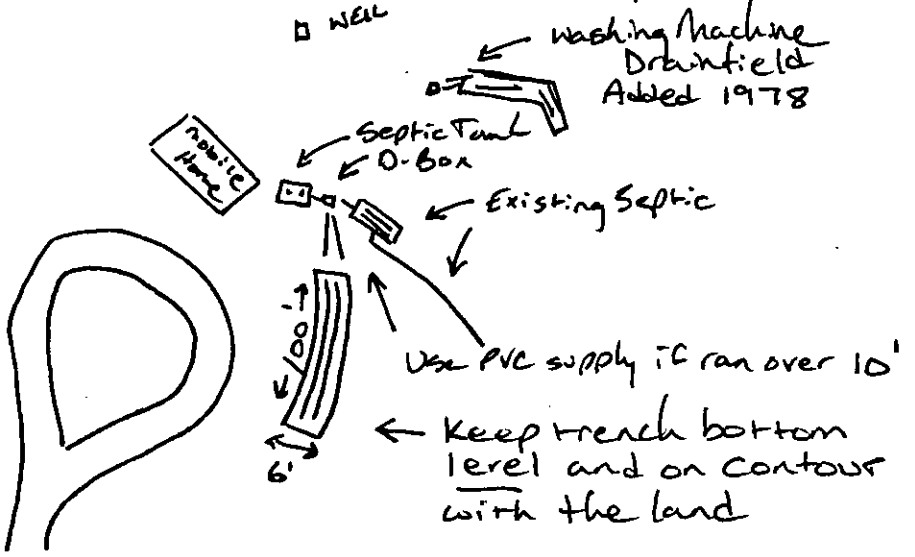

PLOT OF SYSTEM

Liquid Capacity of Septic Tank existing gallons

Liquid Capacity of Dosing Tank N/A gallons

Tank Construction N/A

Trench Depth ≤ 36" as shallow as possible

Absorption and/or Nitrification Lines:

Trench Width 6 feet

Trench Walls Scored and Porous Yes

Total Line Length 200 feet

Number of Lines 2 in 1

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well > 50 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Harry Douglas Hager

LOCATION OF PROPERTY 3433 Miranda Road

Comments: Type II a repair 3 bedrooms
(1) 6'w x 100'L x 12" stone
* Feed New bed (or trenches) first — use speed levels inside D-Box

Larry B. Thompson, J., R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14538 DATE: 5-12-97

TC: 033-151-08 ☐ L ☒ CRT

SERIAL Nº 16945

Name of Owner Harry Douglas Hager Juris.: _____

Address of Property 3433 Miranda Road

Inspection Data:

Tank Material existing

Total Length of Drainfield 200'

Number of Lines 2 @ 100'

Cover Depth 12"

Water Supply Source priv. well


Distance to Water Source 750'

Excavation Inspected 5-12

Tank(s) Inspected N/A

Wash Line Inspected N/A

High Water Alarm Inspected N/A

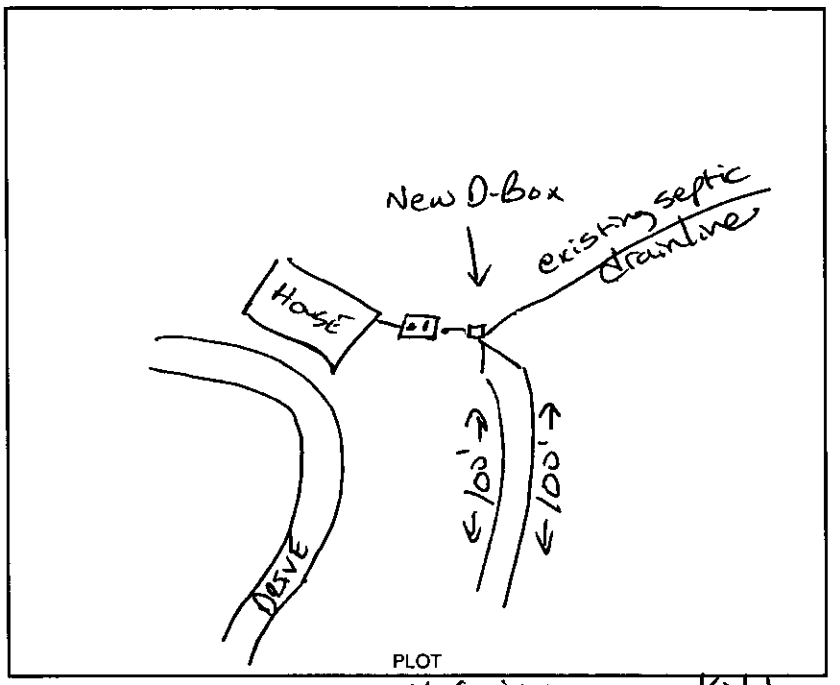

Design 1997 alteration; CON, 600SF, T, 12G, soil series not determined TR# Kidd 172

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☐ in accordance with the permit issued ☑ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Type IIa alteration 3 bedrooms
Washing machine is to be plumbed back into
septic tank - disconnecting from washer drainfield

Larry G. Thompson, J., R.S.
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

TE X400

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION** X
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 4.18.97 PERMIT NO: 14538
PARCEL NO: 033-151-08

JOB LOCATION ADDRESS: 3433 Miranda Rd
PROPERTY OWNER: Harry Douglas Hagel
BUILDING CONTRACTOR: _____
SUBDIVISION NAME: _____
AUTHORIZATION ISSUED BY: Danny B. Thompson Jr. L.S. DATE: 4-18-97
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 14538, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: See conditions of Improvement permit

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

Harry D Hagel 4-18-97
SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

Permit Number: 14538 Tax Number: 033-151-08

The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.

CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.

Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
___ Long-term acceptance rate	___ Max gallons/day wastewater flow	___ Absorption Area (sq ft)	___ Trench spacing (min. on centers)
Yes Serviced by private well	___ Gallon septic tank	___ Total trench length (ft)	___ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
___ Bedrooms in residence	___ Gallon pump tank	___ Depth of stone	
Any surface waters present:	Type:	Minimum separation distance:	
Site modifications required:			
Additional Conditions: 3 bedroom alteration (1) 6'w x 100'L x 12" stone			
Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
600 Absorption Area (Sq ft) 300 Total Trench Length (Ft)	12" Depth of Stone Trench	N/A Trench spacing (min. on centers)	≤36" Maximum Trench Depth
For existing system, enter the year originally installed:			

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department
- This Improvement permit is transferable.

Larry B. Mullis 4-18-97
DEHNR Authorized Agent Date

Harry D. Hagen 4-18-97
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

File 14538 pd 15.00 ck# 2957 11/04/97

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$30.00 4-1-97 ck#2950 [ ] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date:

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 083-151-08

STREET ADDRESS: 3433 Miranda Rd

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

PERSON FILING APPLICATION:

NAME: Hager (last) Harry (first) Douglas (mi)

ADDRESS: 3433 Miranda Rd. PHONE: (__) 392-8188 work

CITY: Charlotte STATE: NC ZIPCODE: 28216.

PROPERTY OWNER:

NAME: Hager (last) Harry (first) Douglas (mi)

ADDRESS: 3433 Miranda Rd PHONE: (__) 392-8188 work.

CITY: Charlotte. STATE: NC ZIPCODE: 28216

Home # 394-0252

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):

[ ] EXISTING 2 BEDROOM
[X] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y) NEW 3 bedrooms
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)

RESIDENTIAL PROPERTY (Type Building, check one)
[ ] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[X] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [ ] None
[ ] Garage [ ] Storage Building [X] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Harry D Hager Date: 3-31-97

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[X] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

4-2-97 OSV washing machine drainfield has some problems - septic drainfield is supersaturated - Would recommend Washing Machine to be plumbed back into septic tank and more septic drainfield added - Ileteja detailed message on answering machine for the owner. TO

Environmental Hlth Spec 4-18-97 Date

4-18-97 Release with hold on C.O. Will install alteration later.

WWATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14538

TC: 033-151-03

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

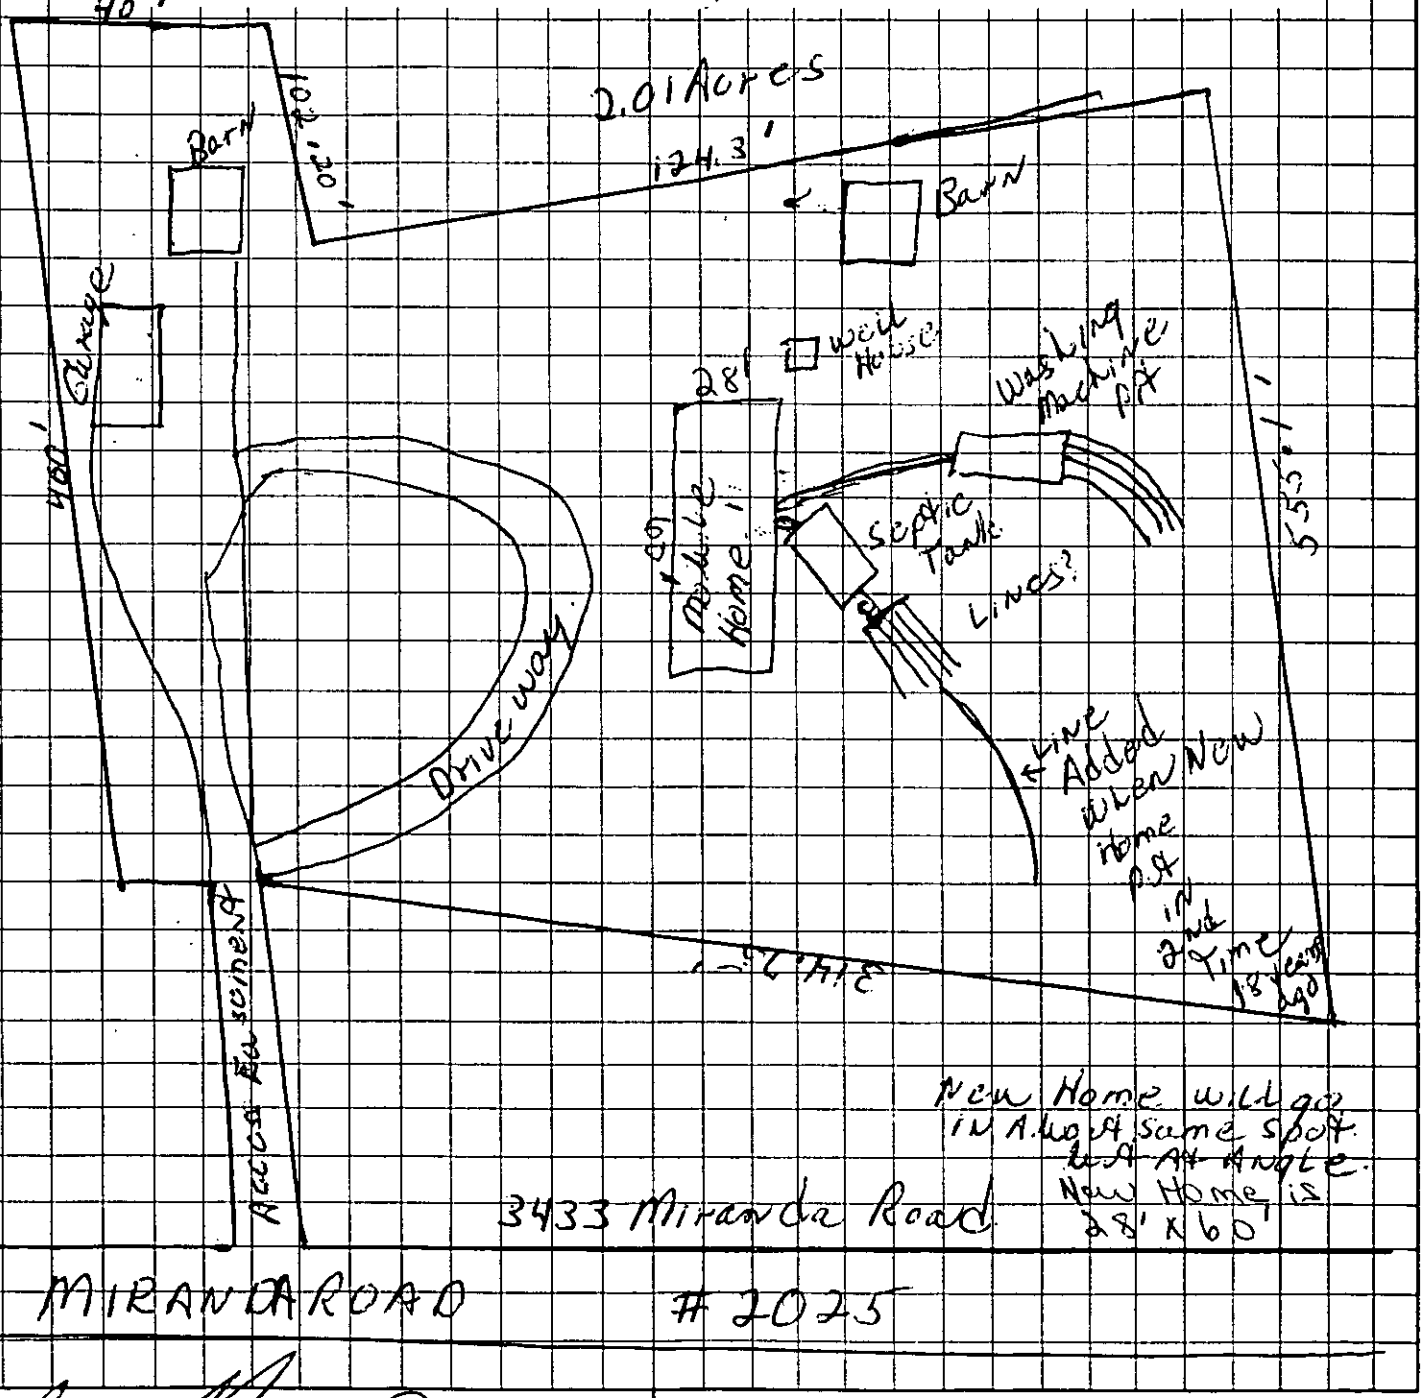

OWNER/AGENT SIGNATURE

DATE 3-31-97

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

$250

File 14538

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$30 — 4-1-97
CK #2950

[ ] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: Hager (last) Harry (first) Douglas (mi)

ADDRESS: 3433 Miranda Rd PHONE: (__) 392-8188 work

CITY: Charlotte STATE: NC ZIPCODE: 28216

Date:

PROPERTY OWNER:

NAME: Hager (last) Harry (first) Douglas (mi)

ADDRESS: 3433 Miranda Rd PHONE: (__) 392-8188 work

CITY: Charlotte STATE: NC ZIPCODE: 28216

Home # 394-0252

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 033-151-08

STREET ADDRESS: 3433 Miranda Rd

ZONING: _____

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):

[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y) Existing 2 Bedroom New = 3 bedrooms
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] [redacted] BEDROOMS (E)
[ ] [redacted])

RESIDENTIAL PROPERTY (Type Building, check one)
[ ] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[X] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [ ] None
[ ] Garage [ ] Storage Building [X] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Harry D Hager Date: 3-31-97

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

_____ Date
Environmentalist

WATER : 122791