

5725 THOMPSON RD

03711404

12/19/2007

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 648B/8519A DATE: 12/9/93

TC: 037 114 04 ☐ CL ☒ CRT

SERIAL № 15371

Name of Owner Cora B. Hill Juris.:

Address of Property 5725 Thompson Rd

Inspection Data:

Tank Material PCC

Total Length of Drainfield 268'

Number of Lines 4 @ 67'

Cover Depth 8"-14"

Water Supply Source well

Distance to Water Source >50'

Excavation Inspected 12/9/93

Tank(s) Inspected 12/9/93

Wash Line Inspected -

High Water Alarm Inspected -

PLOT

Design: 1993, 1500 ST, 888 SFT, CON, 12" stone cecil CTR# A. Cornelius

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Septic System designed for 3 bedroom residence

T. Walker for S. Daniel
10/9/93

Philo A. Walker R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 648B/8519A DATE: 12/7/93

TC: 037-114-04 ☐ L

SERIAL Nº 15206

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 11/15/93. All work shall be completed on or before 1/7/94, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

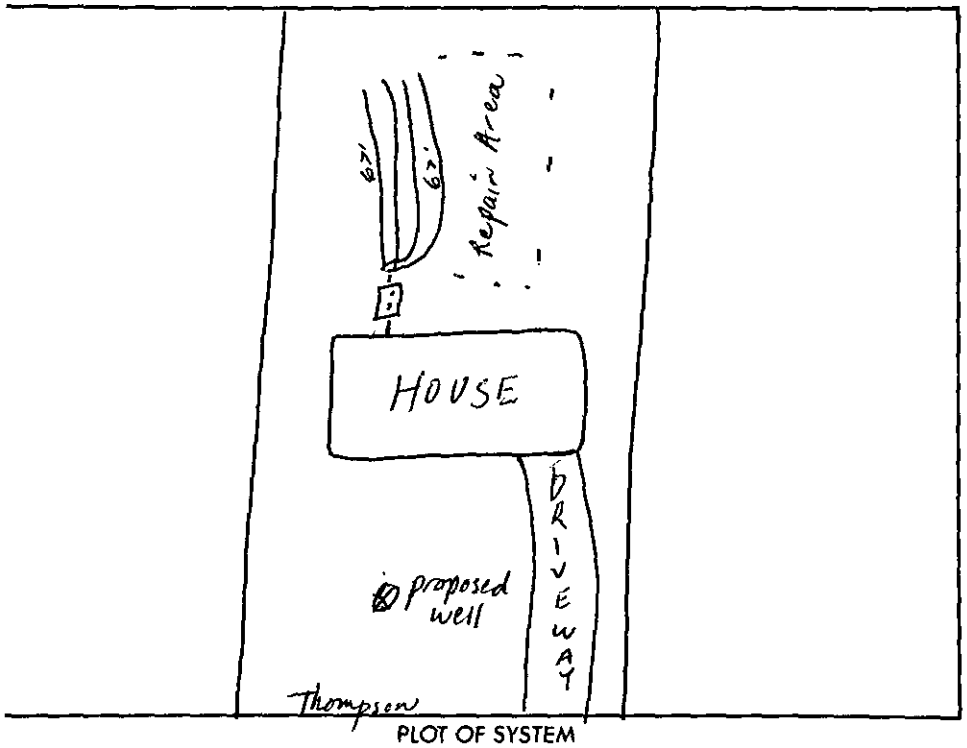

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank [redacted] gallons

Tank Construction PCC

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 270 feet

Number of Lines 4

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well >50 feet

NAME OF OWNER Cora B. Hill

LOCATION OF PROPERTY 5725 Thompson Rd

Comments: 1500 ST, 4 lines x 67'long x 3'wd x 12"stone
Keep septic system on contour of land | Keep septic system >50' from any wells.

Division or Section Head

Milo S. Walker R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

6488/8519A 4400

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

~~Ck #4497~~ #200.00 11/05/93 CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date: 6-1-93

PERSON FILING APPLICATION:
NAME: Hill (last) Cora (first) B (mi)
ADDRESS: 5717 Thompson Rd PHONE: 704 394-1708
CITY: Charlotte STATE: NC ZIPCODE: 28216

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 037-114-04
STREET ADDRESS: 5725 Thompson Rd.
ZONING:

PROPERTY OWNER:
NAME: Hill (last) Cora (first) B (mi)
ADDRESS: 5717 Thompson Rd PHONE: 704 394-1708
CITY: Charlotte STATE: NC ZIPCODE: 28216

SUBDIVISION OR MOBILE HOME PARK NAME: Springlake

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

TYPE APPLICATION (check one):
LOT NUMBER: LOT SIZE (in acres):

[ ] SOIL TEST - INDIVIDUAL LOT (D)
[X] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[ ] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[X] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: 2 NUMBER OCCUPANTS: 2
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [X] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Pamela H. Francis Date: 11-5-93

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[X] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Philip A. Walker 11/15/93
Environmental Date

Director or Authorized Section Head Date

WWATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 648B/8519A

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

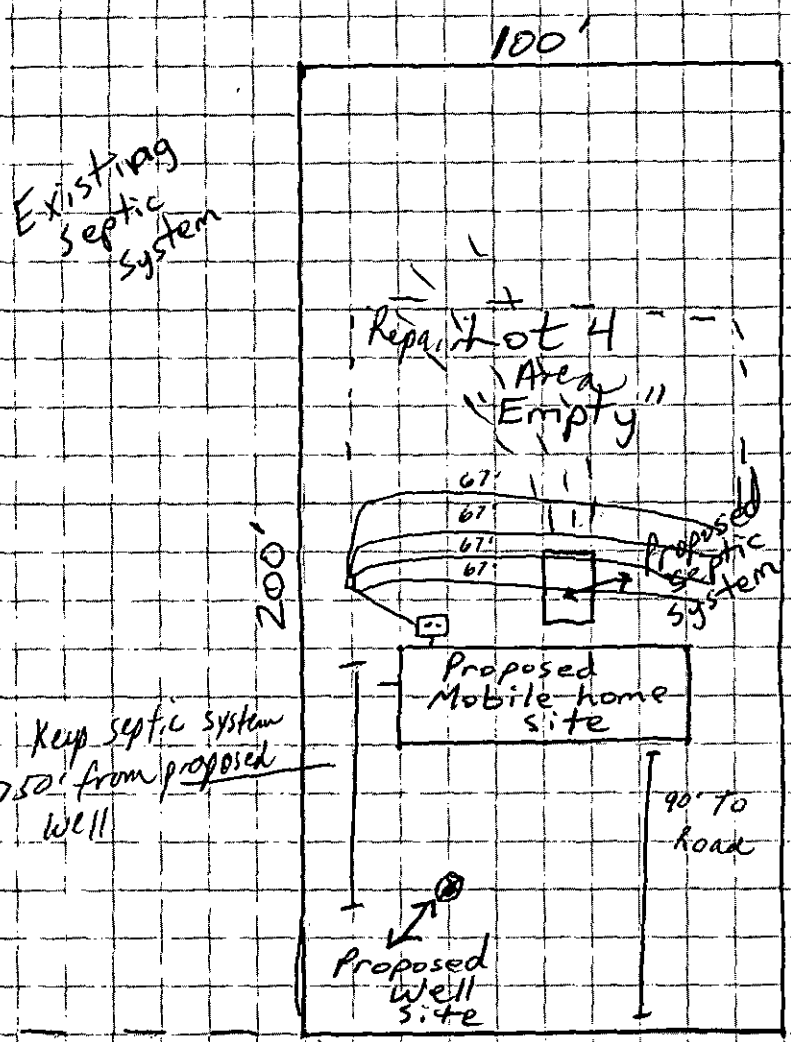

1500 ST
4 lines x 67' long x 3' wid x 2" stone
268' LF
Keep septic system
> 50' from any wells.
Pam Warren

Existing Septic System

Thompson Road

APPROVAL DATE PAW 11/15/93 appr

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
SITE EVALUATION REPORT
SERIAL NUMBER 12852

File: 6488/8519A Action 1

Parcel: 037-114-04 ☐ PC

Location: Thompson Road

Subdivision:


Lot: 4 Block: Acres: .47

Owner: Clara B. Hill
Address: 5717 Thompson Road
Charlotte, N.C.

Comments: _____

Described by: William A. Marlin

Date: 10-1-92

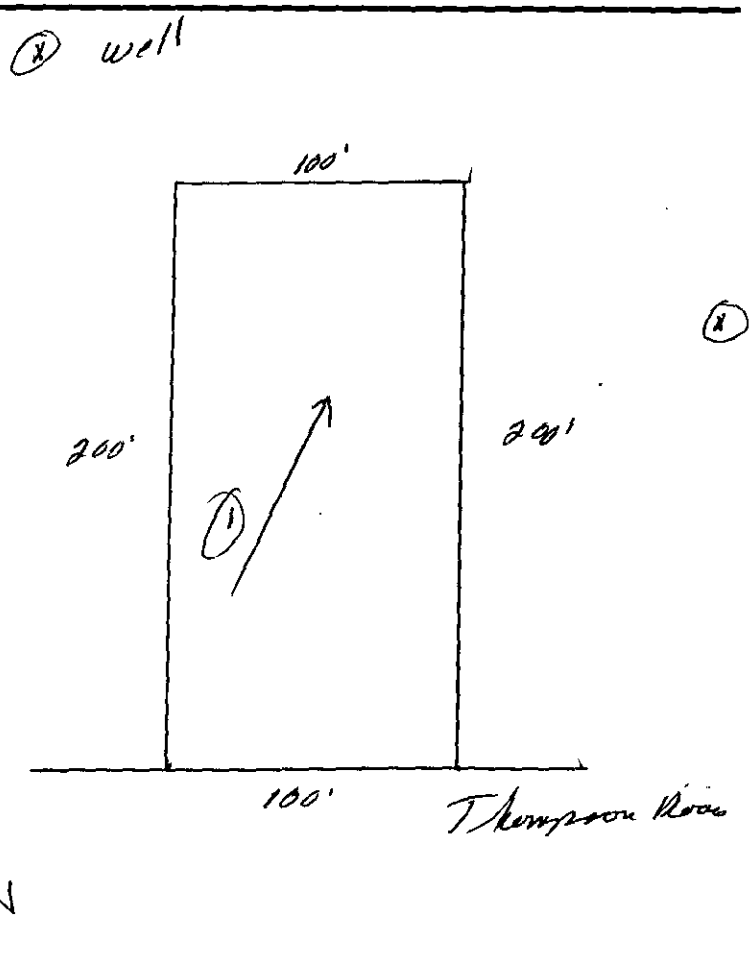

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U S-10%	S PS U	S PS U	S PS U	S PS U	S PS U
Texture	S (PS) U Slightly Expansive clay	S PS U	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U Sub Angular Blocky	S PS U	S PS U	S PS U	S PS U	S PS U
Drainage	(S) PS U 7-48" To water	S PS U	S PS U	S PS U	S PS U	S PS U
Depth	(S) PS U >48"	S PS U	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	(S) PS U >48"	S PS U	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U Limited	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	III Cecil-Lo					
Area Classification	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U

Mecklenburg County

Health Department

Betty S. Snow, R.N., M.A.
Health Director

October 02, 1992

Ms. Clara B. Hill
5717 Thompson Road
Charlotte, NC 28212

RE: Property located off Thompson Road
FILE: 648B/8519A
PARCEL: 037-114-04

Dear Ms. Hill:

At your request, a field investigation was conducted on the property designated above for the purpose of determining site suitability for the installation of a ground absorption sewage disposal system. The property was found to contain a limited area of soils which were classified as PROVISIONALLY SUITABLE for such an installation. A copy of the Site Evaluation Report (Serial Number 12852) is enclosed for your information.

While this classification indicates the site is acceptable for the installation of a septic tank system, no specific system or plans have been approved. The area available for such an installation may impose limitations on the size and/or type construction permitted on the lot. Our review process begins upon receipt of an Application for an Improvement Permit accompanied by a plot plan **drawn to scale with accurate dimensions indicated** detailing the location of **existing** well or type sewage disposal systems (if applicable), setbacks, and utility easements. Proposed buildings, etc. must be drawn on the plot plan to allow sufficient remaining space for the sewage disposal system and well. The well should be located 100 feet from any part of any sewage disposal system (including those located on adjacent properties).

Please note that this classification may be changed if any filling, grading or construction (including the drilling of a well) is performed on the lot which without **prior** approval from this Department. Current regulations in effect are "Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal: 15A NCAC 18A .1900, August, 1991". Changes in regulations may impact future approvals on this lot.

If there are any questions concerning this matter, please contact Bill Marlin at 336-5574.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems
KR/wpg

File #648B/8519A)

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

Pd 50.00 CK 9/13 92
[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

COPY

Date:

PERSON FILING APPLICATION:
NAME: Hill (last) Cora (first) B. (mi)
ADDRESS: 5717 Thompson RD PHONE: (704) 394-1708
CITY: Charlotte STATE: NC ZIPCODE: 28216

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 037-114-04
STREET ADDRESS: OFF THOMPSON RD (5700 BLK)
ZONING:

PROPERTY OWNER:
NAME: Hill (last) Cora (first) B (mi)
ADDRESS: 5717 Thompson RD PHONE: (704) 394-1708
CITY: Charlotte STATE: NC ZIPCODE:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

[X] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[X] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 2 NUMBER OCCUPANTS: 2
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Cora B. Hill Date: 9/18 92

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collectiog, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 648B / 8519A.

TC: 057-114-04.

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

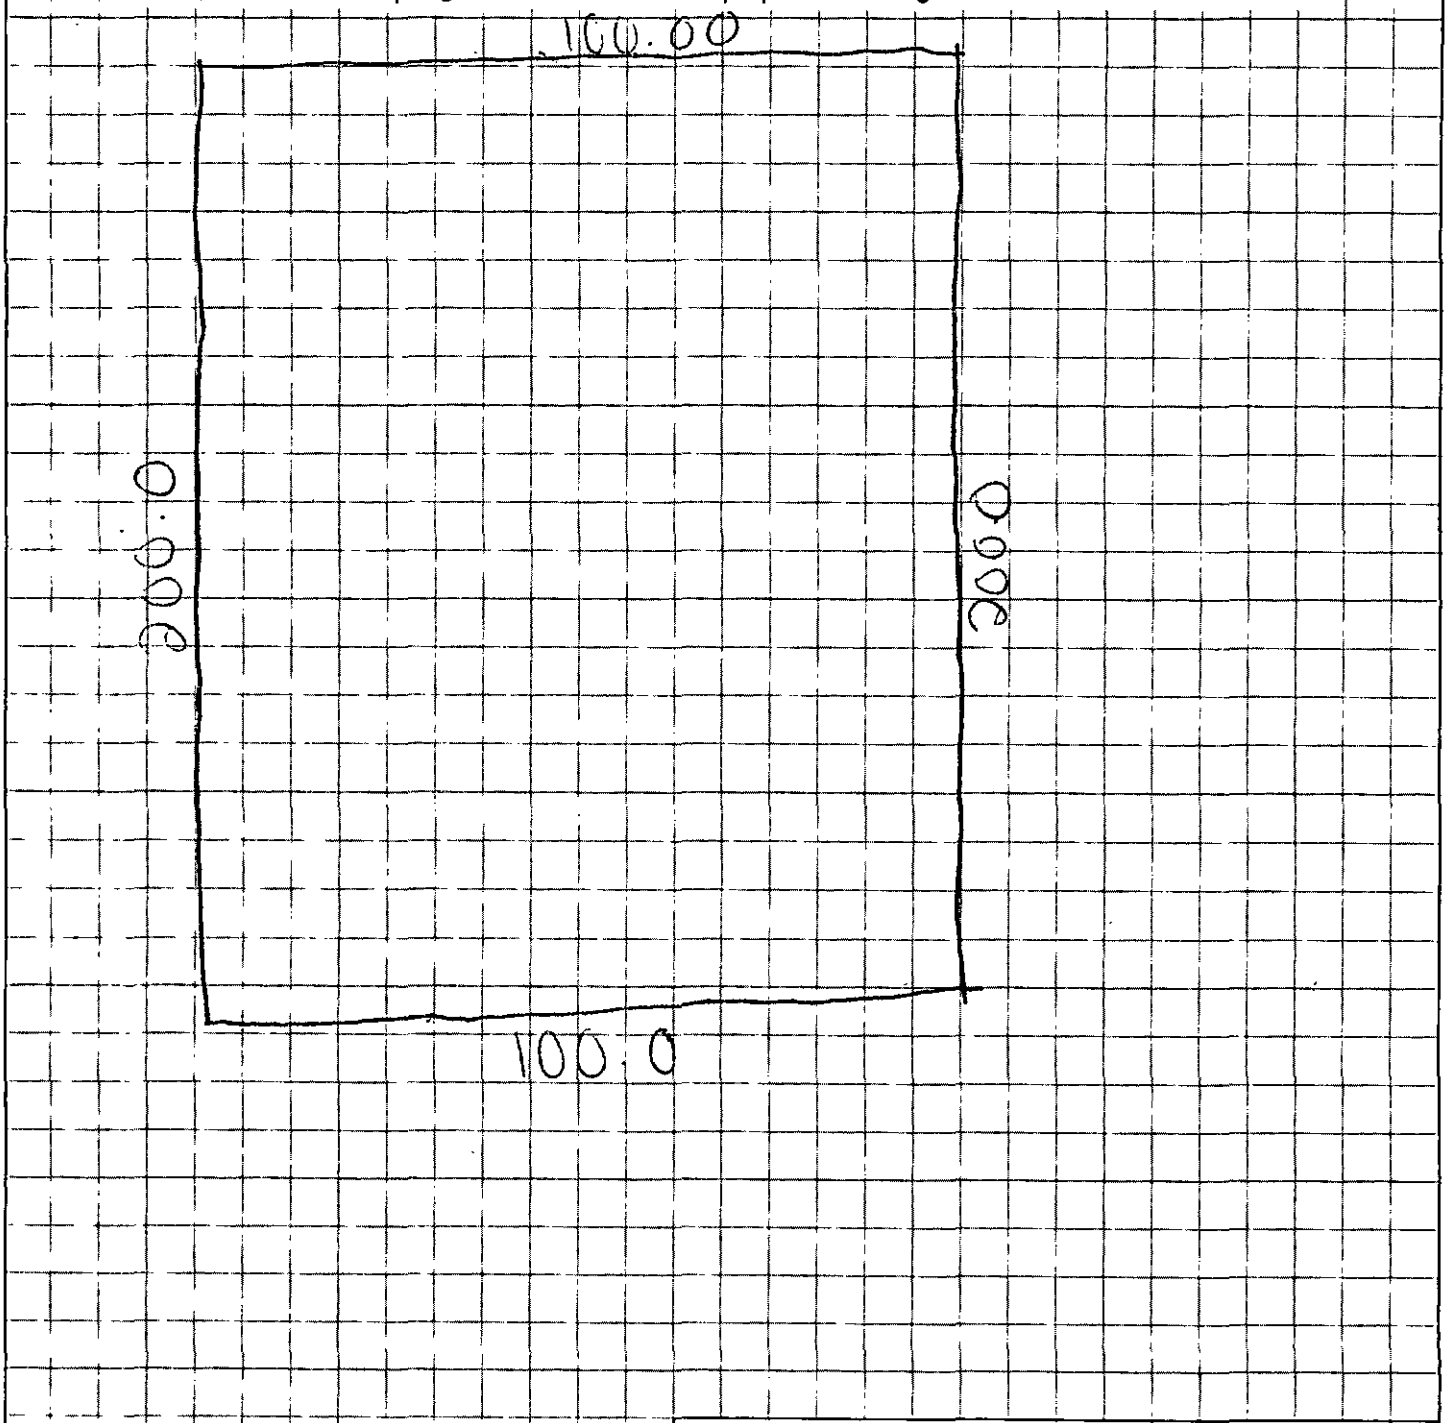

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

Pd 50.00 Ck # 9/18/92 () CRT

Sale #648B/8519A)

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date:

PERSON FILING APPLICATION:
NAME: Hill (last) Cora (first) B. (mi)
ADDRESS: 5717 Thompson RD PHONE: (704) 394-1708
CITY: Charlotte STATE: NC ZIPCODE: 28216

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 037-114-04
STREET ADDRESS: OFF THOMPSON RD (5700 BLK)
ZONING:

PROPERTY OWNER:
NAME: Hill (last) Cora (first) B (mi)
ADDRESS: 5717 Thompson RD PHONE: (704) 394-1708
CITY: Charlotte STATE: NC ZIPCODE:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

[X] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[X] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 2 NUMBER OCCUPANTS: 2

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Cora B. Hill Date: 9/18/92

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

_____
Environmentalist Date

_____
Director or Authorized Section Head Date

WATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 648B / 8519A.

TC: 037-114-04.

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

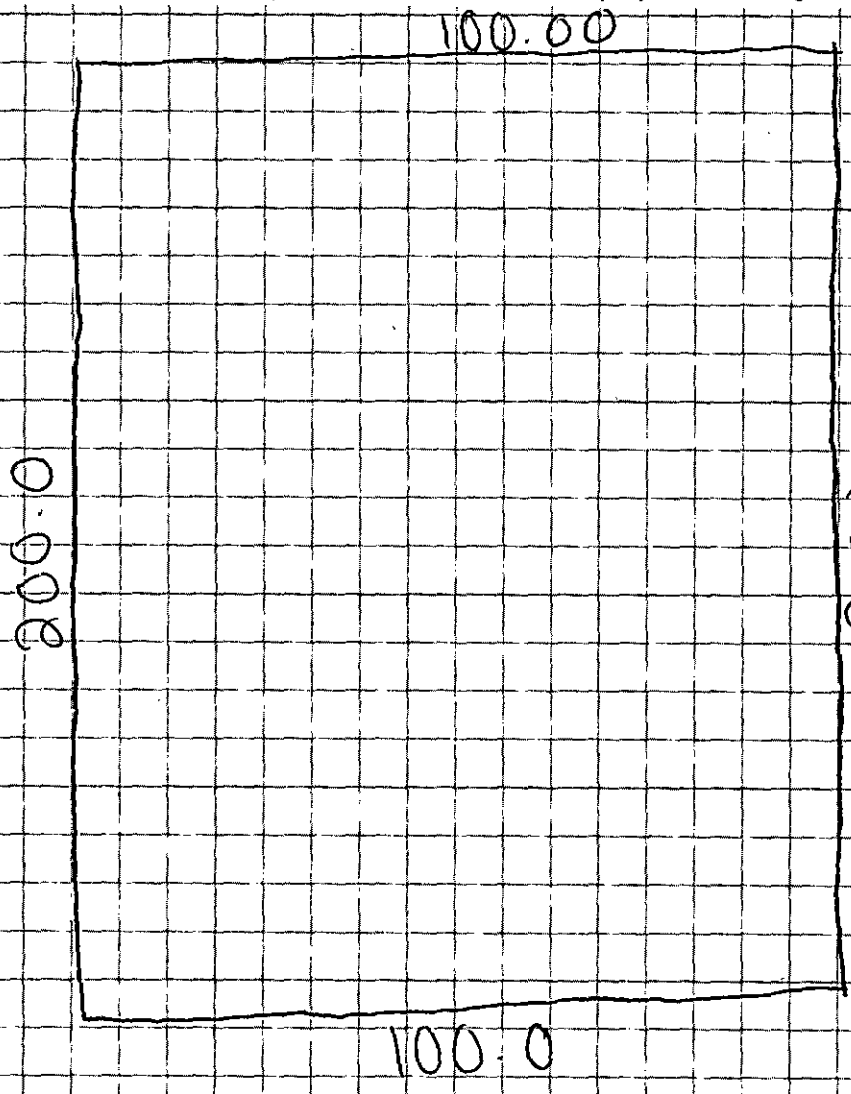

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

6400 648B / 8519A

FILE: N/A DATE: 9-15-92

TC: 195-041-11 ☒ L ☐ CRT

SERIAL Nº 15545

Name of Owner JANET HOWELL Juris.:

Address of Property 4100 RIVENDELL LANE

Inspection Data:

Tank Material 1992 REPAIR

Total Length of Drainfield 300

Number of Lines 3 @ 100

Cover Depth 20"

Water Supply Source COMMUNITY

Distance to Water Source 100'+

Excavation Inspected 9-15-92

Tank(s) Inspected —

Wash Line Inspected —

High Water Alarm Inspected —

PLOT

Design: 1992 REPAIR CTR#

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☑ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☑ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

12400


648 B 8519A

FILE: N/A DATE: 9-9-92

TC: 195-041-11 X L

SERIAL Nº 13488

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated _____. All work shall be completed on or before 10-9-92, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

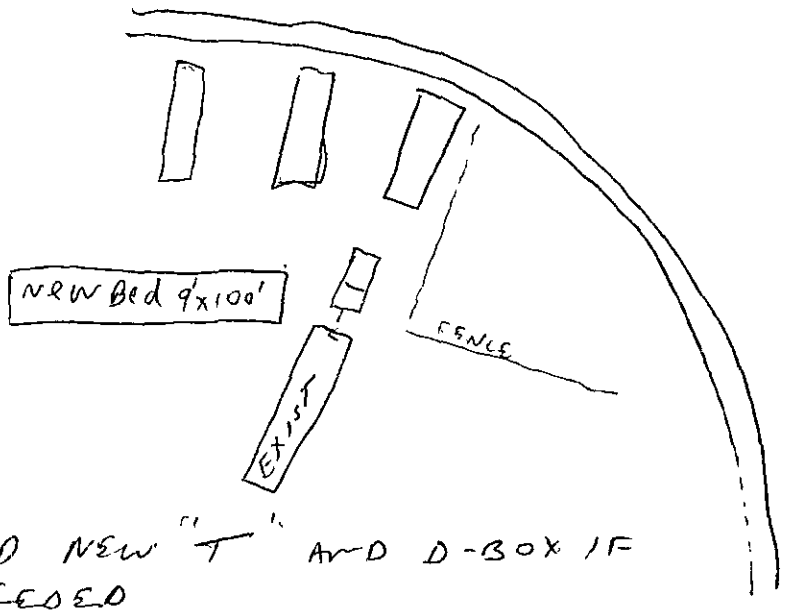

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1992 REPAIR gallons

Liquid Capacity of Dosing Tank _____ gallons

Tank Construction _____

Absorption and/or Nitrification Lines:

Trench Width 9'x100' feet

Total Line Length 300' feet

Number of Lines 3

Depth of Stone 12" inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 100'+ feet

NAME OF OWNER JANET HOWELL (DOGWOOD TRAIL MHP)

LOCATION OF PROPERTY 4100 RIVENDELL LANE

Comments: 1 Bed 9'x100'x12" rock - serves Lot 13, 14, 15

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

6048B

Supervisor/Administrative Professional Checklist

New Septic ☐ **New Well** ☐ **Use Existing** ☑ **Alteration** ☐ **Modified Plot Plan** ☐

New Septic Fees Paid:

IP ($250.00) _____ Initials/Date

CA ($200.00) _____ Initials/Date

OP ($200.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 lwa 6/28/13 Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☐ Reviewed ☐ ____

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☐ _____ Well file completed. ☐ _____

Send permit for signature. ☐ Signature received. ☐ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

648B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

Appt # 6277

APPLICATION FOR APPROVAL TO USE AN EXISTING
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ☑ SEPTIC ONLY ○ WELL ONLY ○ SEPTIC & WELL
○ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE
○ ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE
☑ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: FRANKLIN A. TYSON
ADDRESS: 3601 STARMOUNT AVE.
CITY: CHARLOTTE, N.C.
STATE: N.C. ZIP: 28269
PHONE: 704 502 2951
ALTERNATE PHONE: 704 596-5932
E-MAIL: _____

PROPERTY OWNER: ☑ SAME AS PERSON FILING APPLICATION
NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
PHONE: _____
ALTERNATE PHONE: _____
E-MAIL: _____

JOB LOCATION INFORMATION
TAX PARCEL #: 03711404
STREET ADDRESS: [redacted]5725 Thompson Rd.
CITY: CHARLOTTE, N.C.
STATE: NC ZIP: 28216

SUBDIVISION OR MOBILE HOME PARK NAME: _____
LOT #: _____

WATER SUPPLY:
○ MUNICIPAL ☑ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

RESIDENTIAL PROPERTY TYPE: ○ N/A
○ HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
☑ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER _____

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 2
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☑ N/A
TYPE OF BUSINESS: _____
EMPLOYEES PER SHIFT: _____
OF SHIFTS: _____
INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER _____

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER _____

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Franklin A. Tyson
Owner's/Agent's Signature

6-27-13
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 06/28/13
Receipt #: 84527
Check / Auth #: CASH
Received By: BEACHMS

Amount: 100.00
Tendered: 100.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: Tyson, Franklin
Attn:
Address: 3601 Starmont Avenue
Address:
City/State/Zip: Charlotte, NC 28269

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod 5725 Thompson Road		1	100.00	100.00

Outstanding Balances


Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
40.00	50.00	40.00	1,297.15		

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

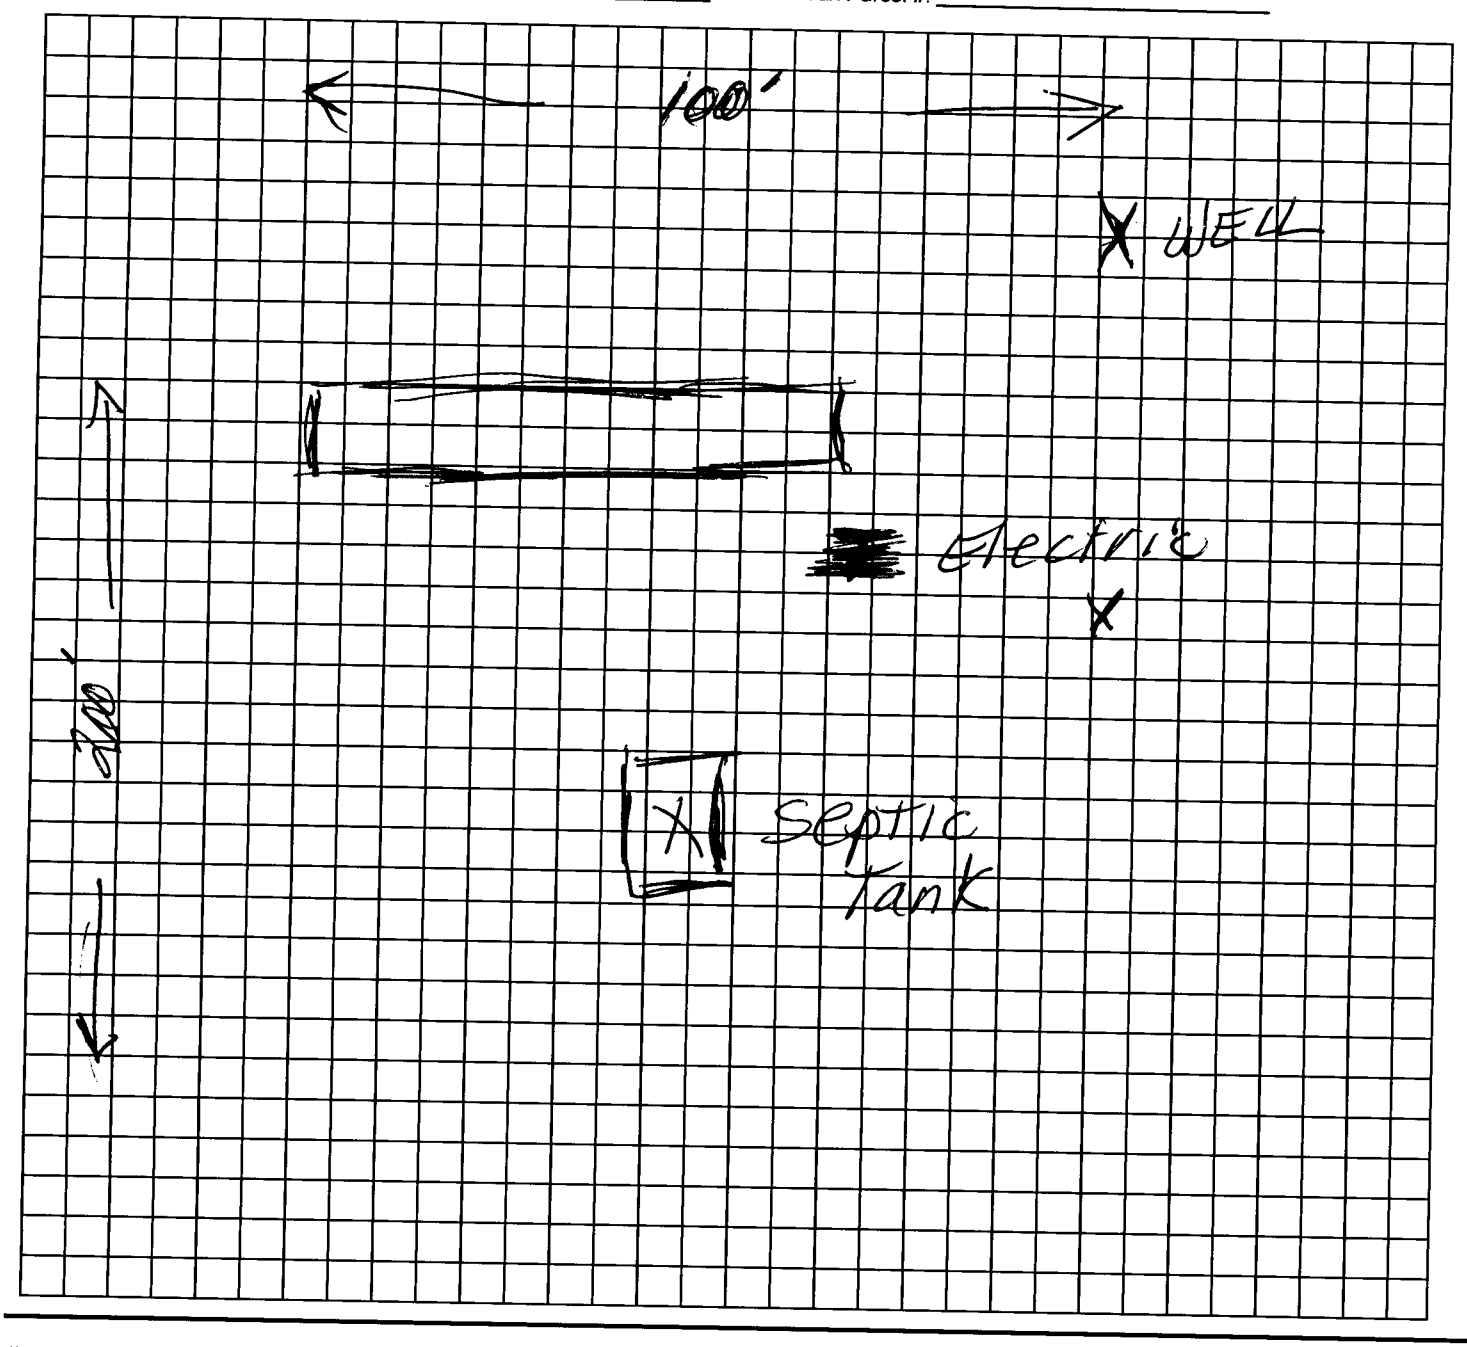

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

O.K. TO ADS FOR A
2 Bedroom MOBILE HOME Exchange

REHS Signature _____ Date 7/8/13

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11