Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 4750B WASPS App #: _____

Primary ES assigned to project: DJ

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 6			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR .25	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☑
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 3-18-08

OP issued date: 3 19 08

Review performed by: IR

Date performed: 4-9-08

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

195-103-02

File #: 4750 B Permit #: _____ Tax Parcel #: _____

Property Owner: Hobart Smith

Job Location Address: 1375 THOMPSON PLACE DR.

City: MINT HILL State: NC Zip Code: _____

Installation Approval Issuance Date: 03-18-08

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 04-18-08, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: 0.25 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons MAY NEED TO BE PUMPED

Drainfield Design ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 480 feet

# of Lines: 4 @ 120 feet or 5@100

Depth of Media: 36 inches (Type) 25% Reduction

Distribution Device: D-Box - Unless pumped.

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks


Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

System will have to be pumped if Drain lines can not be kept within 36" of ground surface.

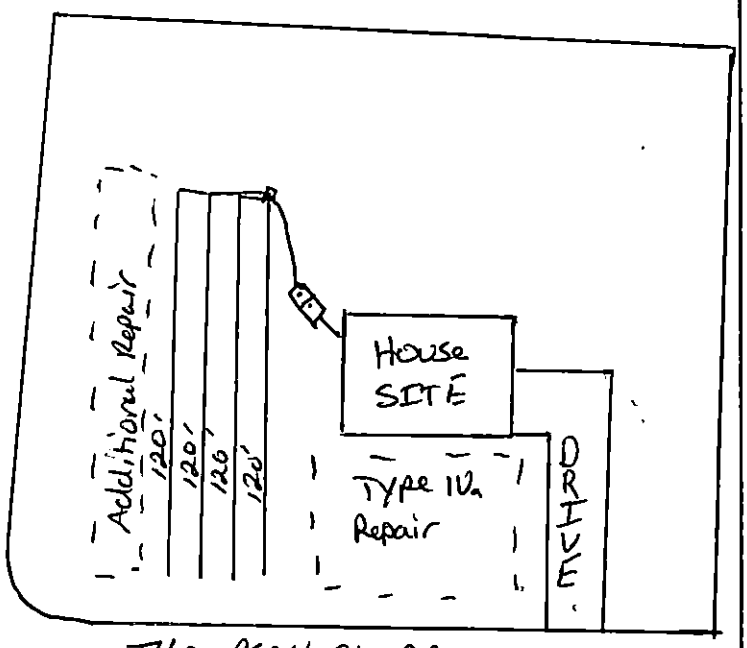

Comments: System Classification & Type: IIIg

DENR Authorized Agent: Jeremy Michee Signature: Jeremy Michee

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4750B Permit #: _____ Tax Parcel #: 195-103-02

Property Owner: Hobart Smith

Job Location Address: 1375 THOMPSON PLACE DR.

City: MINT HILL State: NC Zip Code: _____

Operation Permit Issuance Date: 3-19-08 Contractor Name: RCS

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons 7-31-07

Liquid Capacity of Dosing Tank: 1000 gallons 6-19-07

Effluent Pump Model: _____

Drainfield Installation ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 480 feet

# of Lines: 4 @ 120 feet

Depth of Media: 12 inches (Type) E2 Flow

Depth of Cover: 24 inches

Distribution Device: Pressure Manifold.

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet


Inspection Dates

Tank(s) Inspected: 3-19-08

Excavation Inspected: 3-19-08

Pump & Controls Inspected: 3-19-08

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

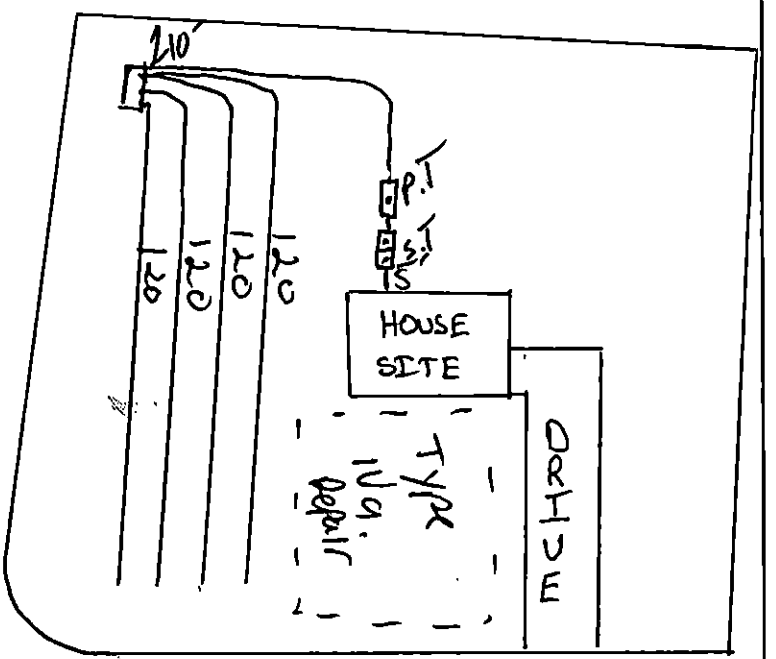

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIb Pump to E2 Flow

DENR Authorized Agent: Jeremy Michael Signature: Jeremy Michael

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4750B Permit #: _____ Tax Parcel #: 195-103-02

Property Owner: HOBart SMITH

Job Location Address: 1375 THOMPSON PLACE DR.

City: MINT HILL State: NC Zip Code: _____

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIb

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☐

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

_____

_____

_____

_____

DENR Authorized Agent: Jeremy Michael Date: 3-19-08

Signature: Jeremy Michael


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4750 B

TC: 195 - 101 - 091? O.

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

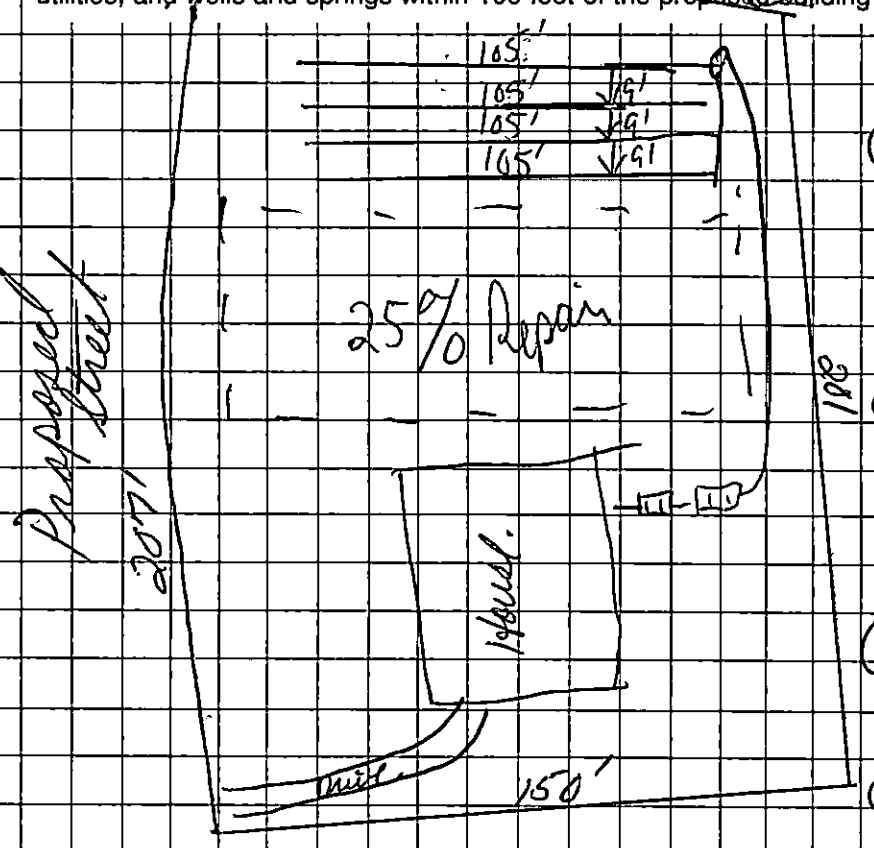

① Scale 1" = 50'

② 1500 ST 1000 DT, 420 linear feet Innovative Drain Line

③ 35% Reduction system requires Warranty and Agreement forms

④ Keep lines level and on contour

⑤ Stay > 10' off all property lines ≥ 5' off bldg foundation

⑥ Type III system requires 5 year maint. inspection by local health department at owners expense.

⑦ Any deviation from this plot plan requires re-evaluation by the local health department to assure that the septic system will not be impacted

OWNER/AGENT SIGNATURE

DATE 11/6/03

APPROVAL DATE

704 289 - 5560

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

mit Number: 475013 CONDITIONS OF IMPROVEMENT PERMIT Tax Number: [illegible]

The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.

CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.

Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ___ Yes ✓ No ___ Partial Basement

Type Primary Wastewater System Type (circle one): I II (III) IV V VI

___ Conventional
___ Prefabricated, permeable block panel system
___ Shallow Placed Conventional
___ Low Pressure Pipe
___ Large Diameter Pipe
___ Fill
___ Other
✓ Innovative or Experimental:
___ IWWS-93-1
___ IWWS-93-2
___ IWWS-94-1

.25 Long-term acceptance rate	480 Max gallons/day wastewater flow	1260 Absorption Area (sq ft)	9' Trench spacing (min. on centers)
N Serviced by private well	1500 Gallon septic tank	420' Total trench length (ft)	36" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
4 Bedrooms in residence	1000 Gallon pump tank	N/A Depth of stone	

Any surface waters present: NO, Type: Minimum separation distance:

Site modifications required:

Additional Conditions: Type III B system will require 5 year maint inspection by local Health dept @ owners' expense Warranty and agreement forms required

Repair Area System Type Type (circle one): I II (III) IV V VI

___ Conventional
___ Prefabricated, permeable block panel system
___ Shallow Placed Conventional
___ Low Pressure Pipe
___ Large Diameter Pipe
___ Fill
___ Other
✓ Innovative or Experimental:
___ IWWS-93-1
___ IWWS-93-2
___ IWWS-94-1

1440 Absorption Area (Sq ft) 480 Total Trench Length (Ft)	N/A Depth of Stone Trench	9' Trench spacing (min. on centers)	36" Maximum Trench Depth

For existing system, enter the year originally installed:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.
- This Improvement permit is transferable.

Joshua R. Sellers R.S. IREHS
DEHNR Authorized Agent — Date 11-05-03

Owner/Agent Signature — Date 11/6/03

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

10/1/03 chk 1948 ACS

FEE: 150 AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION
DATE: VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE

DATE: 11-05-03 13715 PERMIT NO: 47503
PARCEL NO: 195-101-09
JOB LOCATION ADDRESS: Lot 11 Thompson Place.
PROPERTY OWNER: Robert Smith Homes.
BUILDING CONTRACTOR: Same.
SUBDIVISION NAME: Thompson Pl.
AUTHORIZATION ISSUED BY: _____ DATE: 11-05-03
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 47503, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: Type III B system requires 5 year maint inspection @ owners expense & Warranty and agreement forms required.

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE 11/6/03 DATE

FEE: 150
DATE: 10/1/03
DICA

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

I J CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 47503

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 19510109

STREET ADDRESS: Thompson Rd

SUBDIVISION OR MOBILE HOME PARK NAME: Thompson PLACE

LOT NUMBER: 11

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
✓ 7 MINT HILL

CLOSING DATE _____

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
✓ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: 4

NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT
___ ON SLAB
✓ CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
___ SHARED WELL (S)
✓ MUNICIPAL (M)
___ OTHER 'SPRINGS' (O)
___ PRIVATE WELL (P)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ✓ NO
EXISTING WASTEWATER SYSTEMS ___ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS ✓ YES ___ NO
WELL, SPRINGS OR WATERLINES ___ YES ✓ NO
DESIGNATED WETLANDS ___ YES ✓ NO

PROPERTY OWNER:

NAME: Homes Hobart Smith
(LAST) (FIRST) (MI)

ADDRESS: 3703 Catrobe Dr. Ste. 240

CITY: Charlotte STATE: N.C. ZIP: 28211

DAYTIME PHONE: (704) 365 - 6830

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) -

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: [signature] Pres. DATE: 10/1/03

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: _____


TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately diminsion the lot concerned. Accurately indicate property boundaries, proposed and/or exisitng structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building and drainfield.

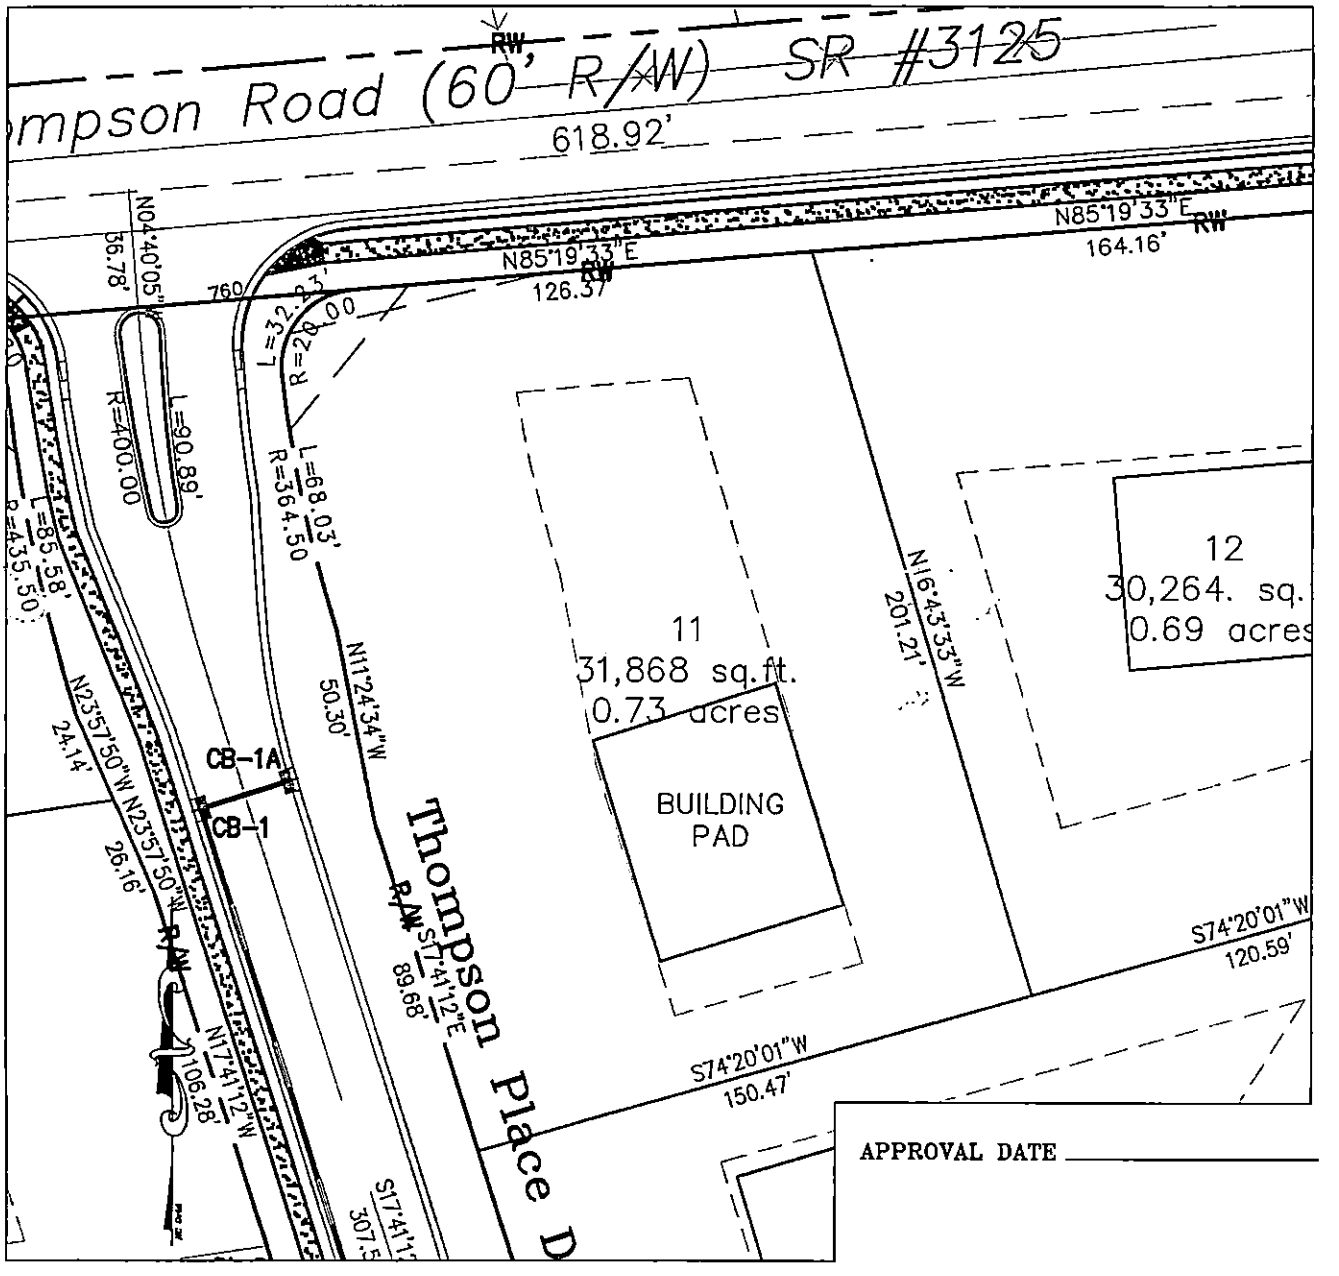

APPROVAL DATE _____

1"=50'

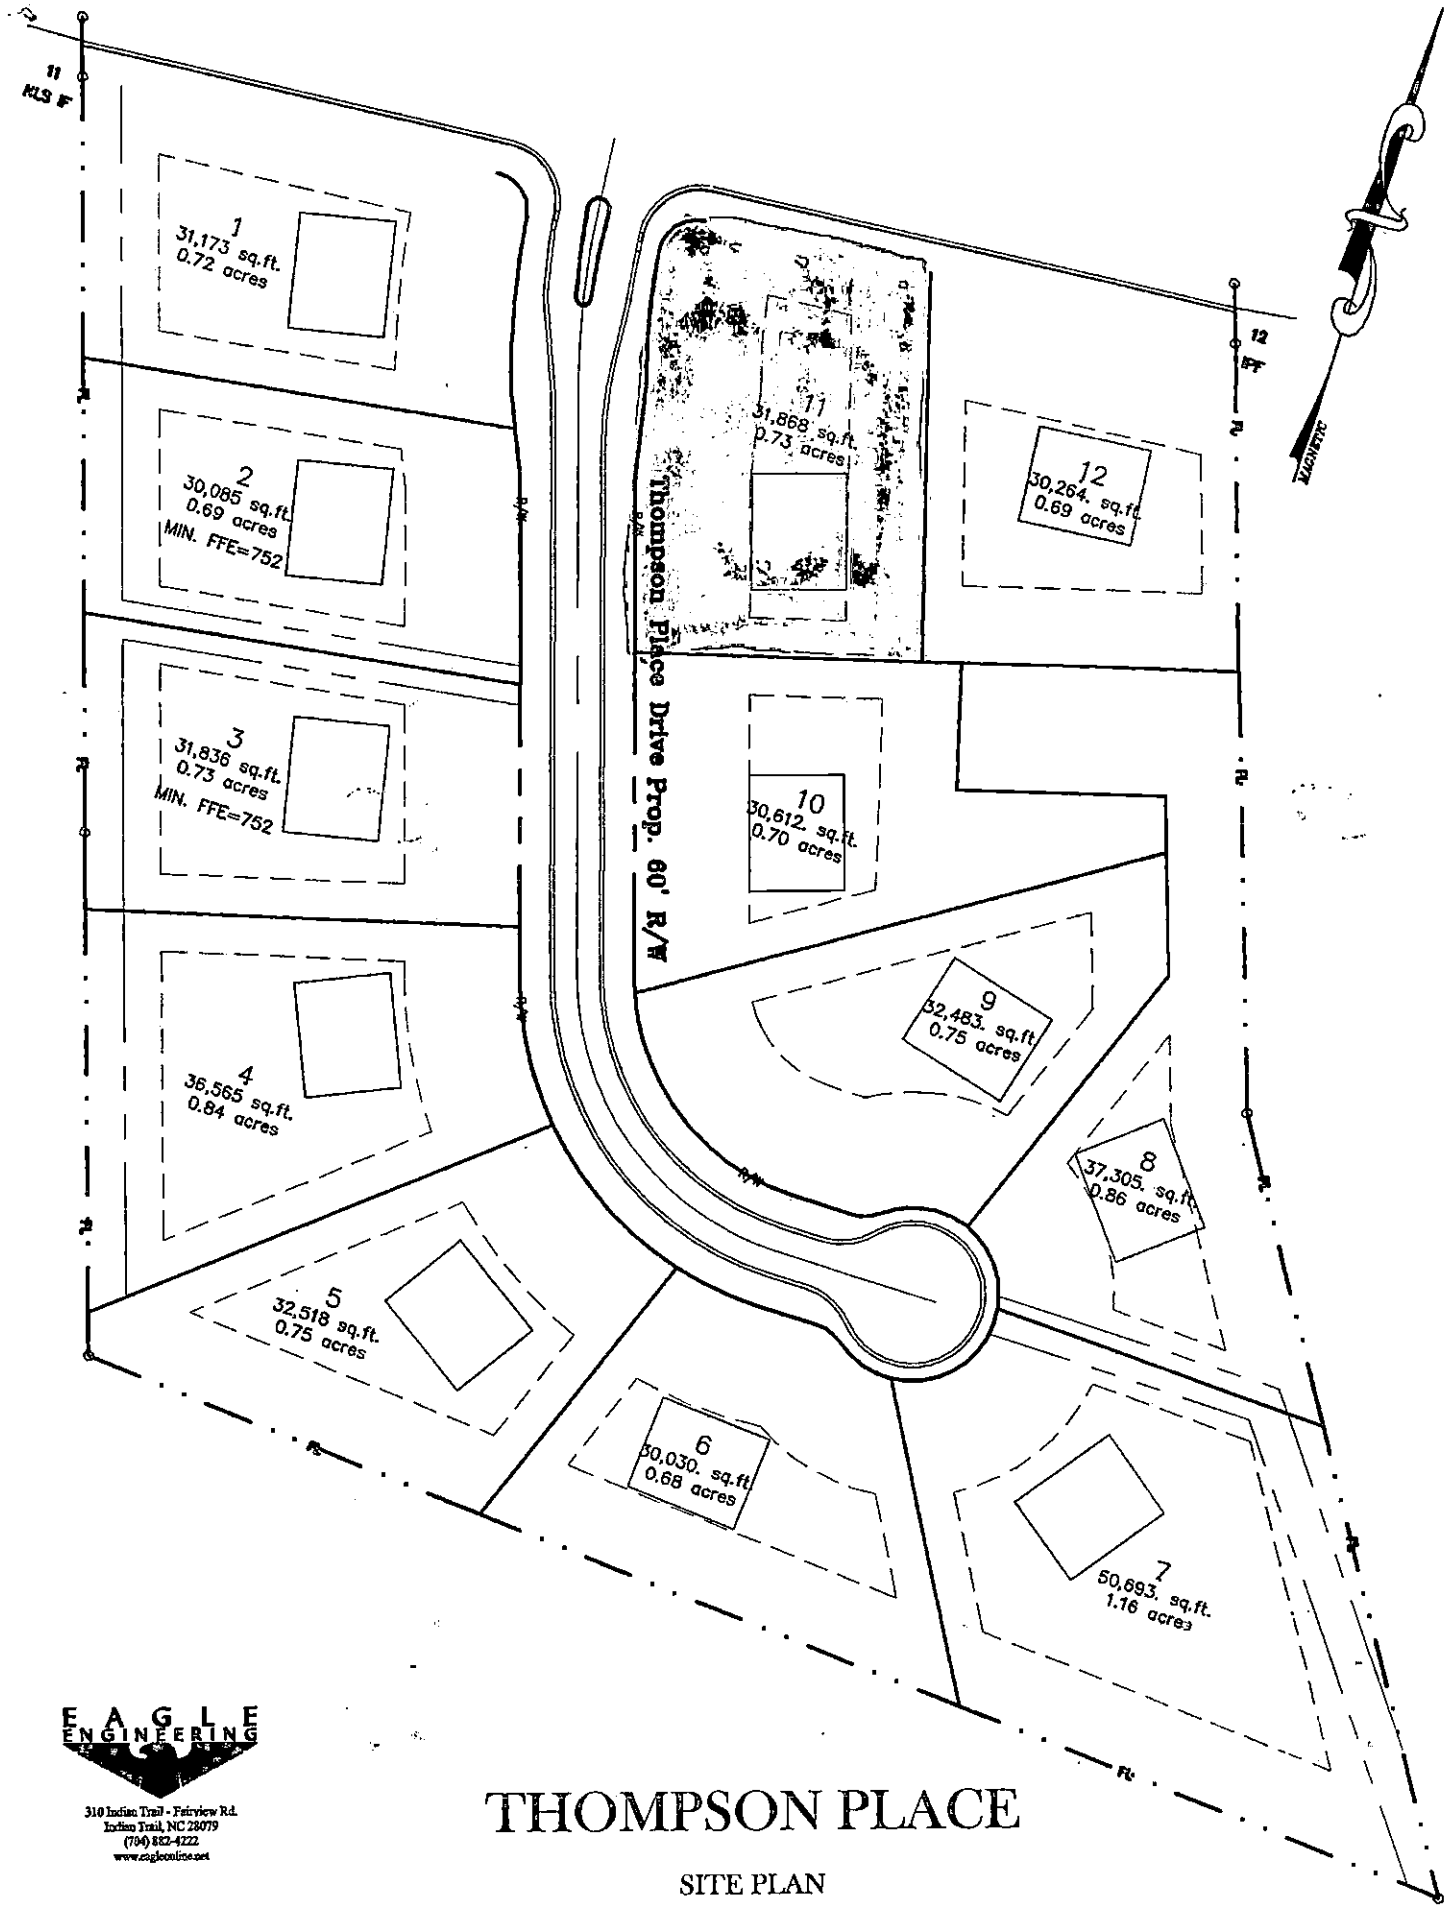

EAGLE ENGINEERING
310 Indian Trail - Fairview Rd.
Indian Trail, NC 28079
(704) 882-4222
www.eagleonline.net

THOMPSON PLACE

SITE PLAN

SCALE: 1" = 100'

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1
Property ID: PO 195-101-09
Lot #: 11
File #: 4750B
Code: 1

AC

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Kevin Pressley
Applicant:
Address: 7125 Secrest Short Cut Road, Indian Trail, N. C. 28079
Date Evaluated: 10/9/01
Proposed Facility: residence
Design Flow (.1949): 480gpd
Property Size: .73a
Location of Site: Thompson Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
	5-10								
1	LS	0-5	GR/SL	FR/SEXP/NS/NP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV .275G/FT^2/DAY
		5-34	SBKI/ABK/C	FI/SEXP/S/P					
		34-48	ABK/SBK/C	FI/SEXP/S/P					
2	"	0-3	GR/SL	FR/SEXP/NS/NP	>45" TO SOIL WETNESS	45	"	"	PS, IV .25G/FT^2/DAY
		3-6	GR/SCL	FR/SEXP/SS/SP					
		6-45	ABK/SBK/C	FI/SEXP/S/P					
3	"	0-5	GR/SCL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	"	"	"
		5-48	ABK/SBK/C	FI/SEXP/S/P					
4	"	0-5	GR/SCL	FR/SCL	"	"	"	"	"
		5-24	SBK/C	FI/SEXP/S/P					
		24-48	ABK/SBK/C	FI/SEXP/S/P					
5	"	0-5	GR/SCL	FR/SEXP/SS/SP	"	"	"	"	"
		5-24	SBK/ABK/C	FI/SEXP/S/P					
		24-48	ABK/SBK/C	"					
6	"	0-3	GR/SL	FR/SEXP/NS/NP	>29" TO SOIL WETNESS	29	"	"	US, IV
		3-5	GR/SCL	FR/SEXP/SS/SP					
		5-29	ABK/C	FI/SEXP/S/P					
		PLATY	@27"						

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.25G/FT^2/DAY	.25G/FT^2/DAY

Other Factors (.1946): _____
Site Classification (.1948): PROVISIONALLY SUITABLE
Evaluated By: W. R. Marlin, LSS, 10/10/01, W. R. Marlin
Others Present:

FILE # 4750B

COMMENTS 100 To Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE	
MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC


STRUCTURE

SG-SINGLE GRAIN
M-MASSIVE
CR-CRUMB
GR-GRANULAR
SBK-SUBANGULAR BLOCKY
ABK-ANGULAR BLOCKY
PL-PLATY
PR-PRISMATIC

MINERALOGY

SLIGHTLY EXPANSIVE

EXPANSIVE

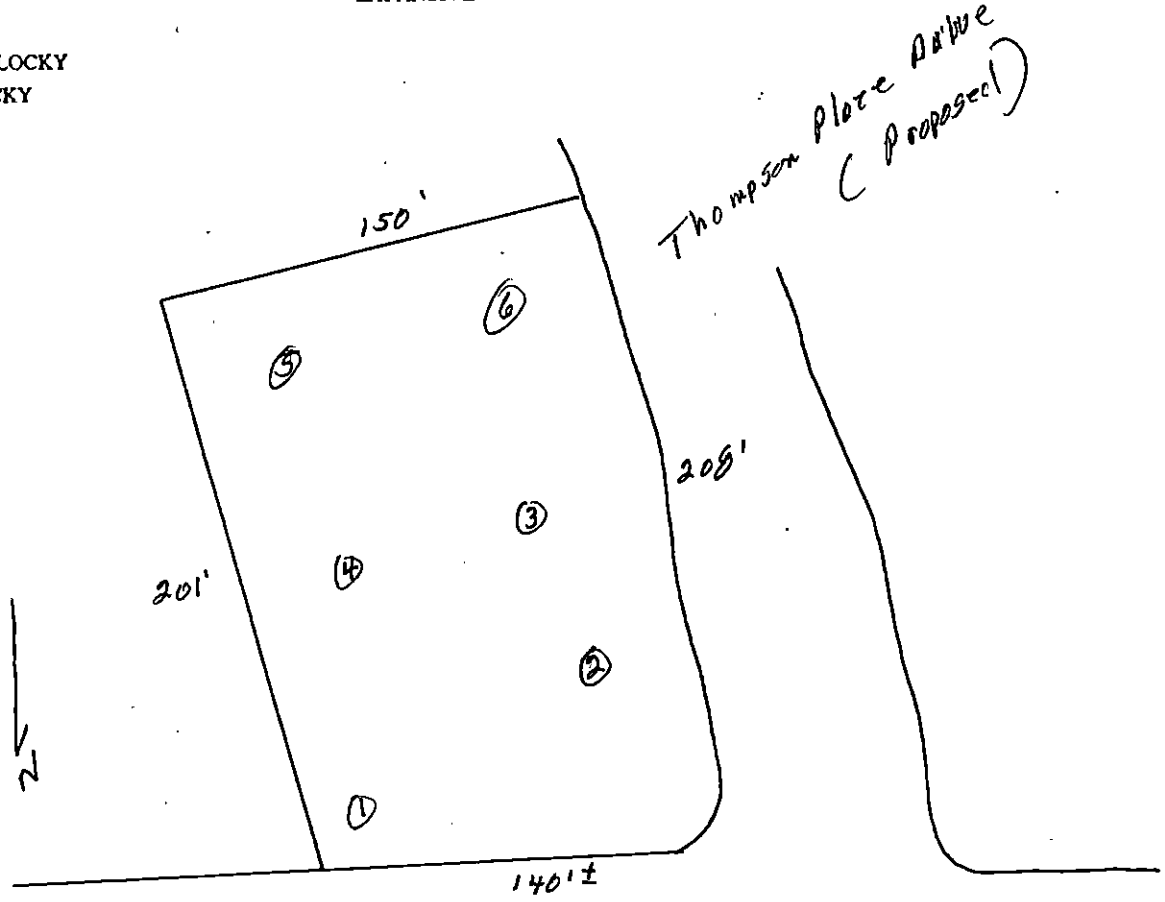

FEE: _____
DATE: 9/13/01

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

Paid 200 - C/C 9/13/01 RF.

[ ] CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 4750B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 195-101-09 P.O

STREET ADDRESS: Thompson Road

SUBDIVISION OR MOBILE HOME PARK NAME: Thompson Place Subdivision

LOT NUMBER: 14

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
X HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
X 7 MINT HILL

HEATED SQUARE FOOTAGE: 3,000

NUMBER OF BEDROOMS: 4 NUMBER OF OCCUPANTS: 5

CLOSING DATE _____

FOUNDATION FOR RESIDENCE:

X WITHOUT BASEMENT
___ ON SLAB
X CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES X NO TYPE: _____

WATER SUPPLY (CHECK ONE):
___ COMMUNITY (C)
X MUNICIPAL (M)
___ PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES X NO
EXISTING WASTEWATER SYSTEMS ___ YES X NO
EASTMENTS OR RIGHT-OF-WAYS ___ YES X NO
WELL, SPRINGS OR WATERLINES ___ YES X NO
DESIGNATED WETLANDS ___ YES X NO

PROPERTY OWNER:

NAME: Pressley Kevin
(LAST) (FIRST) (MI)

ADDRESS: 7125 Seorest Short Cut Rd

CITY: Indian Trail STATE: NC ZIP: 28079

DAYTIME PHONE: (704 882- 2571

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) -

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: _____ DATE: 9-5-01


MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

PROPOSED PLOT PLAN

FILE: 4750 B
TC: 195.101.PO


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

Draw in and name all roads adjoining the property. Draw in and accurately diminsion the lot concerned. Accurately indicate property boundaries, proposed and/or exisitng structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building and drainfield.

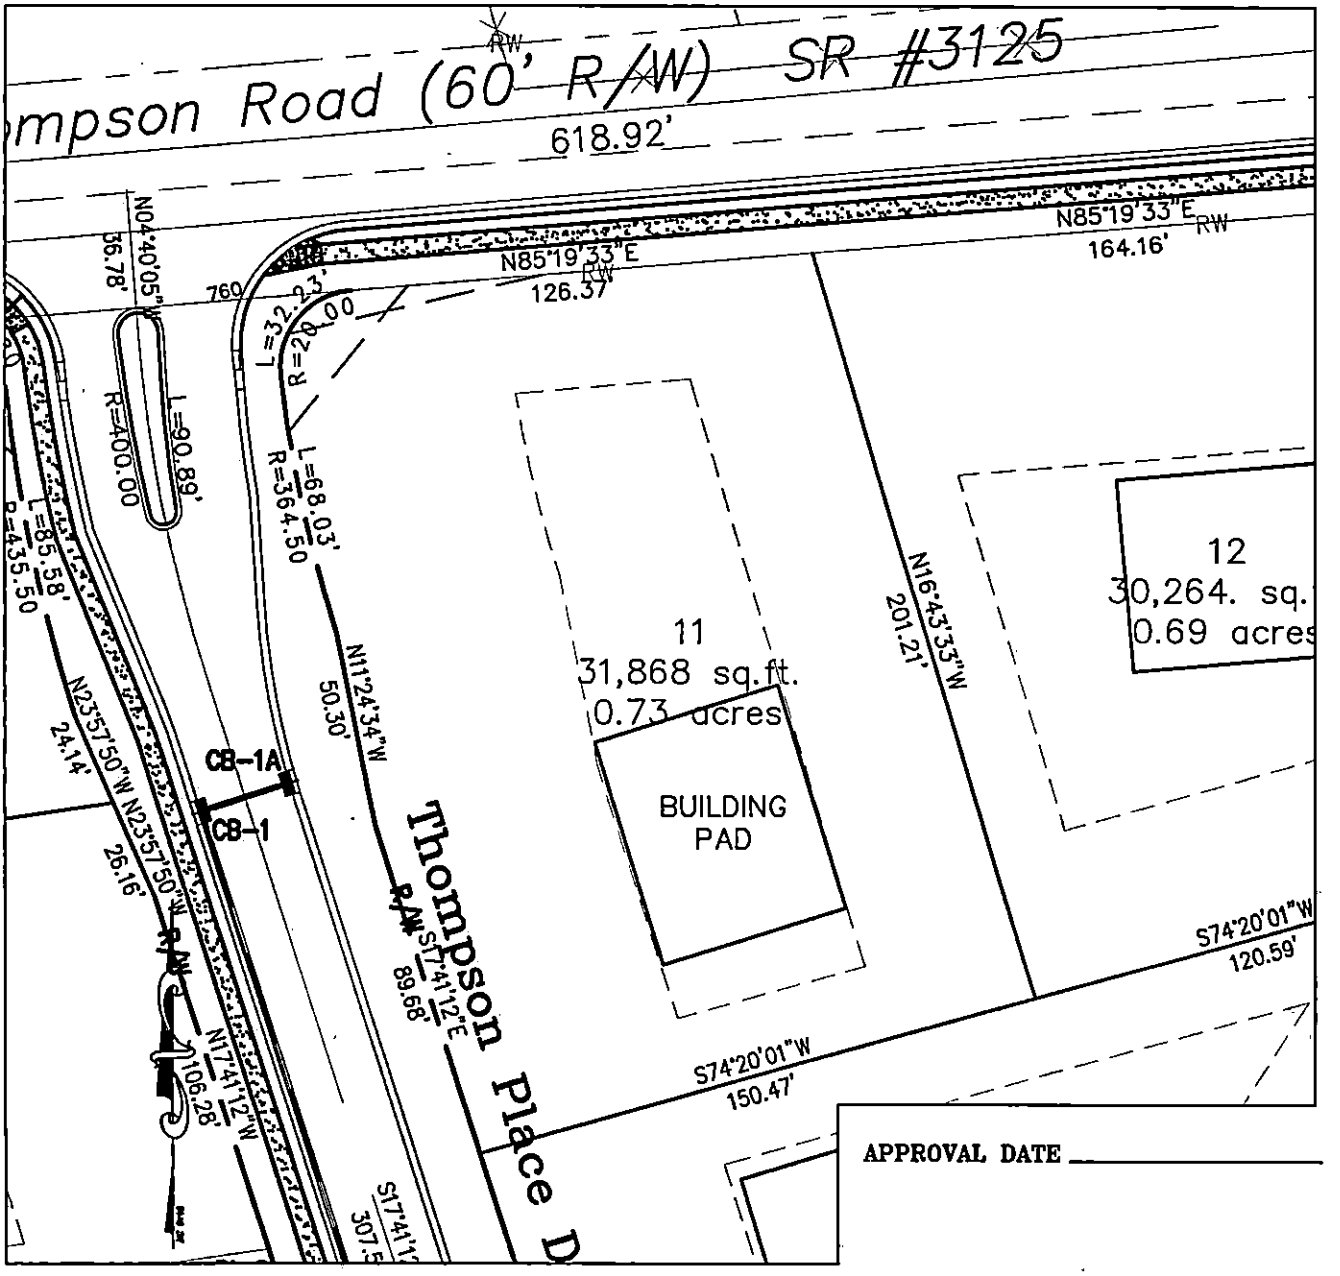

1"=50'

LOT # 11

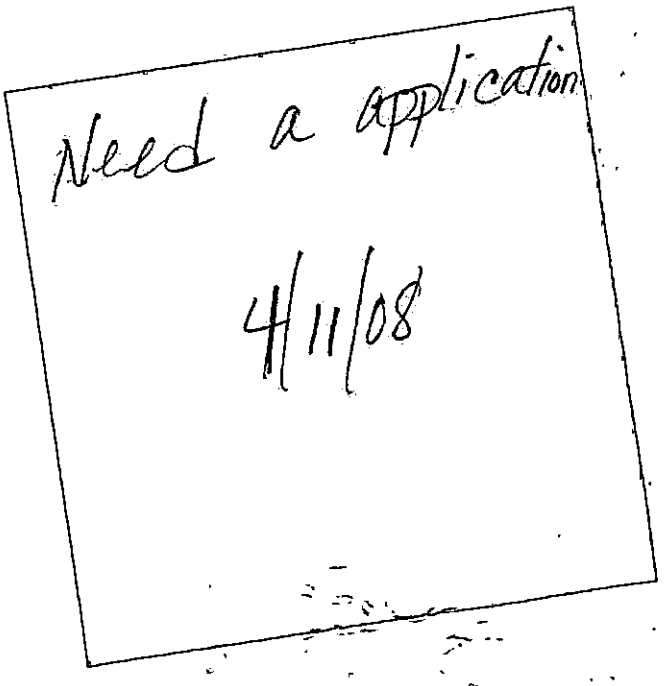
Need a application
4/11/08