

15531 MCAULEY RD


01113117

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Line	Bearing	Distance
L1	S 33° 43' 40" W	140.00'
L2	N 33° 15' 25" E	121.04'

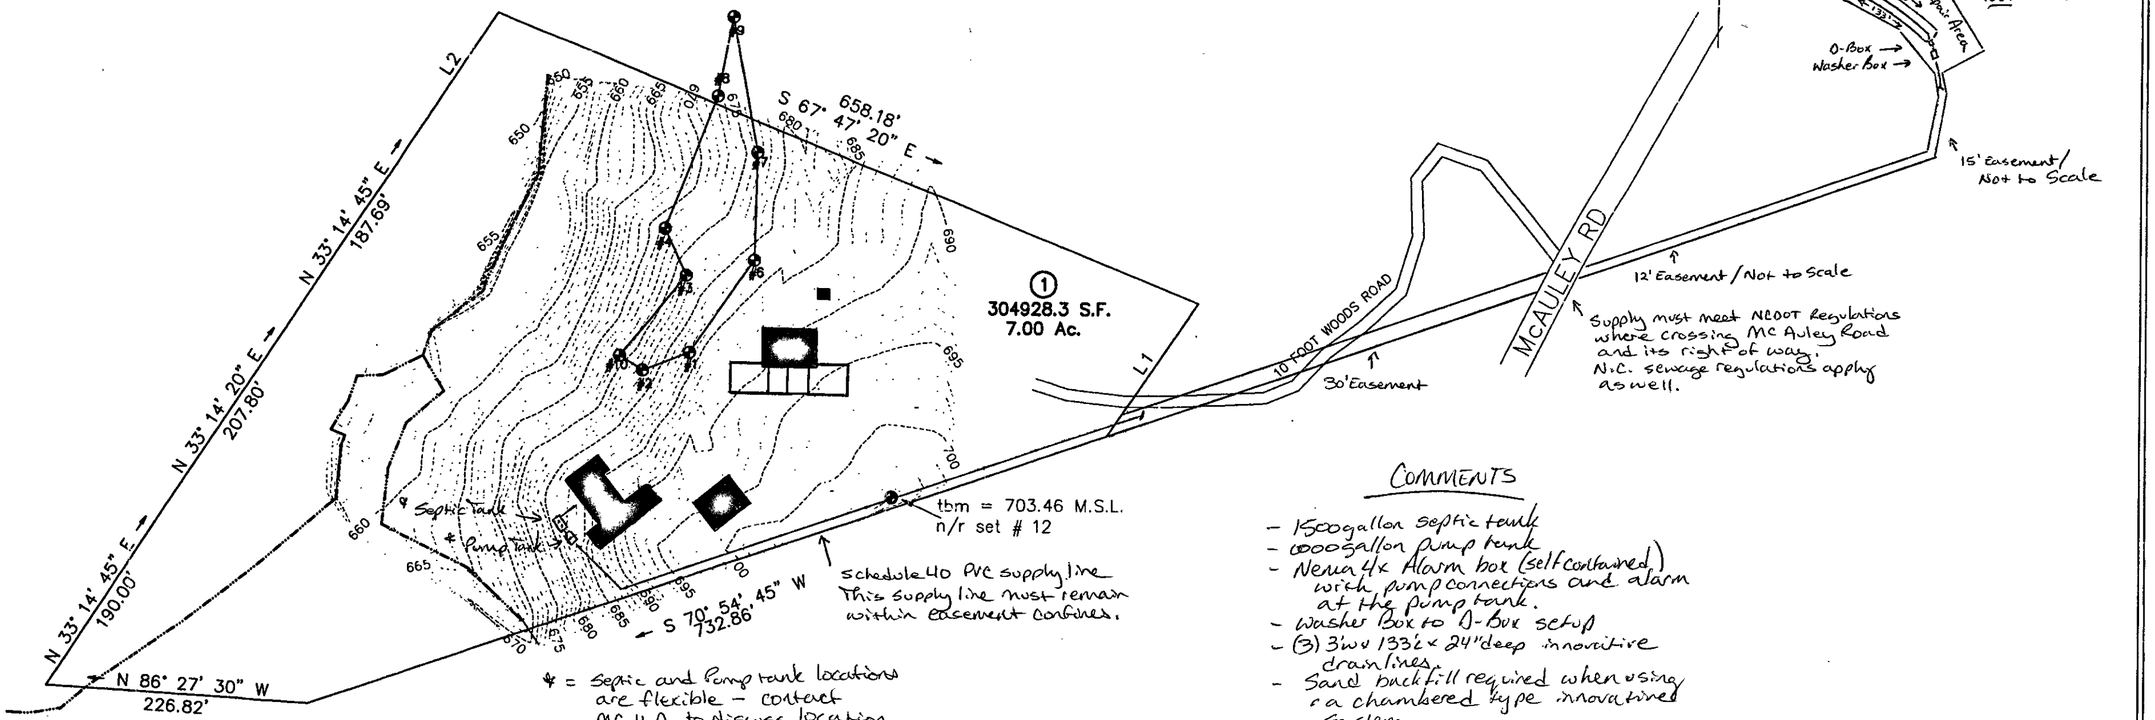

* = Septic and Pump tank locations are flexible - contact MC, H.D. to discuss location options.

COMMENTS

- 1500gallon septic tank
- 6000gallon pump tank
- Nema 4/x Alarm box (self contained) with pump connections and alarm at the pump tank.
- Washer Box to O-Box setup
- (3) 3'w x 133'± x 24"deep innovative drainlines.
- Sand backfill required when using a chambered type innovative system.

1 FOOT CONTOUR INTERVAL

100 50 0 100 200

SCALE OF DRAWING IS 1 INCH = 100 FEET

Survey for: File # 3834/B

FB: 95-XX PG: XX
PSD: 9500XX-X
DWG: 9500XX-X

Wilkins & Associates
Land Surveying Consultants
Post Office Box 665
Mooresville, NC 28115
191-B West Plaza Drive
Tel. (704) 663-5566

Project # 950177-1
Date: 2 APRIL 96

TITLE
TITLE
McAULEY ROAD (SR 2425)
HUNTERSVILLE TOWNSHIP
MECKLENBURG COUNTY, NORTH CAROLINA