Date Received 8-28-84

RECEIVED
AUG 28 1984
ENVIRONMENTAL HEALTH

IOAR(S) Application No. 1241

T. C. No. 035-142-05


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ___ Install (or Construct 2) X Alter or Repair an individual septic tank wastewater treatment system with a (subsurface, soil absorption, effluent discharge.

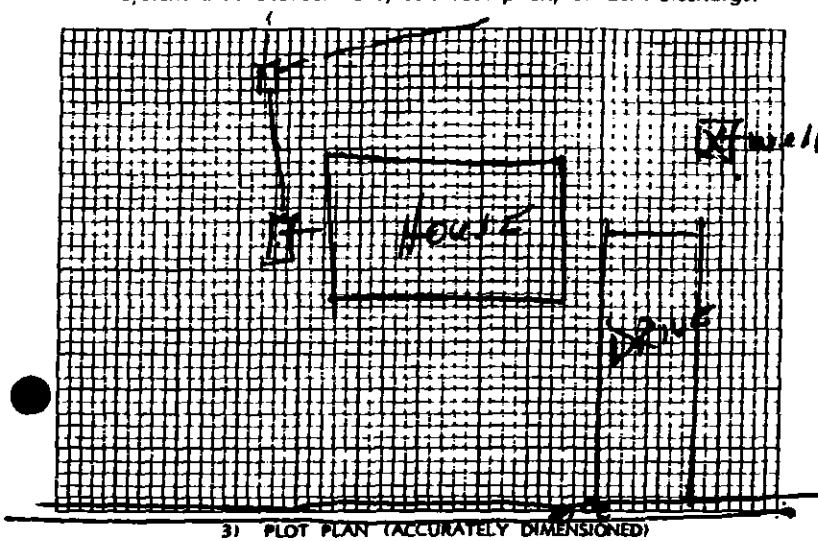

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes X No
Residence X Yes ___ No
4) No of Bedrooms 2
5) Business Use - Max No Employees ___
6) Washing Machine X Yes ___ No
7) Garbage Disposal ___ Yes X No
8) Dishwasher ___ Yes X No
9) Water Supply
A) Individual Well X
B) Governmental System ___
C) Community System:
1. Well source ___
2 Governmental source ___
10) Sewage System:
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No
11) FHA Case No. ___
12) VA Case No. ___

13) NAME OF OWNER Severs (LAST) Ethel (FIRST) Bigger's (MIDDLE)

14) ADDRESS OF OWNER 9224 McClure Circle, Charlotte, N.C.

15) PHONE NO. Home 319-6132 Office ___

16) LOCATION OF SYSTEM 8224 McClure Circle (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. 05 Block No. 14 2

Map Book No. 035 Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

8/27/84
DATE OF APPLICATION

Pamela W Rodgers Agent for Ethel B Severs
OWNER

EHD-5-76

Environmental Health Department's Copy

Date Issued 8-29-84

Serial No. 07490


ICAR(S) Permit No. 1241

T. C. No. 035-142-05

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ____ Install or Construct, X Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 1241, dated 8-27-84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before SEPT 14 1984, after which date this permit shall be null and void. BED

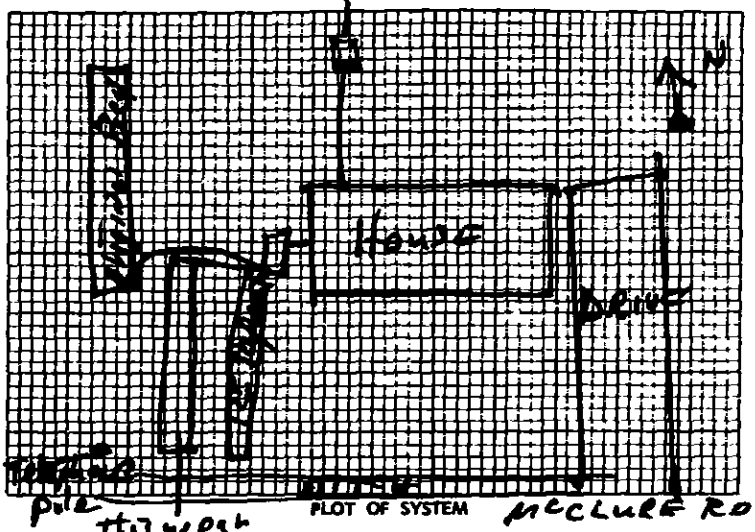

Permeability Rate 4 LTB

Liquid Capacity of Tank ____

Tank Construction Repair

Absorption and/or Nitrification Lines

Total Line Length 100 Lin FT

Number of Lines TWO

Distance from House 10 FT

Distance from Property Line 15 FT

Distance from Well 75 FT

NAME OF OWNER Mr SEVERS, ETHEL

LOCATION OF PROPERTY 8224 McCLURE CIRCLE

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Comments: ONE Bed To be 50FT X 6FT X 12 inches STONE - hay or STRAW Cover Check water in TWO existing BEDS for Blockage - USE NEW DIST, Box if Necessary

Division or Section Head

Ralph Miller
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-S-76

Environmental Health Department's Copy

C of A (s) No. 1241

Date Issued Sept 6th 1984 Serial 6936

T. C. No 035-142-05 L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF COMPLETION
CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner SEVERS, ETHEL (LAST, FIRST, MIDDLE)

Location of Property 8224 McCLURE CIRCLE

Application Number 1241 Permit Number 1241

Inspection Data:

Liquid Capacity of Tank Repair Tank Material Repair

Total Length of Drain Tile 150 LIN FT Number of Lines Two

Depth of Filter Material 12 inches Cover Depth 18 inches

Water Supply Source well Distance from Water Source 75 FT


Excavation Inspected 9-6-84 (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 9-6-84 (DATE)

Washing Machine Line inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been — installed or constructed, X altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Cust requested 50 additional ft - put in L shape

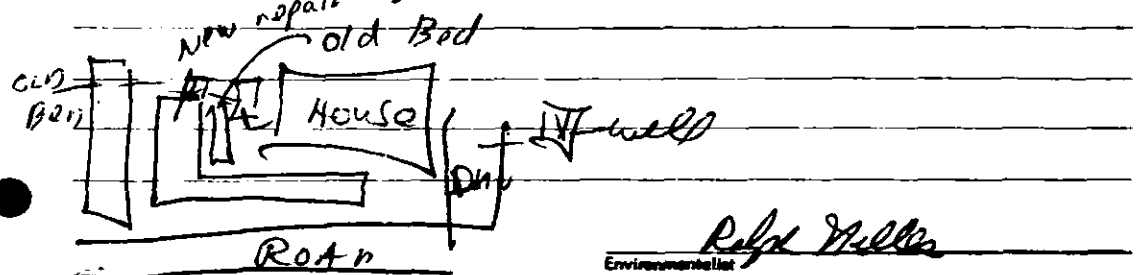

Environmentalist Ralph Miller

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY