SEE INSTRUCTIONS ON BACK

Date Received July 14, 1978

ICAR (S) Application No. [redacted]

P.O. T. C. No. 049-011-05A


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

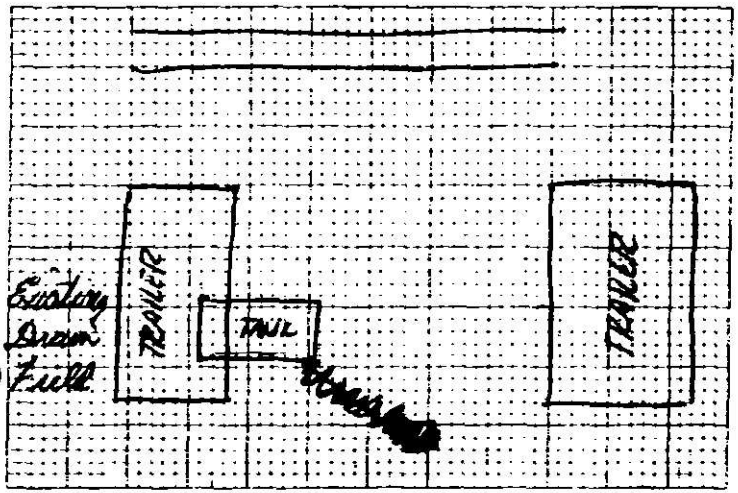

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ✓ Yes ___ No
Residence ___ Yes ___ No

4) No of Bedrooms _____
5) Business Use — Max No Employees _____
6) Washing Machine ___ Yes ___ No
7) Garbage Disposal ___ Yes ___ No
8) Dishwasher ___ Yes ___ No
9) Water Supply:
A) Individual Well _____
B) Governmental System _____
C) Community System:
1 Well source _____
2 Governmental source _____
10) Sewage System:
House located within 200 feet of public sewer ___ Yes ___ No
House located within 200 feet of community sewer ___ Yes ___ No
11) FHA Case No _____
12 VA Case No _____

13) NAME OF OWNER Thompson (LAST) D. (FIRST) L. (MIDDLE)

14) ADDRESS OF OWNER 5707 N. Tryon St. Charlotte NC 28213

15) PHONE NO. Home 597-8232 Office 597-8377

16) LOCATION OF SYSTEM 5710 Oak Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION Ocean Grove M.H. Park Lot No. 3 Block No. _____

Map Book No. _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN _____

20) PTR NUMBER (See Instructions) _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

7-13-78
DATE OF APPLICATION

D L Thompson
OWNER

EHD-5-76

Environmental Health Department's Copy

Date Issued July 29, 1978 Serial No. 1812


ICAR (S) Permit No. 19291

P.O. T. C. No. 049-011-054

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19291, dated _____ and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before _____, after which date this permit shall be null and void.

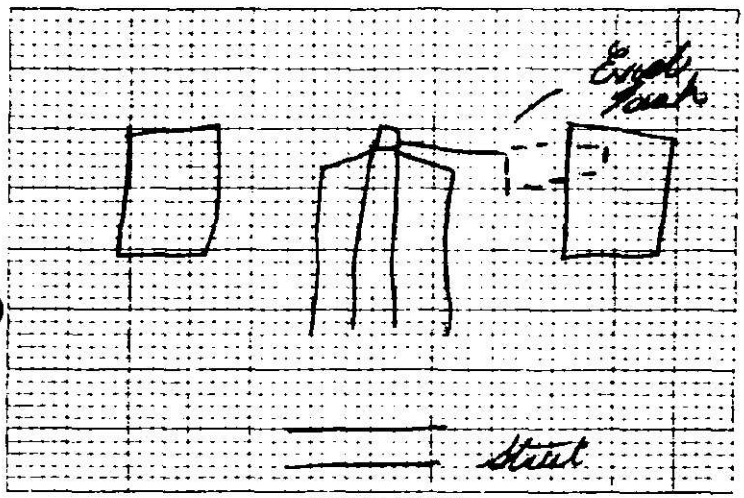

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank —

Tank Construction —

Absorption and/or Nitrification Lines.

Total Line Length 200 L/ft.

Number of Lines 5

Distance from House 15'

Distance from Property Line 15'

Distance from Well —

NAME OF OWNER D. L. Thompson

LOCATION OF PROPERTY Orr Rd.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments: 15x90'x17"

Division or Section Head

Eddie Reynolds
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued July 26, 1978 Serial No. 1733

C of A (s) No. 14291

P.O.T C. No. 059-011-054

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Thompson (LAST) D. (FIRST) L. (MIDDLE)

Location of Property On Rd.

Application Number 14291 Permit Number 14291

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 200 l/ft. Number of Lines 5

Depth of Filter Material 17" Cover Depth 13"

Water Supply Source — Distance from Water Source —

Excavation Inspected — (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 7-26-78 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Ellie Reynolds
Environmentalist

EHD-5-76

Environmental Health Department's Copy

SEE INSTRUCTIONS ON BACK

Date Received _____

ICAR (S) Application No. 19291

P.O. T. C. No. 049-011-05A


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) _____ Alter or Repair on individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

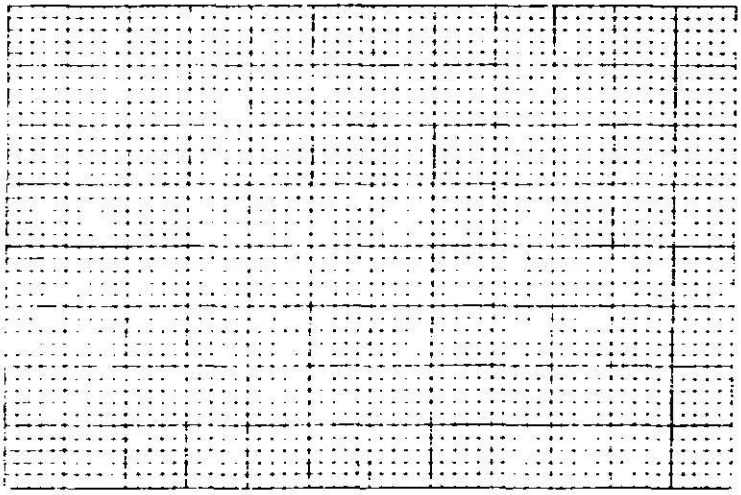

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) Mobile Home ✓ Yes ___ No
Residence ___ Yes ___ No

5) No. of Bedrooms _____

6) Business Use — Max. No. Employees _____

7) Washing Machine ___ Yes ___ No

8) Garbage Disposal ___ Yes ___ No

9) Dishwasher ___ Yes ___ No

10) Water Supply
A) Individual Well _____
B) Governmental System ✓
C) Community System
1 Well source _____
2 Governmental source _____

11) Sewage System
House located within 200 feet of public sewer ___ Yes ___ No
House located within 200 feet of community sewer ___ Yes ___ No

12) FHA Case No. _____

13) VA Case No. _____

13) NAME OF OWNER Thompson (LAST) Donald (FIRST) Lee (MIDDLE)

14) ADDRESS OF OWNER 5707 North Tryon St. Charlotte NC

15) PHONE NO. Home 597-8232 Office 597-8377

16) LOCATION OF SYSTEM 5709 5706 Orr Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION Pegram Grove Mobile Home Park Lot No. 28 Block No. _____

Map Book No. _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN _____

20) PTR NUMBER (See Instructions) _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

10-5-78
DATE OF APPLICATION

D L Thompson
OWNER

EHD-5-76

Environmental Health Department's Copy


Date Issued Oct. 5, 1978 Serial No. 2025 ICAR(S) Permit No. 14291

P.O. T. C. No. 049-011-054

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 14291, dated 10-5-78 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 10-8-78 after which date this permit shall be null and void.

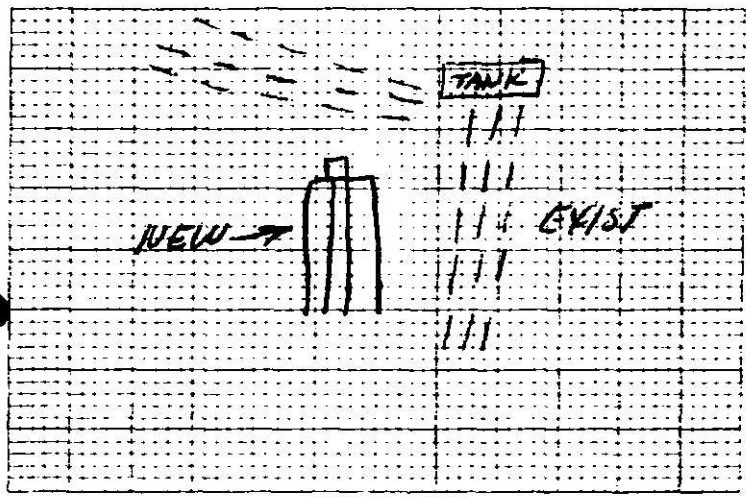

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank —

Tank Construction —

Absorption and/or Nitrification Lines

Total Line Length 100 L/Ft.

Number of Lines 4

Distance from House —

Distance from Property Line 10'+

Distance from Well NA

NAME OF OWNER Donald Lee Thompson

LOCATION OF PROPERTY Oak Rd.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. **The issuance of this permit does not in any way guarantee that the sytem anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments: 12' x 25' x 17" stone

Eddie Reynolds
Environmentalist

Division or Section Head

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued Oct. 6, 1978 Serial No. 1957

C of A (s) No. 14291

P.O. T. C. No. 049-011-054

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Thompson (LAST) Donald (FIRST) Lee (MIDDLE)

Location of Property Off 10.

Application Number 14291 Permit Number 14291

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 100 l/ft. Number of Lines 4

Depth of Filter Material 18" Cover Depth 15"

Water Supply Source — Distance from Water Source —

Excavation Inspected — (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 10-6-78 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ____ installed or constructed, ✓ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments: System will probably fail after short period of time. Ground saturated.

Eddie Reynolds
Environmentalist

EHD-5-76

Environmental Health Department's Copy